




- ELECTRICAL SERVICES**
- APPROXIMATE POSITION OF EXISTING HV CABLE
 - APPROXIMATE POSITION OF EXISTING LV CABLE
 - PROPOSED HV CABLE
 - PROPOSED LV CABLE
 - PROPOSED LV SERVICE CABLE
 - 150mm BLACK PLASTIC RIGIDUCT
 - 50mm ALKATHENE DUCT FOR ELECTRICITY SUPPLY (BLACK)
 - BREECH JOINT
 - STRAIGHT JOINT
 - POT END
 - SINGLE PHASE SERVICE CONNECTED TO RED PHASE
 - SINGLE PHASE SERVICE CONNECTED TO YELLOW PHASE
 - SINGLE PHASE SERVICE CONNECTED TO BLUE PHASE
 - THREE PHASE SERVICE
 - STREET LIGHTING COLUMN
 - 50mm DUCT FOR STREET LIGHTING
- WATER SERVICES**
- APPROXIMATE POSITION OF EXISTING WATER MAIN
 - PROPOSED WATER MAIN
 - SERVICE CONNECTION 25mm UNLESS STATED OTHERWISE
 - PE DUCT FOR WATER SUPPLY (BLUE)
 - WATER METERS/BULK METER LOCATION
 - SERVICE CONNECTIONS MANFOLD-- No. OF PORTS
 - FIRE HYDRANT
 - WASHOUT
 - TEMPORARY WASHOUT
 - VALVE
- GAS SERVICES**
- APPROXIMATE POSITION OF EXISTING GAS MAIN (MEDIUM PRESSURE)
 - APPROXIMATE POSITION OF EXISTING GAS MAIN (LOW PRESSURE)
 - PROPOSED GAS MAIN (MEDIUM PRESSURE)
 - PROPOSED GAS MAIN (LOW PRESSURE)
 - GAS SERVICE PIPE TO BE LAID INSIDE FLEXIBLE 50mm ID
 - PE DUCT FOR GAS SUPPLY (YELLOW)
 - SEM CONCEALED
 - RECESSED
 - MULTIBOX
 - METER
 - VALVE
 - SERVICE VALVE
 - REDUCER
 - END CAP
 - PRS

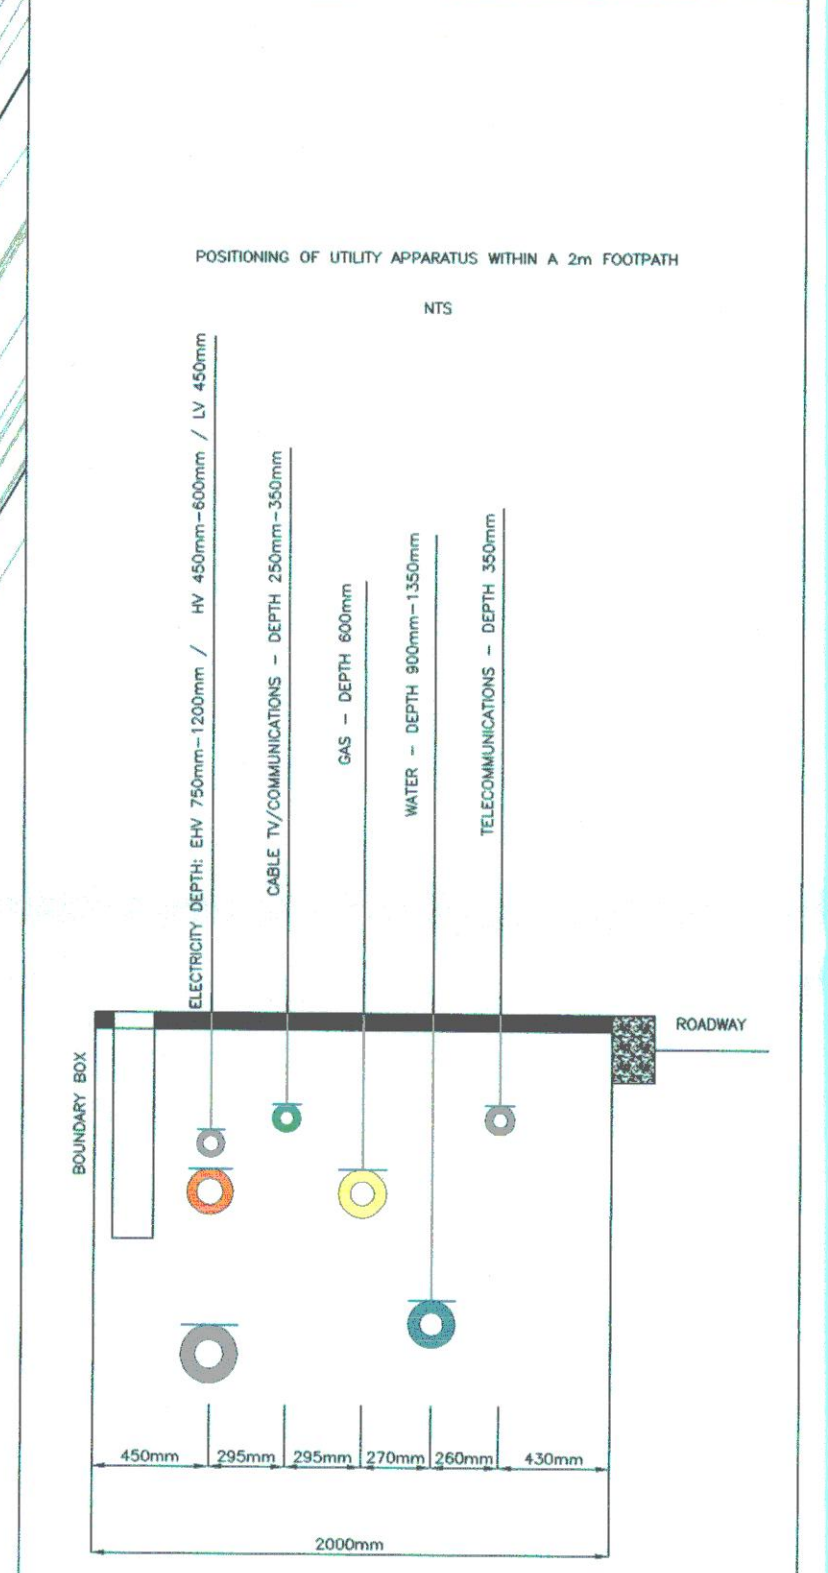

Plan No. 13/0227/013
 Approved/Amended Plans received
 20.8.14
 Form dated 14.8.14
 CHERMELL DISTRICT COUNCIL

INDICATIVE
 PURPOSES ONLY
 DO NOT SCALE

PROJECT
**SOUTHWEST BICESTER
 KM7&9**

Criterion 31

TITLE
WATER LAYOUT

REFERRING TO CUSTOMER DRAWING: **089/PRELM**

DATE: **03/10/2013** SCALE: **1:800**

DESIGNED BY: **RJ** DRAWN BY: **SA**

APPROVED BY: (Print Name) REV: **E**

DRAWING NO: **220920-KM7/9-MU04** SHEET SIZE: **A1**



SSE Utility Solutions
 Robert Brown House
 Pipers Way
 Thatcham
 RG19 4AZ

DATE	DETAILS OF REVISION	Rev by:	Rev:
03/10/13	An additional Gas and Water main added to KM9.	SA	E
20/08/13	Gas & Elec designs amended in line with service margins.	ME	D
26/07/13	Water mains extended at three points.	SA	C
25/07/13	Fire hydrants added.	SA	B
12/07/13	G,W,E added.	ME	A

Not all utilities are shown on this plan. Information with regard to such utilities should be obtained from the owners. The information shown on this plan is given without obligation, or warranty. The accuracy thereof cannot be guaranteed. All service pipes are not necessarily shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by SSE PLC, its agents or servants, for any error or omission. Safe digging practices, as detailed in Health and Safety booklet HS(G)47 'Avoiding danger from underground services', must be used to verify and establish the actual position of mains, services and other plant on site before any Mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct or contract labour) working for you.

THE INFRASTRUCTURE DESIGN INFORMATION CONTAINED WITHIN THIS DRAWING REMAINS THE PROPERTY OF SSE AND AS SUCH SHOULD NOT BE PASSED TO 3rd PARTIES WITHOUT PRIOR WRITTEN CONSENT.