

TYPICAL CARRIAGEWAY CROSS SECTION - BITUMINOUS CONSTRUCTION (SECONDARY STREET)

Aggregate Grading  
4/20 Sutton Courtenay Gravel in accordance with BS7533-13 with minimum 30% voids.

Sieve Size	Percentage Passing
40	100
31.5	100
20	91
10	38
4	4
2	1
0.063	0.1

Sub Base Grading Chart

Aggregate Grading  
2/6.3 Sutton Courtenay Gravel in accordance with BS7533-13 with minimum 30% voids.

Sieve Size	Percentage Passing
40	100
10	100
6.3	99
2	1
1	0
0.063	0.1

Clean Stone Grading Chart

The flakiness index, shell content and mechanical properties should be as set out in BS EN12620 for coarse graded crushed rock or gravel. The 10% fines value should be 150kN or more, when tested in accordance with BS812: Part 111: Testing Aggregates; with the amount of material passing the 75 micron sieve should not exceed 4%. Minimum void space of 30%.

\*Sub base & clean stone material to be Sutton Courtenay Gravel or Marchington Stone, to comply with the Marshalls grading chart shown. Marshalls approved the use of these materials on the 5th May 2011. Specific testing charts available on request.


- Notes**
- All levels relate to Ordnance Datum.
  - For adaptable roads and sewer details refer to drawings 5-200 series.
  - All connections to adaptable manholes from private building drainage to be 150mm diameter pipes unless otherwise specified.
  - All house drainage to be 100mm dia unless otherwise stated, and laid in accordance with current Building Regulations and BS801: 1995.
  - All drainage products are to be Polypropylene.
  - Pipe bedding material is to be Class II with 150mm minimum thickness surround.
  - Soakoff is to be by selected fill free of stones larger than 40mm, lumps of clay over 100mm, timber, frozen material and vegetable matter.
  - Pipe protection of house drainage runs is required in accordance with the Special House Drainage Details drawing. The contractor shall satisfy themselves and agree with the Site Management the actual extent of pipe protection required.
  - Pipes entering and leaving manholes/respection chambers shall include a rack pipe, 600mm in length.
  - Drainwork to chambers shall be Class D Engineering to BS5921.
  - Rainwater pipes are to be laid on side elevations whenever possible.
- Remarks**
- All retaining walls with a height of 600mm or greater are to include 1.2m high post and rail fencing unless located in rear gardens. Similar retaining walls in rear gardens are to include 900mm height post and rail.
  - All heights of steps to primary level access, with more than 2 steps are to be provided with handrails, except where the steps are 900mm or more apart.
  - Block retaining walls are to be used in preference to grand boards for front garden areas.

MARSHALLS ARE TO BE CONSULTED THROUGHOUT THE CONSTRUCTION OF THE POROUS PAVING SYSTEMS TO ENSURE COMPLIANCE WITH THEIR STANDARDS. THE CONTRACTORS ATTENTION IS DRAWN TO THE REQUIREMENT FOR THE POROUS PAVEMENT FORMATION TO FALL TOWARDS THE OUTFALL.


INFILTRATION POROUS PAVING SYSTEM - TO BE UNDERLAIN WITH A PERMEABLE MEMBRANE (TERRAM 1000 OR SIMILAR APPROVED)

AFTER MAIN CONSTRUCTION WORK IS COMPLETE, ON AREAS OF POROUS PAVING: 100mm DIA CORES ARE TO BE DRILLED INTO THE ROAD BASE AT 750mm CENTRES AND FILLED WITH LAYING COURSE MATERIAL. ROAD BASE TO BE MACHINE CLEANED PRIOR TO CORE DRILLING - EXCEPT WITHIN SERVICE MARGINS


PERMEABLE SUB BASE GRADING CHART AND REQUIREMENTS

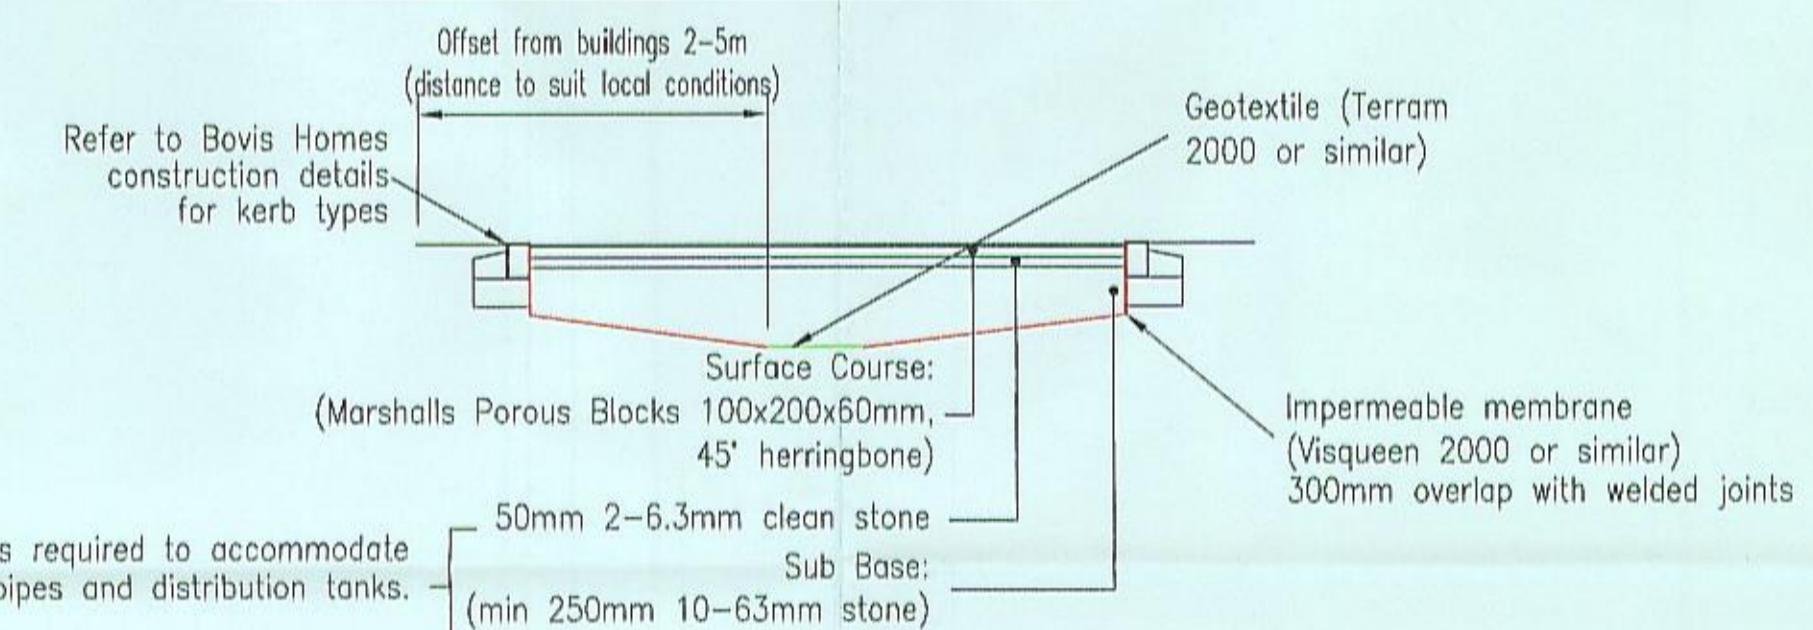


TYPICAL PRIVATE DRIVE CROSS SECTION - POROUS PAVING CONSTRUCTION INFILTRATION SYSTEM

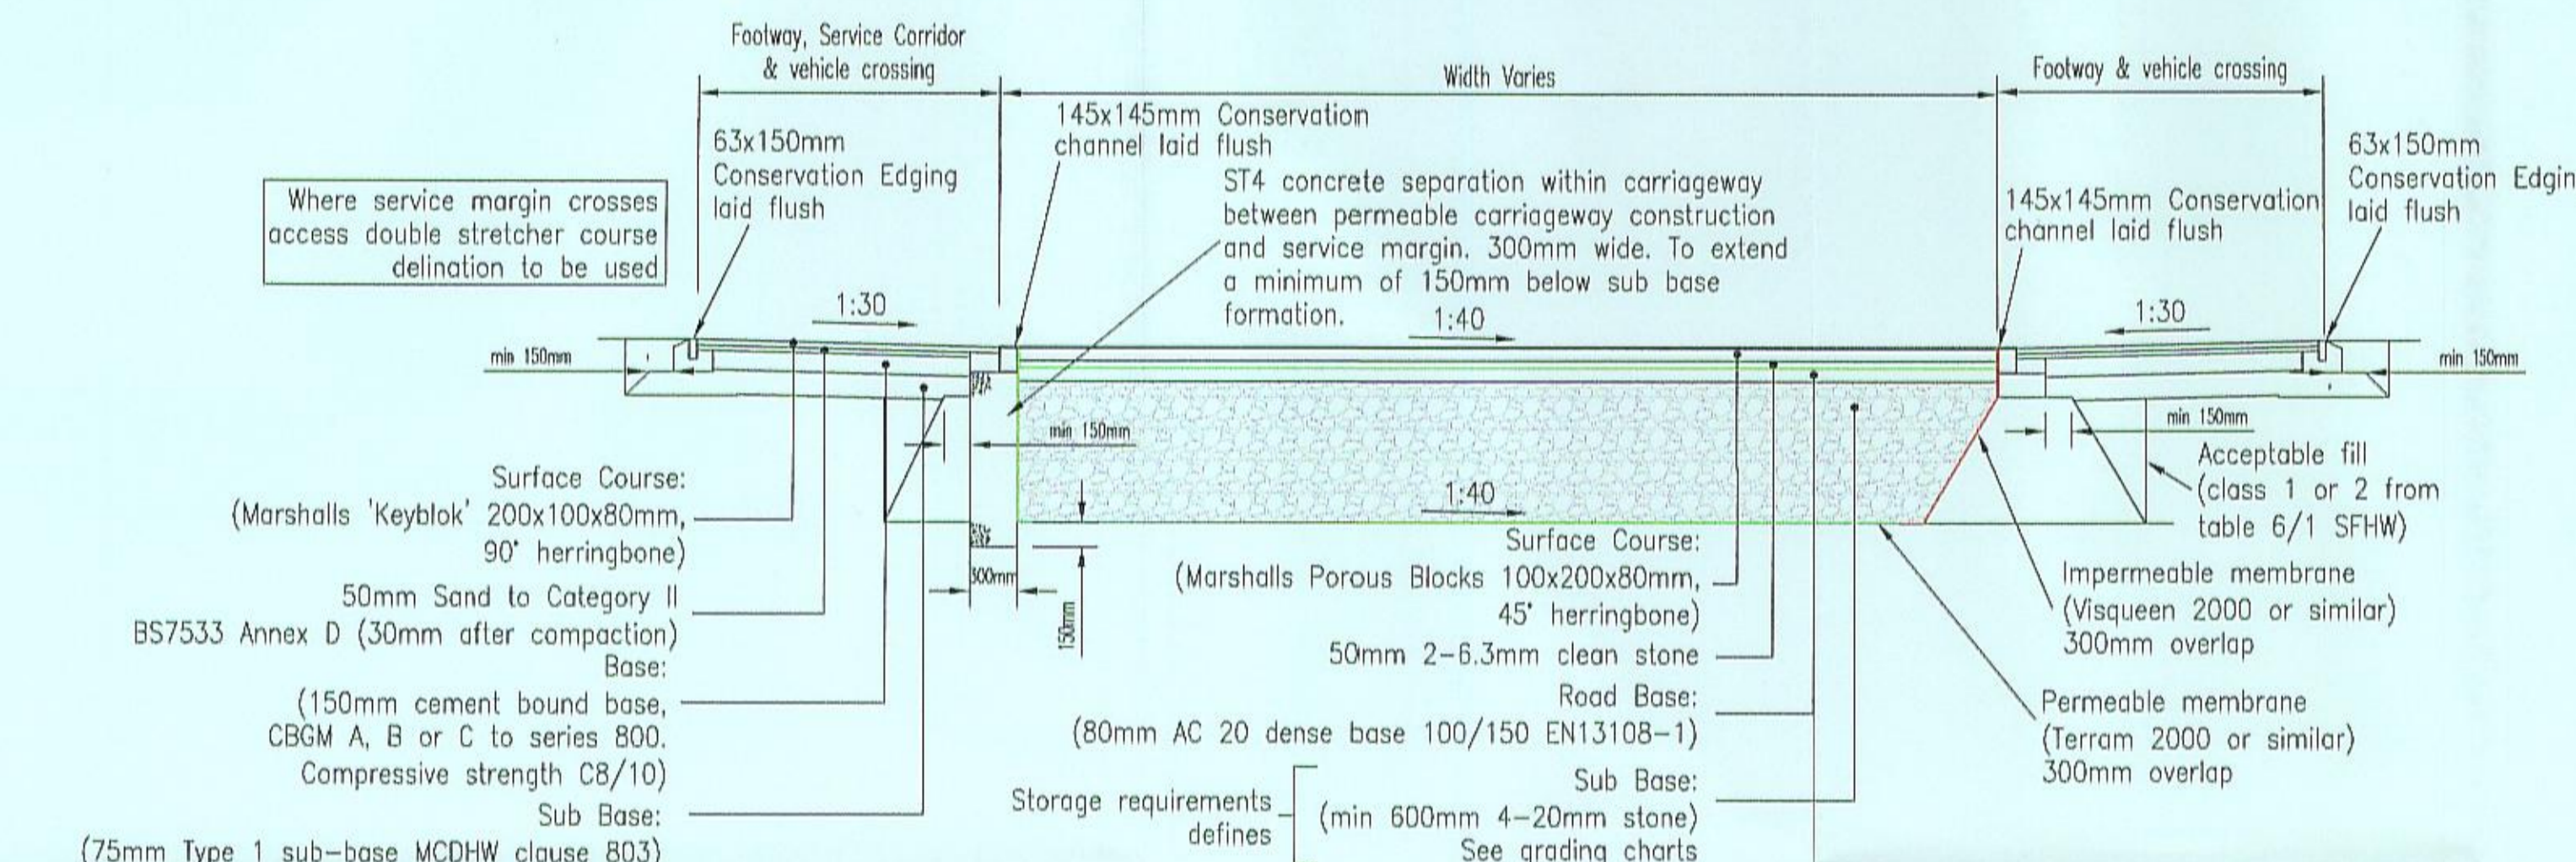


TYPICAL CARRIAGEWAY CROSS SECTION - POROUS PAVING CONSTRUCTION (SIDE STREETS) INFILTRATION SYSTEM

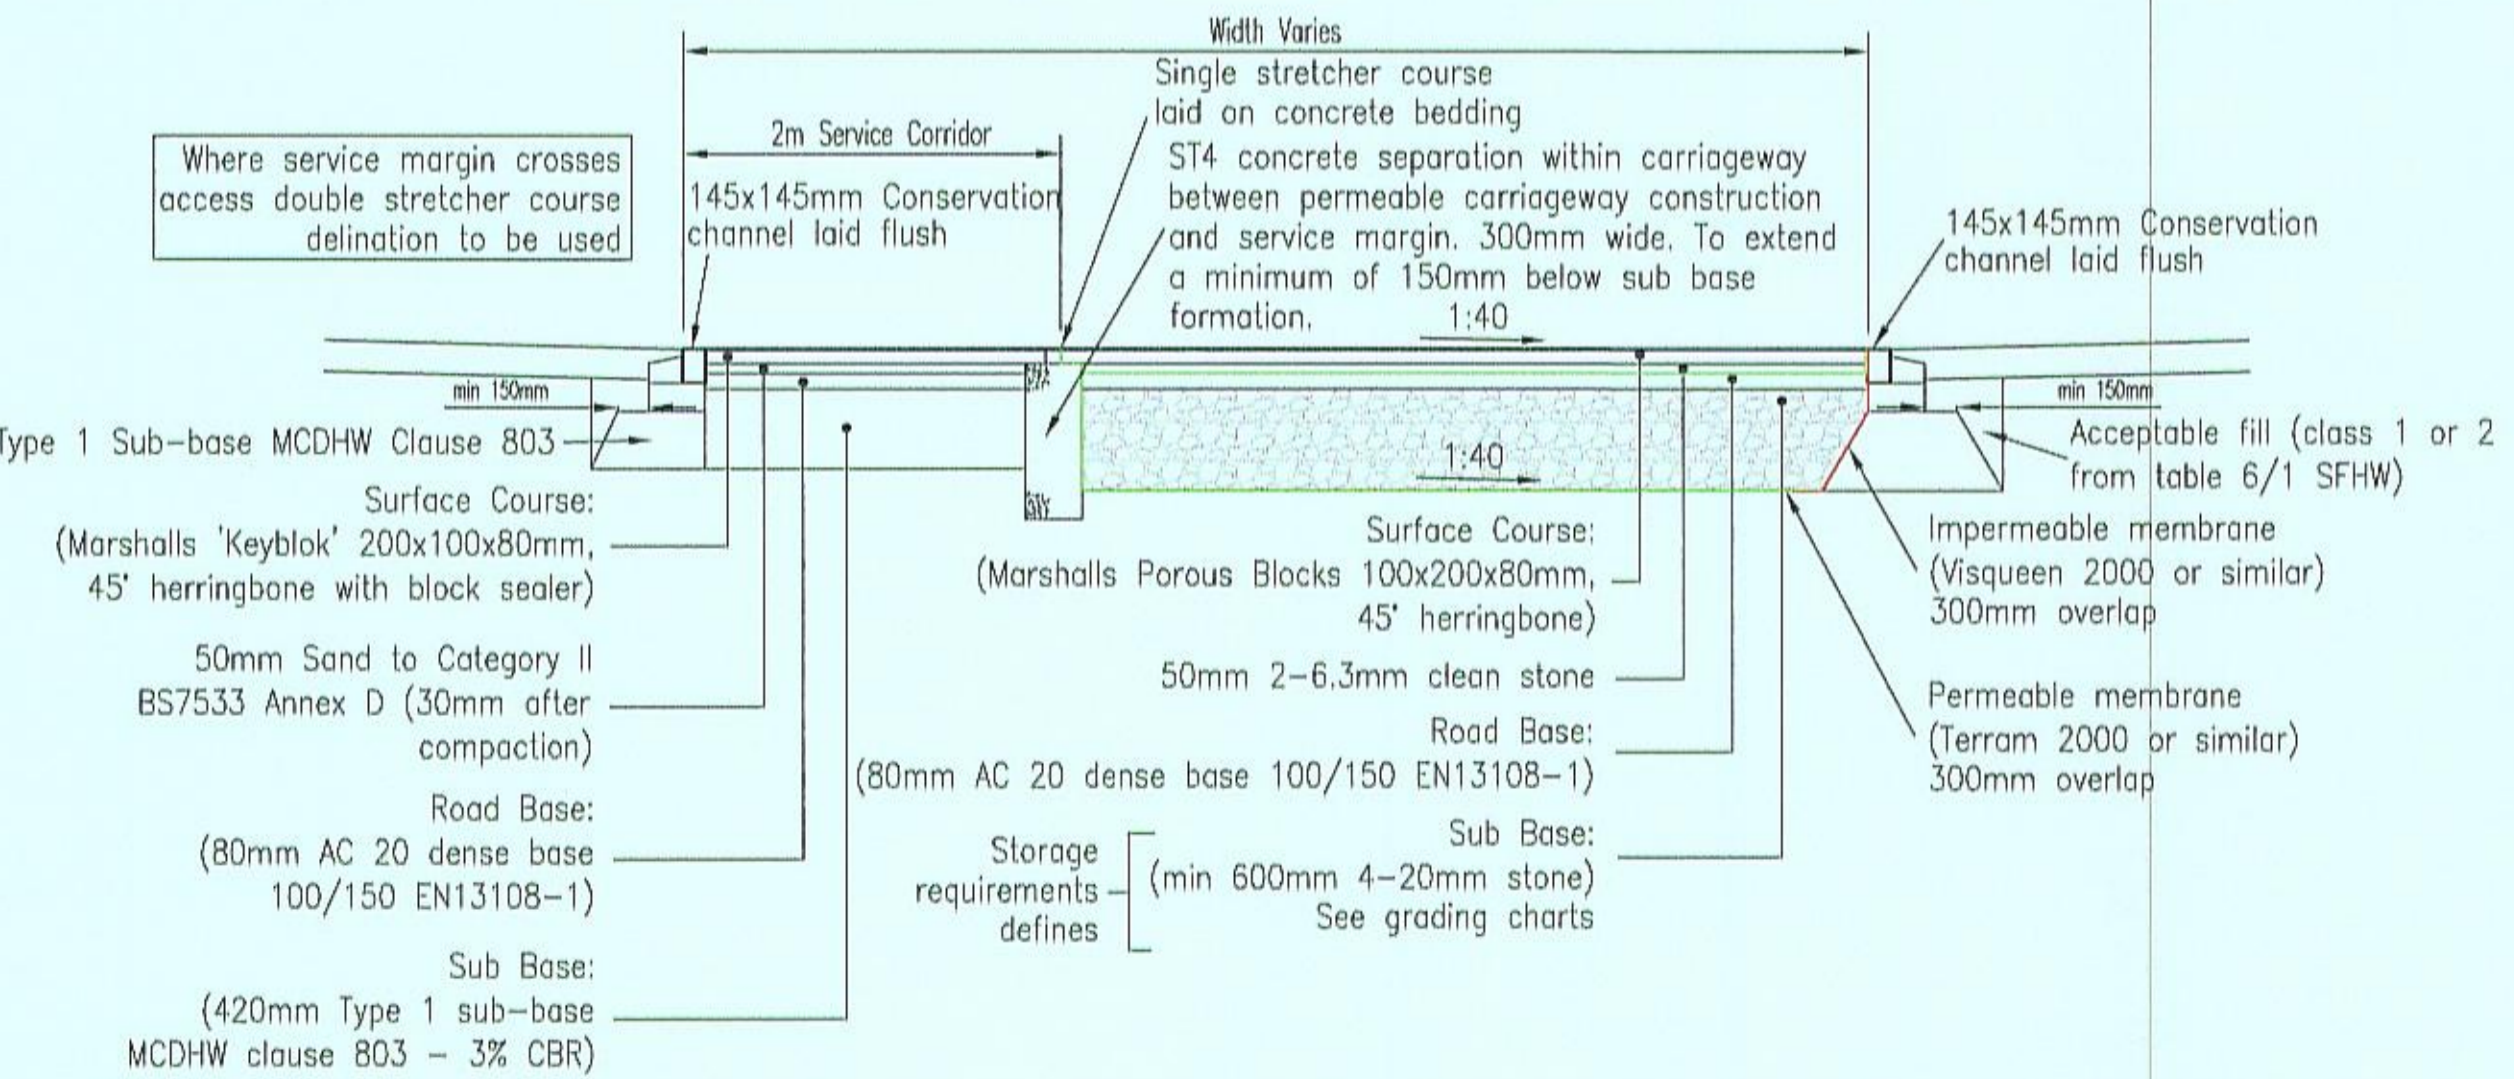


TYPICAL CARRIAGEWAY CROSS SECTION - POROUS PAVING CONSTRUCTION (MEWS) INFILTRATION SYSTEM

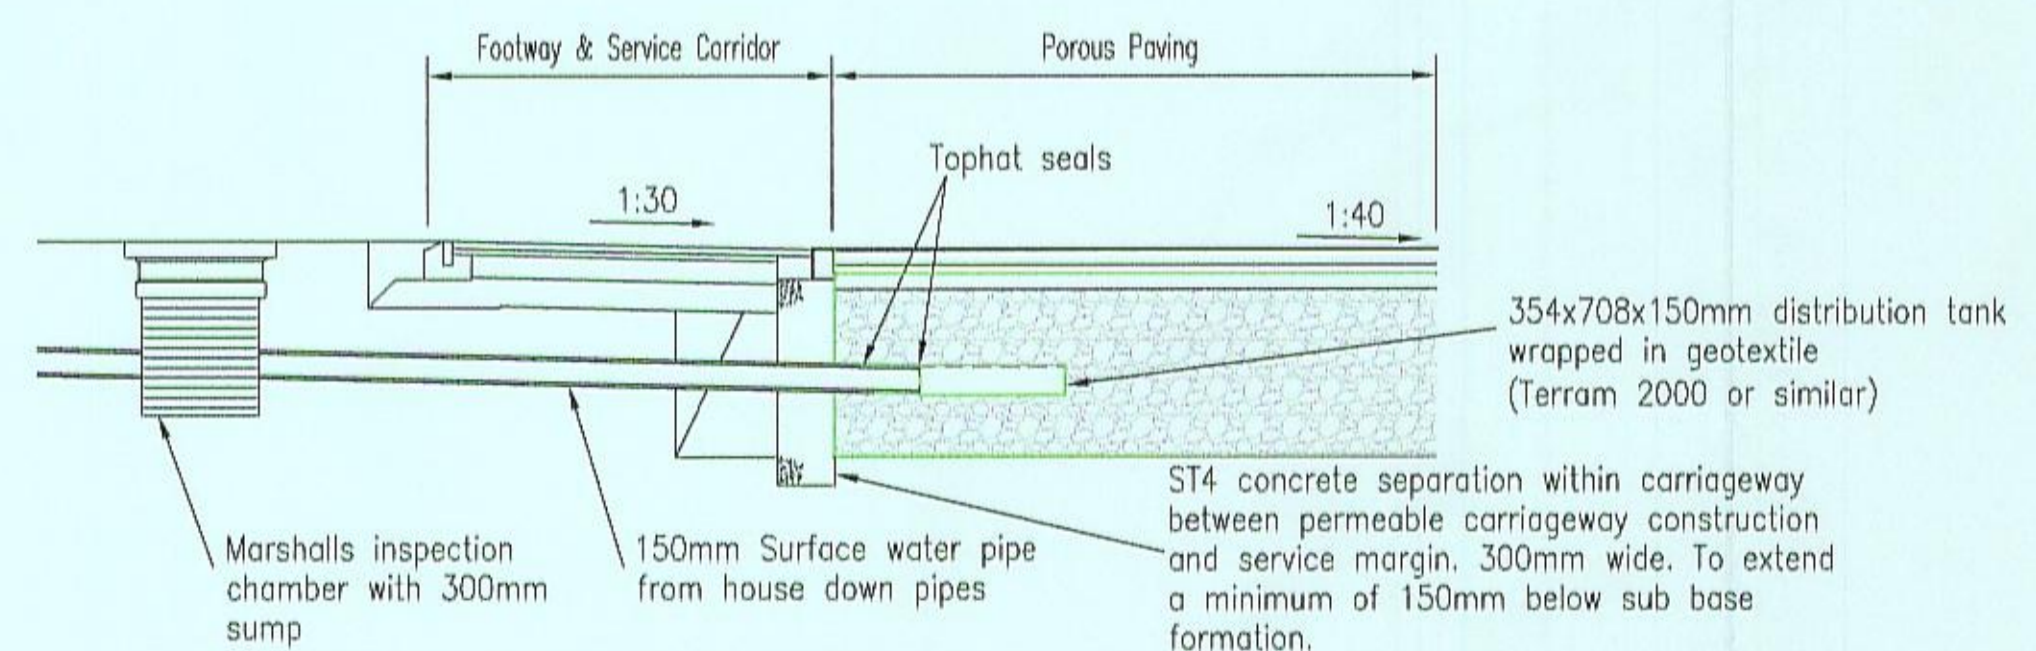

TYPICAL SECTION SURFACE WATER OUTFALL FROM HOUSE DRAINAGE

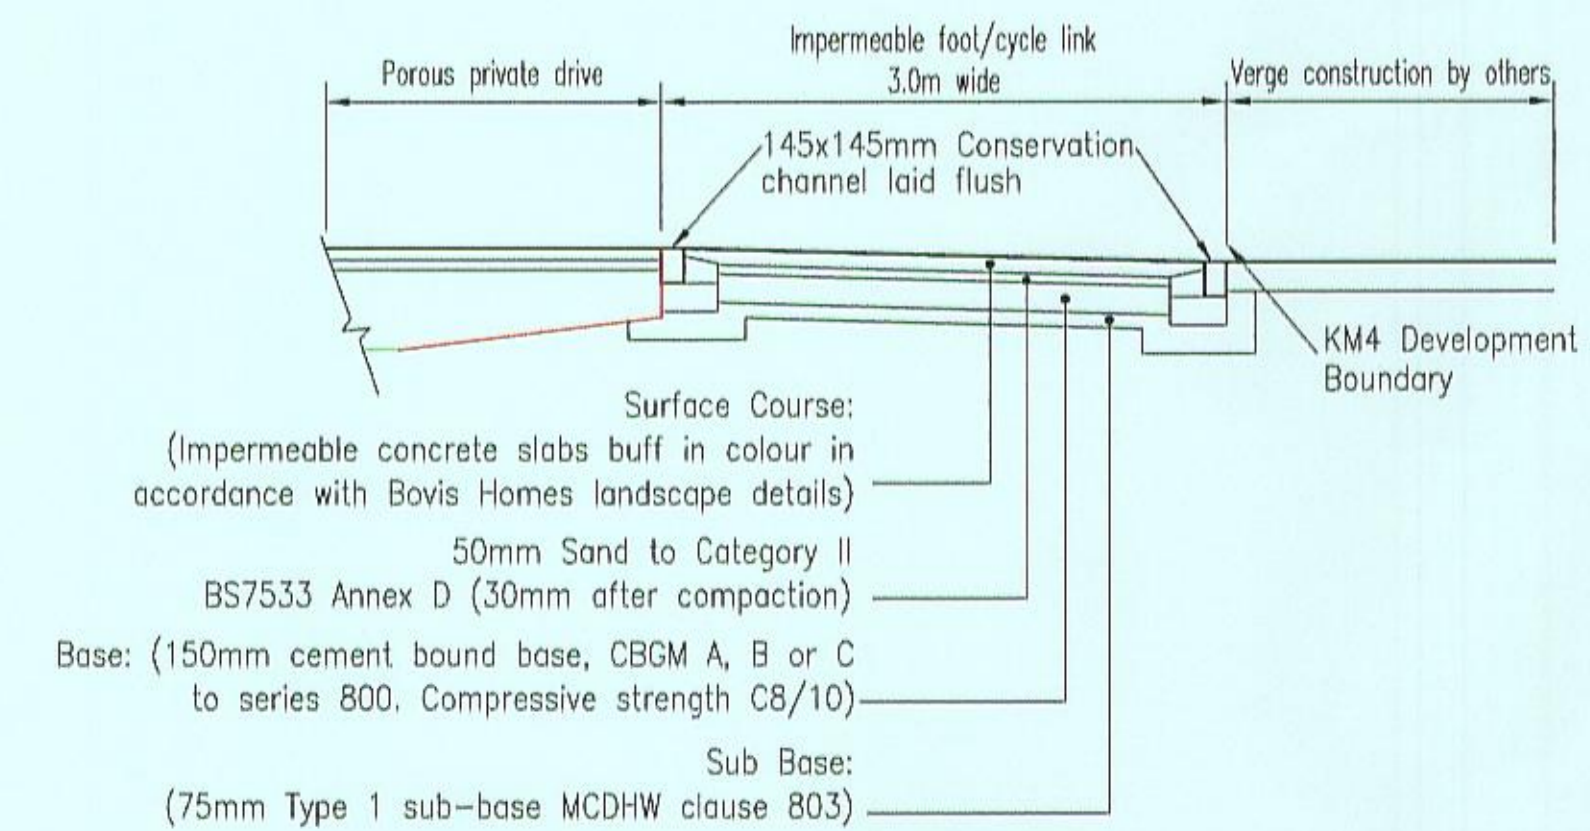

TYPICAL CROSS SECTION - FOOT/CYCLE WAY ON EASTERN SITE BOUNDARY

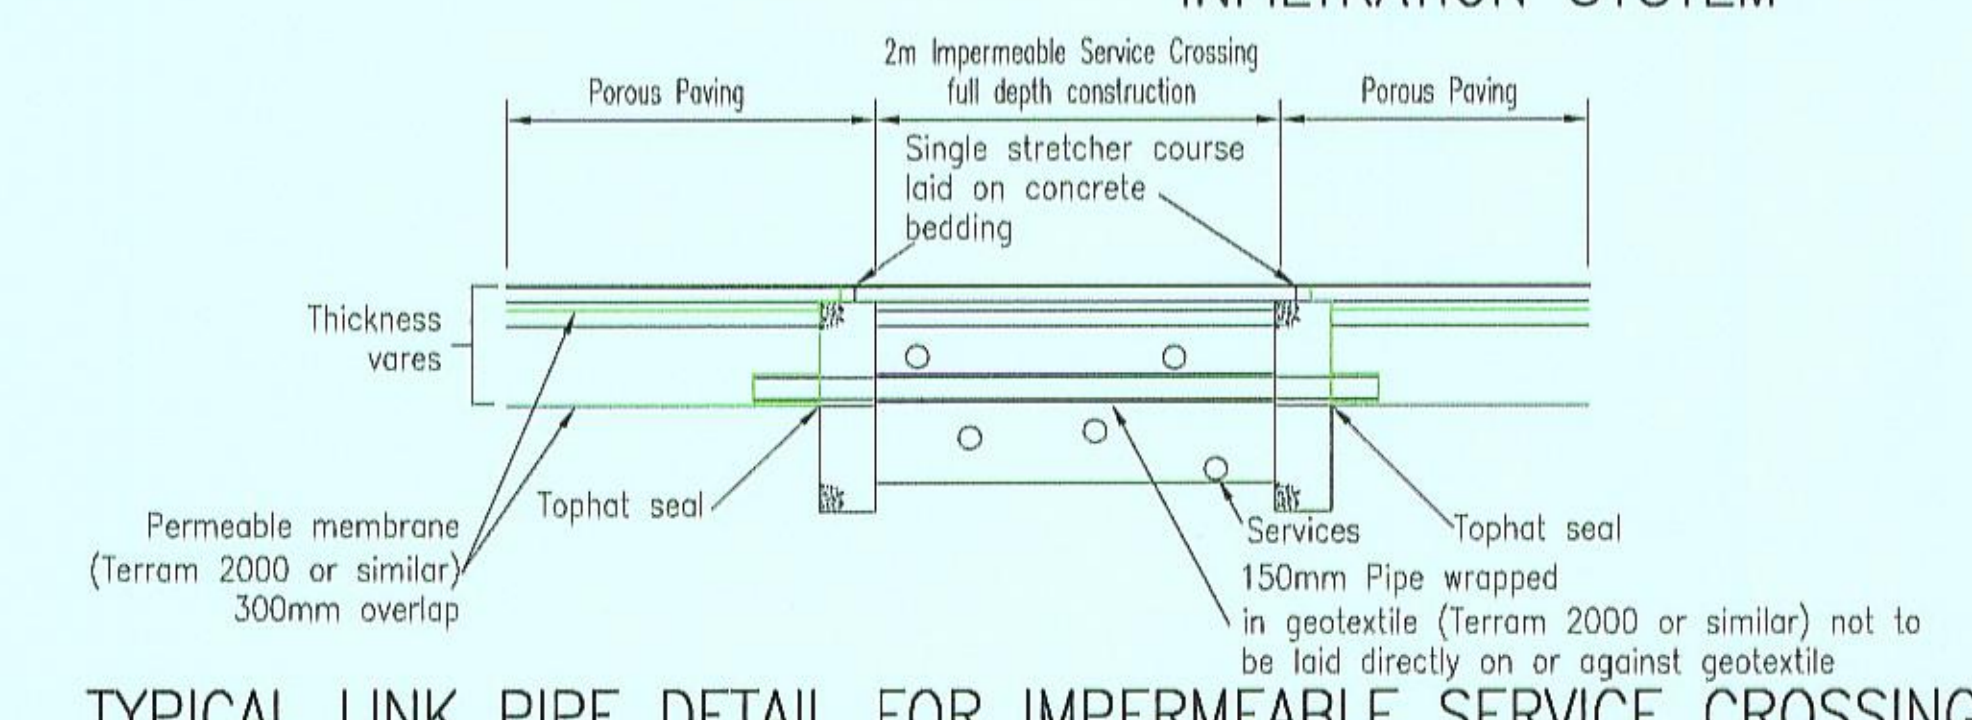

TYPICAL LINK PIPE DETAIL FOR IMPERMEABLE SERVICE CROSSINGS

Rev	Date	Details	By

Drainage Authority Approval Date

Highway Authority Approval Date

Do not scale from this drawing. Use written dimensions only. When shown relationships between sizes levels and ground levels are to be checked on site. Any discrepancy or suggested modification is to be reported to Design and Engineering Director. Note: This drawing is the copyright of Bovis Homes Ltd.

**BOVIS HOMES**  
Bovis Homes Central Region  
Bromwich Court  
Highway Point  
Gorseley Lane  
Coleshill  
B46 1JU  
Tel: 01675 437 000  
Fax: 01675 437 094  
DX: 728340 Coleshill 2

**Brookbanks Consulting**  
6150 Knights Court Sellhull Parkway Birmingham B37 7WY  
Tel (0121) 329 4330 Fax (0121) 329 4331  
www.brookbanks.com

SITE: KINGSMERE, BICESTER  
KM4

DRAWING TITLE: TYPICAL HIGHWAY CROSS SECTIONS

DRAWN BY	DATE	DRAWING NO.	REV
RM	02.09.14	BICE_5_971	-

SCALE:	CHECKED/DATE
NTS	RH