

DO NOT SCALE FROM THIS DRAWING.
USE WRITTEN DIMENSIONS ONLY.
ANY DISCREPANCIES OR SUGGESTED
REVISIONS TO BE REPORTED TO TAYLOR
WIMPEY UK.
DRAWING TO BE READ IN CONJUNCTION
WITH LATEST TAYLOR WIMPEY NATIONAL
CONSTRUCTION SPECIFICATION.


Air Barrier Continuity:
Apply continuous ribbons of adhesive along top of wall. Apply
expanding foam tape or sealant under the skirting & continuous bead
of sealant to the back of the skirting prior to fixing. Where there is
no skirting apply expanding foam tape or sealant between plasterboard
& floor. Seal all penetrations in the plasterboard.

- LEGEND:**
- 1A. 215mm SPLAYED BRICK FLAT ARCH IN MATCHING COLOUR, FLUSH WITH MAIN BRICKWORK.
 - 1B. 215mm SPLAYED BRICK FLAT ARCH IN CONTRASTING COLOUR, FLUSH WITH MAIN BRICKWORK.
 - 1C. 215mm STONE HEADER FLUSH WITH MAIN BRICKWORK.
 - 1D. 215mm BRICK SOLDIER HEADER IN MATCHING COLOUR, FLUSH WITH MAIN BRICKWORK.
 - 1E. 65x25mm PRESSURE IMPREGNATED TIMBER ON 75mm THICK CONCRETE BACKING, FLUSH WITH MAIN BRICKWORK.
 - 1F. 140x25mm PRESSURE IMPREGNATED TIMBER ON 75mm THICK CONCRETE BACKING, FLUSH WITH MAIN BRICKWORK.
 2. INSULATED STEEL UNTEL WITH CAVITY TRAY OVER. 20mm TIMBER SOFFIT TO UNDERSIDE OF STEEL WHEN TIMBER FRONTED HEADER.
 3. WINDOW TO BE SEALED WITH PROPRIETARY SILICONE MASTIC. COLOUR TO MATCH WINDOWS.
 4. DOUBLE GLAZED WINDOW SECTION VARIES. TO BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS RECOMMENDATIONS.
 5. DPC/SLIP PLANE TO BE INSTALLED OVER CILL STOOL AND EXTENDED UP THE ENDS OF THE CILL TO KEEP IT SEPARATE FROM SURROUNDING BRICKWORK.
 - 6A. 140mm HIGH CAST STONE CILL WITH 100mm ENDS.
 - 6B. 140mm BRICK SOLDIERS, FLUSH WITH MAIN BRICKWORK.
 7. LEADING EDGE OF DPC TO PROJECT 5mm.
 8. MORTAR BED BELOW CILLS TO BE TROWELLED SMOOTH AND ALLOWED TO SET PRIOR TO DPC INSTALLATION MORTAR FOR ONE PIECE CILLS TO BE RESTRICTED BELOW THE STOOINGS. OPEN SECTION BELOW THE CILL TO BE SEALED WITH MASTIC SEALANT.
 9. STONE CILL TO BE WRAPPED IN BLACK POLYTHENE DPC.
 10. PROPRIETARY INSULATED CAVITY CLOSER/VERTICAL DPC SYSTEM.
 11. CILL BOARD AS SITE SPECIFICATION.
 12. MASTIC SEALANT BETWEEN U/S CILLBOARD AND WALL.

NOTE: STOOLED CILLS SHOULD BE BEDDED ACCORDING TO THE RECOMMENDATIONS OF BS 8000 PT3 & NHBC I.E. THE ENDS SHOULD BE MORTAR BEDDED DURING CONSTRUCTION, FOLLOWED BY THE POINTING OF THE REMAINING JOINT WHEN THE CONSTRUCTION IS COMPLETE.


IF USING A FORTICRETE CAST STONE PRODUCT COMPRESSIVE GRADE (M2) DESIGNATION MORTAR SHOULD BE SPECIFIED, BUT IN NO CASE SHOULD ANYTHING STRONGER THAN (M4) BE USED. A MORTAR CONTAINING LIME IS RECOMMENDED TO ACCOMMODATE MOVEMENT.

SPLAYED BRICK FLAT ARCH IN MATCHING COLOUR, FLUSH WITH MAIN BRICKWORK

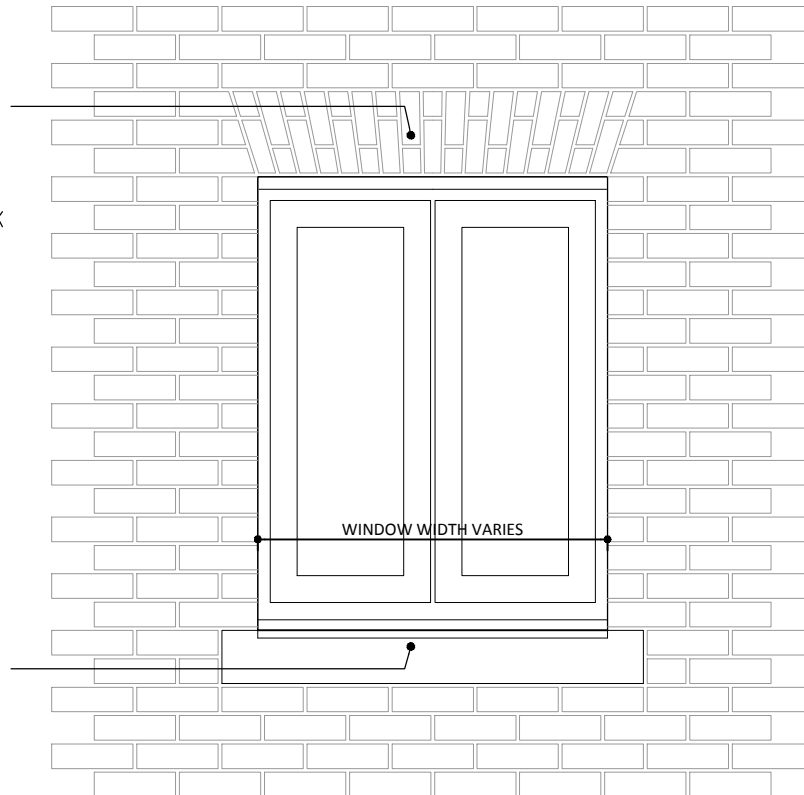


FLAT BRICK ARCH HEAD & STONE CILL
BRICK ELEVATION
SCALE 1:20



SPLAYED BRICK FLAT ARCH IN CONTRASTING COLOUR, FLUSH WITH MAIN BRICKWORK

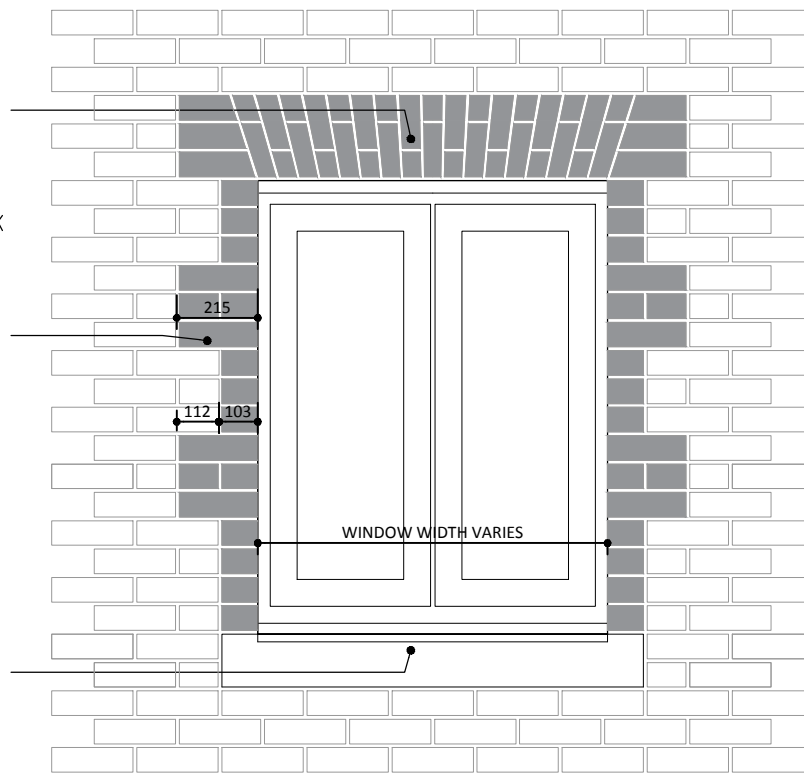



FLAT BRICK ARCH HEAD, BRICK QUOINS & STONE CILL
BRICK ELEVATION
SCALE 1:20

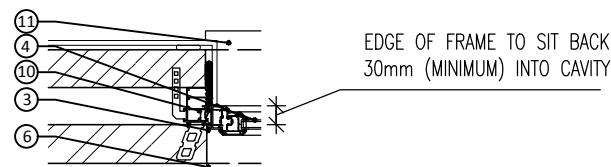

WINDOW JAMB / REVEAL
BRICK ELEVATION
SCALE 1:20

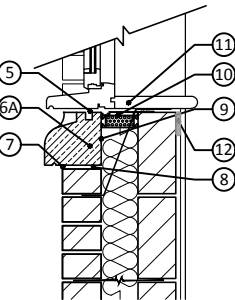


BRICK HEAD & STONE CILL
SECTION
SCALE 1:20
BRICK ELEVATION

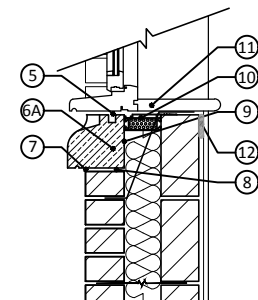



BRICK HEAD & STONE CILL
SECTION
SCALE 1:20
BRICK ELEVATION

215mm STONE HEADER, FLUSH WITH MAIN BRICKWORK

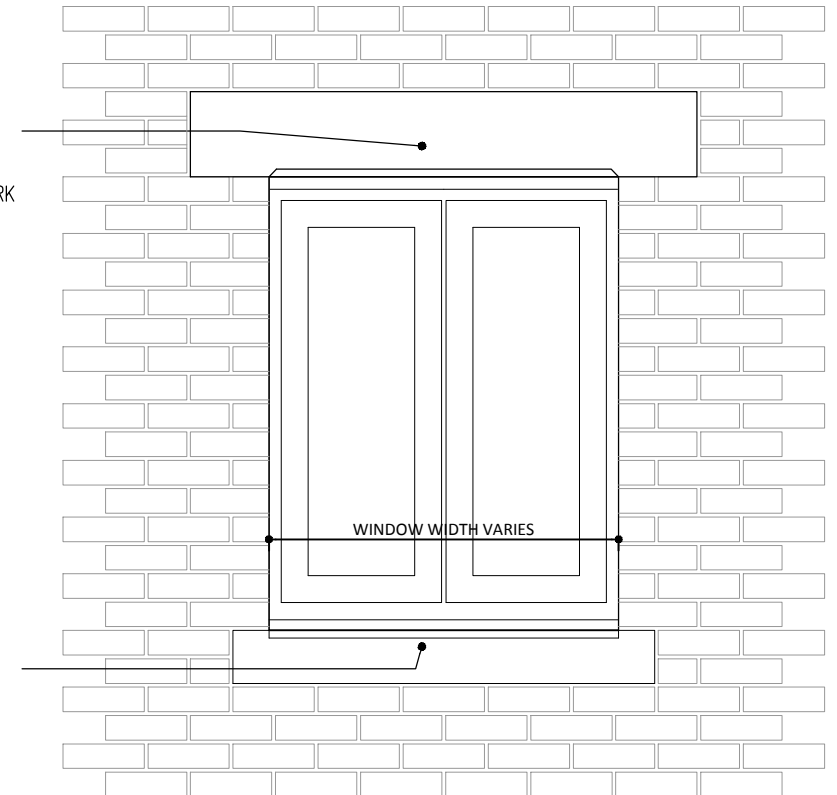

STONE HEAD & STONE CILL
BRICK ELEVATION
SCALE 1:20

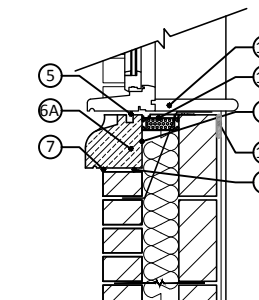

STONE HEAD & STONE CILL
SECTION
SCALE 1:20
BRICK ELEVATION

REV A: WINDOW STYLES AMENDED TO SHOW BALANCED CASEMENTS. MAY 2017

Date	Rev	Description
Taylor Wimpey		
Taylor Wimpey Oxfordshire, Windrush Court, Suite J, Abingdon Business Park, Abingdon, Oxfordshire, OX14 1SY t: 01235 541900 f: 01235 541901		
Project Title AUDLEY GARDENS CHESTERTON		
Drawing Title WINDOW DETAILS SHEET 1 OF 3		
Date	Drawn	Checked
02/17	LSD	LSD
Scale		1:20 @ A3
Consultant Preston Lodge Court, Preston Deanery, Northampton, NN7 2DS t: 01604 871199 e: info@sdev.co.uk		
Drawing Number LSD129.06.01		Rev. A

