

**BERRY HILL ROAD  
ADDERBURY**

---

**FLOOD RISK ASSESSMENT AND  
DRAINAGE MANAGEMENT STRATEGY**

---



For  
Hollins Strategic Land  
Suite 14  
1 King Street  
Manchester  
M2 6AW

**HSL** | HOLLINS STRATEGIC LAND

**OCTOBER 2017**

This page has been intentionally left blank


**BERRY HILL ROAD  
ADDERBURY**

**FLOOD RISK ASSESSMENT AND  
DRAINAGE MANAGEMENT STRATEGY**

**Document Tracking Sheet**


**Document Reference:** HYD250\_BERRY.HILL.ROAD.FRA&DMS  
**Revision:** 1.1  
**Date of Issue:** 06.10.17  
**Report Status:** FINAL

**Prepared by:**




Patrick Taylor BSc (Hons)

**Checked by**



Dominic Kearney BEng (Hons) MSc PhD  
*Principal Hydraulic Analyst*

**Authorised by**



Richard Nicholas BEng (Hons) MBA  
*Director*

**Revision History:**

<b>Rev.:</b>	<b>Date:</b>	<b>Status:</b>	<b>Prepared by:</b>	<b>Checked by:</b>	<b>Issued by:</b>
1.1	05.10.17	FINAL	PT	DK	PT
1	18.07.17	FINAL	PT	DK	PT
0	30.06.17	DRAFT	PT	DK	PT

Old Marsh Farm Barns  
Welsh Road, Sealand  
Flintshire CH5 2LY  
Telephone: 01244 289 041



This page has been intentionally left blank



## EXECUTIVE SUMMARY

---

This Flood Risk Assessment and Drainage Management Strategy was commissioned by Hollins Strategic Land, referred to hereafter as 'the client'. This report has been prepared to support a planning application for the construction of residential development on land north of Berry Hill Road in Adderbury, Oxfordshire.

### Flood Risk

The total site covers 4.00ha and is located wholly within Flood Zone 1 based on the Environment Agency Flood Zone Map for Planning. The proposals are for a residential development, which is classed as more vulnerable in Table 2: Flood Risk Vulnerability Classification within the Planning Practice Guidance (PPG). This nature of development is confirmed by the PPG to be appropriate within Flood Zone 1.

This report has reviewed all sources of flood risk to both the proposed development and to existing development. No historical flooding at the site was identified during the research or consultations undertaken as part of this assessment. The nearest Main River is Sor Brook located 80m to the north of the site, due to the difference in existing ground levels between the River and the site, the flood risk from this source is considered low. The flood risk associated with all sources is identified to be low.

Due to the low flood risks identified, the development is considered to be appropriate in accordance with the National Planning Policy Framework and Planning Practice Guidance. The principle focus of this assessment has been the effective management of surface water run-off, so not to increase flood risk elsewhere as a result of the development, this includes consideration of sustainable management options in accordance with national and local policy.

### Drainage Strategy

In accordance with the drainage hierarchy there are three methods that have been reviewed for the appropriate management and discharge of surface water. These have been applied in the order of priority: discharge via infiltration, to a watercourse or to public sewerage system. Based on the ground conditions identified via web based resources, it is considered that infiltration would likely provide a surface water drainage solution for the whole of the site. Further Soakaway Testing (to BRE365) is required to confirm infiltration will be an appropriate surface water management solution for the run-off generated by the proposals.

As the substrata is identified to be favourable for infiltration, it is proposed to use this drainage method for management of surface water run-off generated by the development (subject to further testing). The specific drainage infrastructure will be confirmed during the detailed design stage following discussion with all relevant parties. It is advised that new soakaway(s) (or other infiltration methods) be implemented within the boundaries of site such being designed to BRE365 standard.

Should further testing at the site identify that infiltration will not offer a feasible surface water management solution then the next method in the hierarchical approach should be to discharge to a watercourse. Sor Brook is located approximately 80m north of the site and would provide an alternative connection for surface water run-off generated by the proposals. Detailed design will

be required to confirm feasibility of the strategy. Consents from the Environment Agency will also be required for any new outfall structure, along with agreements of proposed rates of discharge.

In accordance with the SuDS Manual (CIRIA 753) and the Non-Statutory Technical Standards for Sustainable Drainage Systems (March 2015) all sites (greenfield and brownfield) should endeavour to achieve as close to pre-development greenfield rates as is viable. If discharge to the watercourse is the surface management option, the development will reduce flood risk through restricting the discharge from site to 5l/s for all storm events. This restriction is based on the minimum constraint of a standard flow control device.

The restricted flow will generate a storage requirement during periods of intense rainfall. This will need to be considered in terms of onsite attenuation as part of detailed design following confirmation of the feasibility of infiltration. The proposed onsite surface water drainage system will need to be sized to contain the 1 in 30yr return period event below ground with overland run-off from storm events up to and including the 1 in 100yr return period event with a 40% allowance for climate change being contained onsite.

It would be beneficial to implement SuDS features including permeable surfaces and bio-filtration where at all feasible (subject to ground investigation and a detailed levels review). If designed appropriately the SuDS features could potentially aid in the attenuation requirements for the proposals and provide added benefits in terms of water quality. Detailed design will be required to confirm whether SuDS can be incorporated.

This report has been prepared in consultation with the relevant interested parties and incorporates their comments where possible. The Flood Risk Assessment & Drainage Management Strategy is considered to be commensurate with the scale and nature of the development proposals and in summary, the development can be considered appropriate in accordance with the Planning Practice Guidance.

## CONTENTS

Document Tracking Sheet.....	iii
<b>EXECUTIVE SUMMARY .....</b>	<b>v</b>
CONTENTS.....	vii
Figures & Tables.....	viii
Specialist Software.....	ix
Abbreviations & Acronyms.....	ix
<b>1.0 INTRODUCTION .....</b>	<b>10</b>
1.1 Planning Policy Context .....	11
1.2 Site Context .....	11
1.3 Consultation .....	11
<b>2.0 EXISTING SITE LOCATION .....</b>	<b>12</b>
2.1 Location .....	12
2.2 Existing and Historical Land Use.....	12
2.3 Topography.....	13
<b>3.0 DEVELOPMENT PROPOSALS.....</b>	<b>14</b>
3.1 Nature of the development.....	14
<b>4.0 SOURCES OF FLOOD RISK .....</b>	<b>16</b>
4.1 Fluvial Flood Risk .....	16
4.2 Tidal Flood Risk.....	16
4.3 Flood Risk Vulnerability Classification and Flood Zone Compatibility .....	17
4.4 Surface Water Flood Risk .....	17
<i>Pluvial (Overland run-off) Flood Risk .....</i>	<i>18</i>
<i>Sewer Flood Risk.....</i>	<i>18</i>
4.5 Groundwater Flood Risk.....	18
4.6 Artificial Sources of Flood Risk.....	19
<i>Reservoirs .....</i>	<i>19</i>
<i>Canals.....</i>	<i>19</i>
4.7 Historical and Anecdotal Flooding Information .....	19
4.8 Flood Risk Mitigation Measures & Residual Risks.....	20
<i>Mitigation Measures.....</i>	<i>20</i>
<i>Residual Risks.....</i>	<i>20</i>
<b>5.0 SURFACE WATER MANAGEMENT .....</b>	<b>21</b>
5.1 Pre-Development Surface Water Run-off.....	21
5.2 Post Development Surface Water Run-Off.....	21
5.3 Sustainable Drainage Systems (SuDS) .....	21
5.4 Methods of Surface Water Management.....	23

5.5	Discharge via Infiltration.....	23
5.6	Discharge to Watercourse.....	24
5.7	Discharge to Public Sewer Network .....	25
5.8	Climate Change .....	26
<b>6.0</b>	<b>FOUL WATER MANAGEMENT .....</b>	<b>27</b>
<b>7.0</b>	<b>SUMMARY AND CONCLUSIONS .....</b>	<b>28</b>
<b>8.0</b>	<b>RECOMMENDATIONS .....</b>	<b>30</b>
	BIBLIOGRAPHY & REFERENCES.....	31
	Web-based References .....	31

## Figures & Tables

Figure 1:	Aerial Photograph of site (Bing Maps, 2017) .....	12
Figure 2:	Indicative Planning Proposals (HSL, 2017).....	14
Figure 3:	Fluvial/Tidal Flood Zone Map for Planning Extract (EA, 2017) .....	16
Figure 4:	Surface Water Flood Map Extract (GOV.UK, 2017) .....	17
Table 1:	Pre-Development Surface Water Run-Off Rates (Betts Hydro, 2017) .....	21
Table 2:	Post-Development Un-Restricted Run-Off Rates (Betts Hydro, 2017).....	21
Figure 5:	SuDS Photographs (SusDrain, 2012) .....	22
Figure 6:	Preliminary Drainage Strategy Plan extract (Betts Hydro, 2017) .....	24
Table 3:	Change to Extreme Rainfall Intensity (Environment Agency, 2016) .....	26

APPENDIX A:	NPFF EXTRACTS .....	
APPENDIX B:	EA INFORMATION & CORRESPONDENCE .....	
APPENDIX C:	TW CORRESPONDENCE .....	
APPENDIX D:	LPA/LLFA CORRESPONDENCE .....	
APPENDIX E:	LOCATION PLAN.....	
APPENDIX F:	TOPOGRAPHIC SURVEY.....	
APPENDIX G:	PLANNING LAYOUT.....	
APPENDIX H:	PFRA/SFRA INFORMATION.....	
APPENDIX I:	SURFACE WATER RUN-OFF CALCULATIONS.....	
APPENDIX J:	OVERLAND FLOOD FLOW PLANS .....	
APPENDIX K:	EXISTING AND PRELIMINARY DRAINAGE PLAN .....	
APPENDIX L:	STORMWATER STORAGE ESTIMATES.....	
APPENDIX M:	TYPICAL SUDS DETAILS .....	

APPENDIX N: NOTES OF LIMITATIONS.....

## Specialist Software

- MicroDrainage WinDES (v.14.1) – Calculation of Greenfield run-off rates IH124/ICP-SUDS, Greenfield run-off volumes, rates of rainfall and stormwater storage estimates.

## Abbreviations & Acronyms

<b>AEP</b>	Annual Exceedance Probability
<b>BGL</b>	Below Ground Level
<b>BGS</b>	British Geological Survey
<b>CC</b>	Climate Change
<b>CDC</b>	Cherwell District Council
<b>CSAI</b>	Cranfield Soil and Agrifood Institute
<b>DMS</b>	Drainage Management Strategy
<b>EA</b>	Environment Agency
<b>FRA</b>	Flood Risk Assessment
<b>FZ</b>	Flood Zone
<b>Ha</b>	Hectare
<b>LLFA</b>	Lead Local Flood Authority
<b>LPA</b>	Local Planning Authority
<b>mAOD</b>	Metres Above Ordnance Datum
<b>NGR</b>	National Grid Reference
<b>NPPF</b>	National Planning Policy Framework
<b>NSRI</b>	National Soil Resources Institute
<b>OS</b>	Ordnance Survey
<b>OCC</b>	Oxfordshire County Council
<b>PFRA</b>	Preliminary Flood Risk Assessment
<b>PPG</b>	Planning Practice Guidance
<b>QSE</b>	Quick Storage Estimate
<b>QBAR</b>	Mean Annual Flood
<b>SFA</b>	Sewers For Adoption
<b>SFRA</b>	Strategic Flood Risk Assessment
<b>SuDS</b>	Sustainable Urban Drainage Systems
<b>TW</b>	Thames Water
<b>TWL</b>	Top Water Level
<b>UKCIP</b>	United Kingdom Climate Impacts Programme

This page has been left intentionally blank

## 1.0 INTRODUCTION

---

### 1.1 Planning Policy Context

- 1.1.1 All forms of flooding and their impact on the natural and built environment are material planning considerations. The National Planning Policy Framework (NPPF) sets out the Government's objectives for the planning system, and how planning should facilitate and promote sustainable patterns of development, avoiding flood risk and accommodating the impacts of climate change. Government policy with respect to development in flood risk areas is contained within the NPPF and the supporting Planning Practice Guidance (PPG) (refer to extracts in **Appendix A**).
- 1.1.2 A Flood Risk Assessment and Drainage Management Strategy (FRA&DMS) has been completed in accordance with NPPF/PPG to review all sources of flood risk both to and from the proposed development. The report also considers the most appropriate drainage options including the implementation of Sustainable Drainage Systems (SuDS) in line with the recent changes to national policy.
- 1.1.3 The proposals are for residential development and as such classified as 'more vulnerable' in Table 2: Flood Risk Vulnerability Classification within Planning Practice Guidance. The PPG confirms that this type of land use is appropriate for Flood Zone 1, providing there is no increase in flood risk elsewhere due to the proposals.

### 1.2 Site Context

- 1.2.1 This FRA&DMS has been prepared to support a planning application for a residential development on land north of Berry Hill Road, Adderbury (Oxfordshire). The proposals will be complete with access, car parking, external works and lighting, landscaping, boundary walls and fencing, external services and drainage. The site is located in close proximity to Sor Brook. This and other potential sources of flood risk to the proposals will be considered within this assessment.

### 1.3 Consultation


- 1.3.1 The preparation of this report has been undertaken in consultation with the following interested parties including: The Environment Agency (EA), Thames Water (TW), Cherwell District Council (CDC) and Oxfordshire County Council (OCC). Consultation responses can be seen in **Appendix B, C and D** respectively. The NPPF advises that Cherwell District Council as the Local Planning Authority (LPA) should consult with the EA who will provide advice and guidance on flood issues at a strategic level and in relation to planning applications.
- 1.3.2 Responses from Cherwell District Council are outstanding at this time.



## 2.0 EXISTING SITE LOCATION

### 2.1 Location

- 2.1.1 The proposed development site is accessed off Berry Hill Road in Adderbury. The Ordnance Survey National Grid Reference (OS NGR) for the site is E: 446877, N: 234796 and the nearest postcode is OX17 3HF. The total site covers approximately 4.0ha and is edged in red in **Figure 1** (see location plan in **Appendix E**).
- 2.1.2 The site is bounded, to the north by a pumping station and adjacent land with Sor Brook located beyond. To the south, the site is bounded by Berry Hill Road with undeveloped land used for agricultural purposes located beyond with similar land use to the east of site (shown in **Figure 1**). To the west of site are gardens and dwellings accessed off Berry Hill Road.

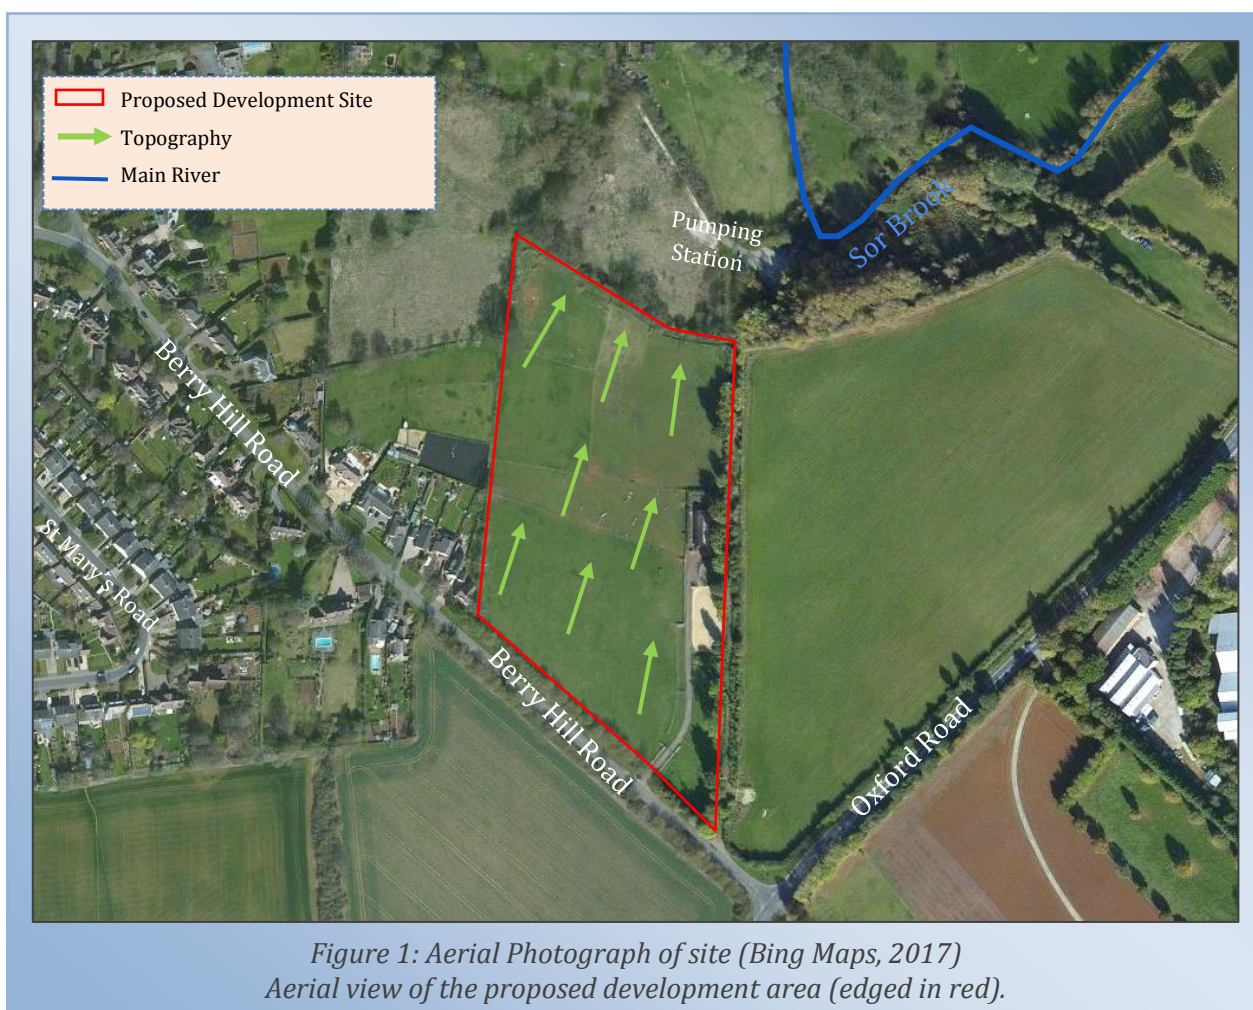

### 2.2 Existing and Historical Land Use

- 2.2.1 The preparation of this report has identified that the site is predominantly undeveloped and comprises of a low-density vegetation, each boundary is sparsely covered by taller shrubs and trees. The site is currently used for recreational purposes with existing stables and equestrian ménage present adjacent to the eastern boundary of the site. No other historical uses have been determined in the preparation of this report.



## 2.3 Topography

- 2.3.1 The topography generally falls from the southern boundary to the northern boundary within site (as illustrated in **Figure 1**). The site is slightly undulating, with levels ranging from 108mAOD (adjacent to Berry Hill Road) to 95mAOD (on the northern boundary). A full site topographic survey is included in **Appendix F**.

## 3.0 DEVELOPMENT PROPOSALS

### 3.1 Nature of the development

- 3.1.1 This planning application is for the construction of residential development on land to the north of Berry Hill Road in Adderbury (Oxfordshire). The illustrative proposals (outlined in **Figure 2/Appendix G**) will be complete with access, footpaths, car parking, external works and lighting, landscaping, boundary walls and fencing, external services and drainage.
- 3.1.2 The total site covers approximately 4.00ha. At present the site is considered to be predominantly undeveloped and comprises of low density vegetation and therefore is considered permeable. An existing stable building and informal access road are currently located onsite. A portion of the development is set aside for Public Open Space (POS) and remain undeveloped, as a result the development area is approximately 1.97ha (edged in green in **Figure 2**). Post-development, the proposed impermeable area will increase to approximately 45% of the development area, given the nature of the proposals.




*Figure 2: Indicative Planning Proposals (DEN Architects, 2017)*

- 3.1.3 It is proposed that permeable surfaces are utilised where at all feasible onsite to minimise the surface water run-off generated by the increase impermeable areas. It would also be beneficial to implement SuDS features where at all feasible onsite if designed appropriately SuDS could potentially aid in the attenuation requirements and provide added benefits in terms of water quality. Detailed design will be required to confirm, subject to ground investigation and a detailed levels review, refer to Section 5.0 for the proposed outline drainage strategy.

## 4.0 SOURCES OF FLOOD RISK

### 4.1 Fluvial Flood Risk

4.1.1 Information relating to flood risk at the site has been obtained from the Environment Agency and from the Gov.UK website. An extract of the EA's Flood Zone Map for Planning is shown in **Figure 3**.

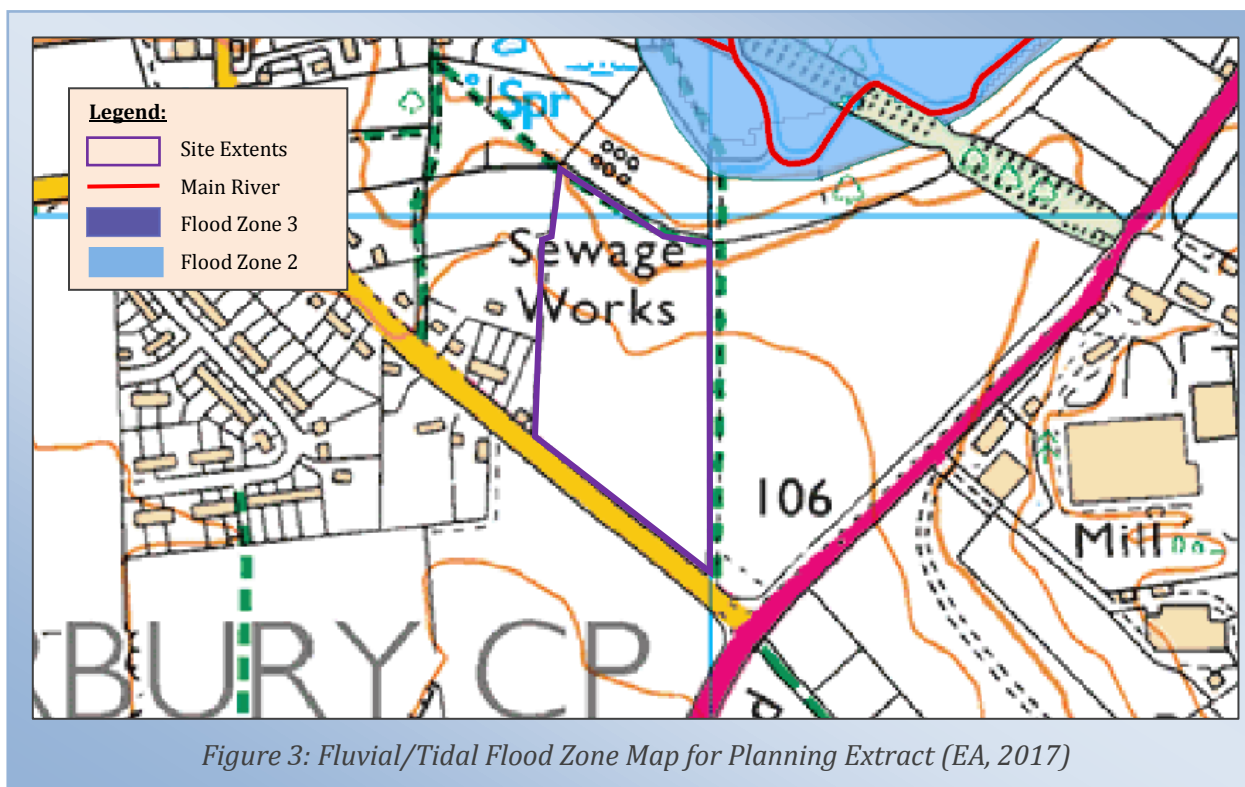

4.1.2 The Flood Map for Planning shows that the site is wholly located within Flood Zone 1 as seen in **Figure 3**, the site is also identified to be at 'low' risk of fluvial flooding on the long-term flood risk mapping (refer to **Appendix B**). The nearest Main River (Sor Brook) is identified to be 80m to the north east of site, due to the levels difference between Sor Brook (86mAOD) and the lowest elevation of site (95mAOD) the potential flood risk from this source is considered to be low.

4.1.3 Ordinary Watercourses/land drainage ditches are located within 1km of the site, the nearest being an ordinary watercourse approximately 550m to the north west of the site. Due to the proximity to the site, the flood risk from this source is classed as very low.

### 4.2 Tidal Flood Risk

4.2.1 The coastline is located more than 154km south-east of the development site and the Thames Estuary is located approximately 115km south west of the site. The associated tidal flood risks to site are therefore considered to be 'low'.

### 4.3 Flood Risk Vulnerability Classification and Flood Zone Compatibility

4.3.1 The proposals are solely 'residential' in nature and as such is classified as 'more vulnerable' in Table 2: Flood Risk Vulnerability Classification within the PPG. Table 3: Flood Risk Vulnerability and Flood Zone 'Compatibility' within the PPG confirms that this type of land use is appropriate for Flood Zone 1, providing there is no increase in flood risk elsewhere due to the proposals.

### 4.4 Surface Water Flood Risk

4.4.1 Surface water flooding occurs when rainwater is unable to drain away through the normal drainage systems or soak into the ground, but lies on or flows over the ground instead. The risk associated with surface water run-off is indicated by the long-term flood mapping (extract shown in **Figure 4**). It illustrates that the development site is at a 'very low' risk of surface water flooding.

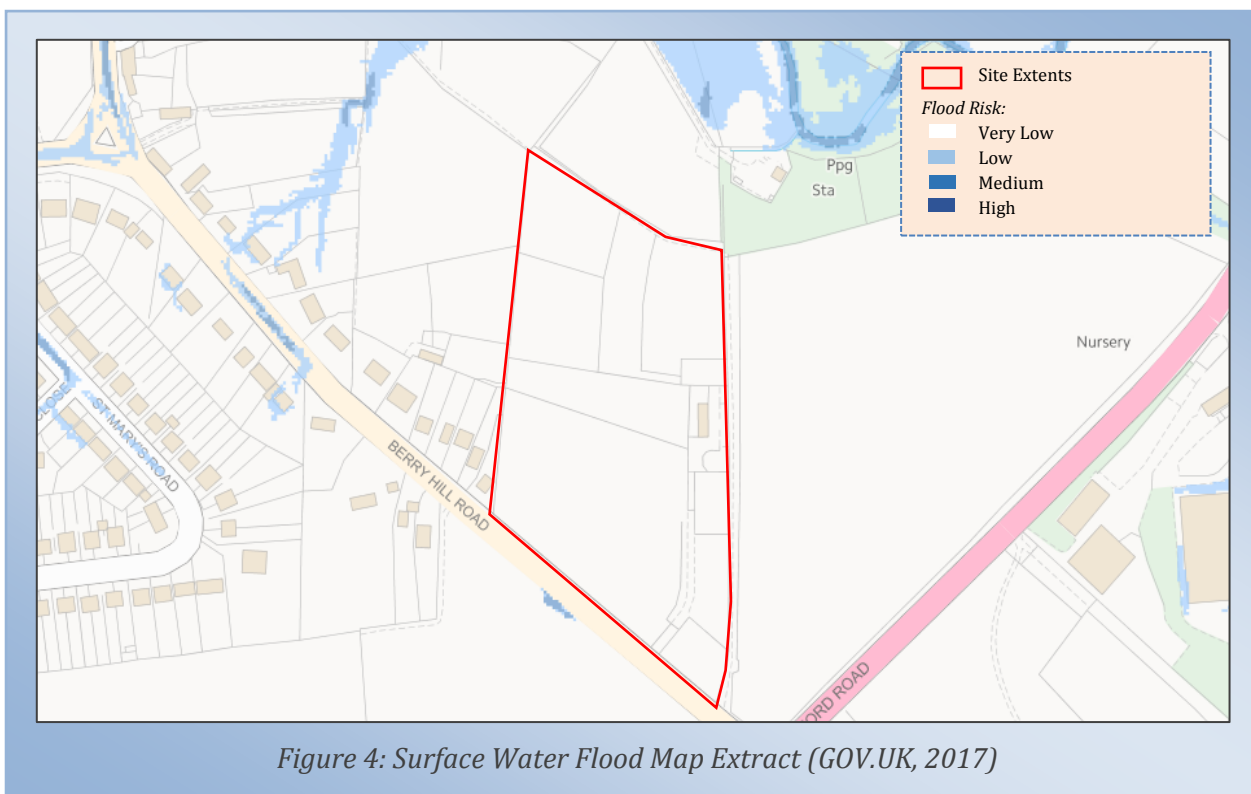


Figure 4: Surface Water Flood Map Extract (GOV.UK, 2017)

4.4.2 The risk to the proposals from surface water will be managed through the implementation of appropriate onsite drainage infrastructure. Furthermore, it would be recommended that (following any re-grade of the site) finished floor levels are raised a minimum of 150mm above the external levels to provide overland flood routes for excess surface water run-off. This will help protect properties from excess surface water run-off. Safe access and egress will be maintained via Berry Hill Road, which is shown to have predominantly 'very low' flood risk.






#### ***Pluvial (Overland run-off) Flood Risk***

- 4.4.5 Intense rainfall that is unable to soak into the ground or enter drainage systems can run-off land and result in flooding. Local topography and the land use can have a strong influence on the direction and depth of flow. Interception ditches can be incorporated along boundaries whereby the potential for overland flow is identified during the detailed design stage (either onto site or resulting from the site).
- 4.4.6 The volume and rate of overland flow from land can be exacerbated if development increases the percentage of impermeable area. Any overland flows generated by the development must be carefully controlled; safe avenues directing overland flow away from adjacent dwellings is advised.

#### ***Sewer Flood Risk***

- 4.4.7 In urban areas, rainwater is frequently drained into surface water sewers or sewers containing both surface and waste water known as 'combined sewers'. Foul water flooding often occurs in areas prone to overland flow and can result when the sewer is overwhelmed by heavy rainfall and will continue until the water drains away.
- 4.4.8 Sewer records identify the nearest public to be foul water sewers. A public foul water sewer (150mm dia.) is located to the west of site within Berry Hill Road and a further public foul water sewer (375mm dia.) is located adjacent to the eastern site boundary, running north. Thames Water have been contacted as to whether they identify any recorded sewer flooding issues in the vicinity of the site. At this time, a response is outstanding.

### **4.5 Groundwater Flood Risk**

- 4.5.1 High groundwater levels are usually the key source of groundwater flooding, which occurs when excess water emerges at the ground surface (or within manmade underground structures such as basements). Groundwater flooding is often more insistent than surface water flooding and would typically last for weeks/months rather than days meaning the result to property is often more severe.
- 4.5.2 In general terms groundwater flooding can occur from three main sources:
-  If groundwater levels are naturally close to the surface then this can present a flood risk during times of intense rainfall. No groundwater flood risk has been identified during consultation with the various interested parties, including review the Cherwell District Council (CDC) Strategic Flood Risk Assessment (SFRA) and Oxfordshire County Council (OCC) Preliminary Flood Risk Assessment (PFRA).
  -  Seepage and percolation occur where embankments above ground level hold water. In these cases, water travels through the embankment material and emerges on the opposite side of the embankment. At present there are no reported problems with groundwater flooding.
  -  Groundwater recovery / rebound occurs where the water table has been artificially depressed by abstraction. When the abstraction stops the water table makes a recovery to its original level. There is the potential for groundwater flooding in low lying areas where groundwater levels have been depressed below their pre-pumping

conditions, where these were at or close to ground level. As with the seepage scenario the likelihood of flooding from this source is low.

- 4.5.3 The EA mapping data for groundwater shows that the site is underlain by Secondary A bedrock aquifer with no secondary superficial deposits identified (**Appendix B**). The site is located within an intermediate vulnerability to a minor aquifer and no historical groundwater flooding of the site has been identified during consultation with interested parties. Irrespective, it is advised that external levels fall away from the property (where feasible) to minimise the flood risk from a variety of sources. By keeping the finished floor levels elevated relative to the externals, this should help create an overland flow route.

## 4.6 Artificial Sources of Flood Risk

- 4.6.1 National policy states that a FRA should consider the potential risks from a variety of sources including the flood risk associated with artificial sources (such as risks from reservoirs and canals).

### *Reservoirs*

- 4.6.2 The EA recognises reservoirs as bodies of water over 25,000cu.m, the site is not considered to be influenced by any flooding associated with a breach or failure in the neighbouring reservoirs (mapping included **Appendix B**).

- 4.6.3 There are a number of small bodies of water (less than 25,000cu.m) located within 1km from site, including several ponds, these features are understood to aid in local drainage. Although due to the natural topography and their scale, the risk they pose to site is considered to be 'low'.

### *Canals*

- 4.6.4 The Oxford Canal is located approximately 2km east of the site. The risk associated with canals is considered to be 'very low,' due to the proximity and local topography (levels falling away from site). Irrespective, it is advised that external levels fall away from the property (where feasible) to minimise the flood risk from a variety of sources. By keeping the finished floor levels elevated relative to the externals, this should help create an overland flood flow route in the event of a breach or any other source of flooding that could lead to overland flows including reservoir or canal flooding.

## 4.7 Historical and Anecdotal Flooding Information

- 4.7.1 An internet based search for flooding did not identify any historical flooding to the site area. Review of Cherwell District Council Strategic Flood Risk Assessment (SFRA) highlighted historic flooding of the River Cherwell Corridor in Adderbury in which Adderbury East was cut off from Adderbury West in 1875. No onsite flooding was identified however (some general mapping is included in **Appendix H**).
- 4.7.2 Consultation with various interested parties including the EA, did not highlight any historical flooding to the immediate site area.

## **4.8 Flood Risk Mitigation Measures & Residual Risks**

4.8.1 The development site is located within Flood Zone 1 based on the mapping information. To observe a more conservative approach, some mitigation measures have been discussed below in accordance with NPPF to take into account the uncertainties of future climate changes.

### *Mitigation Measures*

4.8.2 Given the low flood risks identified, provided Finished Floor Levels are raised a minimum of 150mm above the external the proposals will be safeguarded the proposed dwellings against flooding from fluvial/tidal sources and other sources leading to potential overland flows.

4.8.3 To minimise the flood risk to the neighbouring properties it is recommended that the surface water run-off generated by the proposals be managed effectively with the peak rates of run-off being restricted to the equivalent of the pre-development situation (with betterment where required).

4.8.4 The proposed onsite surface water drainage system will need to be sized to contain the 1 in 30yr return period event below ground with exceedance from storm events up to and including the 1 in 100yr return period storm event with a 40% allowance for climate change being contained onsite.

4.8.5 As with any drainage system blockages within either the foul or surface water system have the potential to cause flooding or disruption. It is important that should any drainage systems not be offered for adoption to either the Water Company or the Local Authority then an appropriate maintenance regime should be scheduled with a suitably qualified management company for these private drainage systems.

### *Residual Risks*

4.8.6 If an extreme rainfall event exceeds the design criteria for the drainage system it is likely that there will be some overland flows that are unable to enter the system, it is important that these potential overland flows are catered for within the proposed planning layout in the event that the capacity of the drainage system is exceeded.



## 5.0 SURFACE WATER MANAGEMENT

### 5.1 Pre-Development Surface Water Run-off

- 5.1.1 The total site covers approximately 4.00ha and at present is approximately 100% permeable, the development area of the site is 1.97ha based on the indicative planning proposals showing POS areas. At present the existing permeable and impermeable areas (stables) of the site naturally drain to ground overtime and Sor Brook via overland flow to the north of the site.
- 5.1.2 The peak rates and volumes of run-off generated by the site have been calculated for the peak events shown in **Table 1** (full details **Appendix I**). The surface water run-off rates have been calculated using the IH124 Greenfield run-off method.

Site Area	Run-Off Rates				Run-Off Volumes	
	1 In 1 Year	1 In 30 Year	1 In 100 Year	QBar	1 In 1 Year	1 In 100 Year
1.97ha (greenfield)	0.6l/s	1.7l/s	2.4l/s	0.7l/s	12.6cu.m	83.6cu.m

*Table 1: Pre-Development Surface Water Run-Off Rates (Betts Hydro, 2017)*

### 5.2 Post Development Surface Water Run-Off

- 5.2.1 The nature of the proposals means that the impermeable areas of the site will increase, based on the indicative layout to 45% of the development area. The unrestricted post-development run-off rates have been detailed in **Table 2**, based on the impermeable area.

Development Area	Run-Off Rates		
	1 In 1 Year	1 In 30 Year	1 In 100 Year +CC
Brownfield Portion (0.886ha)	34.7l/s	76.6l/s	129.3l/s

*Table 2: Post-Development Un-Restricted Run-Off Rates (Betts Hydro, 2017)*

- 5.2.2 The development proposals will provide significant betterment to the unrestricted rates noted above, the surface water run-off generated by the development area will mimic the pre-development situation, meaning betterment on the uncontrolled rates quoted above. The proposed discharge rates are discussed in Section 5.6 along with the drainage strategy.

### 5.3 Sustainable Drainage Systems (SuDS)

- 5.3.1 Sustainable Drainage Systems (SuDS) have the ability to address four core objectives: water quantity, water quality, amenity and biodiversity. In accordance with the NPPF, the Non-Statutory Technical Standards for Sustainable Drainage Systems (March 2015) and the SuDS Manual (CIRIA 753) SuDS should be specified wherever possible to manage surface water run-off generated onsite.
- 5.3.2 Where possible, peak surface water discharge rates to watercourses and sewers should be appropriately managed and where possible reduced. Preference should always be

given to SuDS over the traditional methods of buried sewers wherever possible and practical.




- 5.3.3 It would be beneficial to implement wider green space/POS area(s) in one or more locations within site, where SuDS features could be implemented (indicative proposals show POS to the south-west of the development). Multiple benefits to using SuDS include the improvement of bio-diversity, aesthetics, ecology and water quality. Furthermore, there may be the potential to utilise some SuDS features for conveyance/attenuation of surface water flows, opposed to the traditional below ground storage methods.
- 5.3.4 Opportunities should be taken to provide soft landscaping where at all possible on site to assist in minimising surface water run-off, furthermore depending on the scale of the proposals there may be the opportunity to incorporate methods such as swales, rills and rain gardens to provide a degree of treatment before flows are carried offsite (examples seen in **Figure 5**).
- 5.3.5 It would also be recommended that permeable paving and bio-filtration be considered in private (non-adopted areas) where at all feasible to assist locally with surface water management (subject to optimum ground conditions following further onsite testing). If infiltration is not feasible then the permeable paving should be lined with a positive connection into the main drainage for the site.



- 5.3.6 Should the ground conditions onsite prove favourable, the infiltration measures should be considered where at all feasible, promoting SuDS to deal with surface water at the source, limiting the required attenuation and reducing the volume of surface water in the sewer infrastructure. Detailed design should confirm whether this site would be suitable for incorporation of SuDS following more detailed analysis of levels, ground conditions and attenuation requirements.

## 5.4 Methods of Surface Water Management

5.4.1 At present the development area covers 1.97ha, the proposed impermeable area is set to increase to approximately 45% based on the planning proposals. There are three methods that have been reviewed for the management and discharge of surface water. These may be applied individually or collectively to form a complete strategy and should be applied in the order of priority listed below:

-  Discharge via infiltration
-  Discharge to watercourse
-  Discharge to public sewerage system

## 5.5 Discharge via Infiltration

5.5.1 Any impermeable areas that can drain to soakaway or an alternative method of infiltration would significantly improve the sustainability of any surface water systems.

5.5.2 The Cranfield Soil and AgriFood Institute (CSAI), Soilscape viewer identifies the soil within the area of the site to be slightly acid but base rich loamy soils. Drainage in the areas is considered to be freely draining to the groundwater.

The British Geology Survey (BGS) mapping data indicates that ground conditions are as follows: -

Bedrock Geology: Marlstone Rock Formation – Ferruginous Limestone and Ironstone

5.5.3 The ground conditions identified by the online datasets suggest infiltration characteristics at the site will be favourable for surface water management at the site, furthermore the soil characteristics within the region are confirmed to be low (0.150) suggesting a positive percolation rate. Given the above characteristics, further investigation on the site is required to be undertaken including Soakaway Testing to BRE365.

5.5.4 Should Soakaway Testing identify the substrata to be favourable for infiltration, the proposals are to utilise infiltration methods to manage the surface water run-off generated by the proposals (refer to drainage strategy plan in **Figure 6; Appendix K**). The specific drainage infrastructure will be confirmed during the detailed design stage following discussion with all relevant parties, although given the residential nature of the proposals it is likely domestic soakaways will be utilised where feasible with an appropriate highways infiltration method being adopted.

5.5.5 In terms of discharge rates, these will be in accordance with the SuDS Manual and Non-Statutory Technical Standard for SuDS. The proposed discharge will not exceed that of the existing greenfield situation.



5.5.6 The proposed onsite surface water drainage system will need to be sized to contain the 1 in 30yr return period event wholly below ground with overland run-off from storm events up to and including the 1 in 100yr return period storm event with a 40% allowance for climate change being contained onsite.

5.5.7 It would be beneficial to implement SuDS features into the design to aid in reducing the surface water generated by the proposed impermeable areas of the site, some SuDS features will also assist with any attenuation.

## 5.6 Discharge to Watercourse

5.6.1 Should further testing at the site identify that infiltration will not offer a feasible surface water management solution (in part or in full) then the next method in the hierarchical approach should be to discharge to watercourse. The nearest watercourse to the site is the Sor Brook (Main River) located 80m to the north of the site.

5.6.2 It would be proposed that surface water run-off generated by the proposals discharge to Sor Brook as illustrated in **Figure 6**. As the existing ground levels onsite fall predominantly towards the watercourse, it is assumed that a gravity solution could be feasible at the site, this is subject to further analysis as part of detailed drainage designs.



- 5.6.3 Consent will be required to outfall into Sor Brook from both the Environment Agency (as the watercourse is Main River) and the Lead Local Flood Authority (Oxfordshire County Council). An Environmental Permit will be required for any works to the Main River network including consents for any new outfall structures and early discussion would be advised with the EA to identify any constraints. The Lead Local Flood Authority will be required to agree the proposed discharge rate(s) under Land Drainage Consents.
- 5.6.4 A connection to the watercourse will require offsite routeing. Should any off-site works be required outside of land controlled by the developer then consents should be obtained from the relevant parties at an early stage.
- 5.6.5 In accordance with the SuDS Manual (CIRIA 753) and the Non-Statutory Technical Standards for Sustainable Drainage Systems (March 2015) all sites (greenfield and brownfield) should endeavour to achieve as close to pre-development greenfield rates as is viable, therefore the proposals are to restrict the rate of discharge from the site to mimic the greenfield situation. The development will reduce flood risk through restricting the discharge from site to 5l/s for all storm events (this restriction is based on the minimum constraint of a standard flow control device).
- 5.6.6 The restricted flow will generate a storage requirement during periods of intense rainfall. The stormwater storage figures quoted in **Table 3/Appendix L** are estimates only and the detailed drainage design will determine with accuracy the stormwater storage requirements. Should intrusive investigations identify a more stringent discharge rate is required then this will be addressed during detailed drainage design stage.

Impermeable Area (0.113ha)	1 In 1 Year	1 In 30 Year	1 In 100 Year + 40% CC
Restricted Run-Off Rate	5l/s	5l/s	5l/s
Estimated Stormwater Storage Volume	82cu.m-131cu.m	253cu.m-353cu.m	541cu.m-724cu.m

*Table 3: Estimated Stormwater Storage Requirements (Betts Hydro, 2017)*

- 5.6.7 It would be beneficial to implement SuDS features including permeable surfaces and bio-filtration where at all feasible (subject to ground investigation and a detailed level review). If designed appropriately the SuDS features could potentially aid in the attenuation requirements for the proposals and provide added benefits in terms of water quality. Detailed design will be required to confirm whether SuDS can be incorporated, given the small scale of this development.

## 5.7 Discharge to Public Sewer Network

- 5.7.1 Should infiltration not be feasible (following further investigation) then the proposals are to utilise the watercourse network near the development site for the management of surface water run-off. There are no proposals at this time to discharge surface water generated at the site to the public sewer network.

## 5.8 Climate Change

- 5.8.1 There are indications that the climate in the UK is changing significantly and it is widely believed that the nature of climate change will vary greatly by region. Current expert opinion indicates the likelihood that future climate change would produce more frequent short duration and high intensity rainfall events with the addition of more frequent periods of long duration rainfall. It is believed that the impact of climate change means there is likely to be a long-term increase in the average sea levels, with an expectation that sea levels will rise gradually. An increase in flood water levels means that future flooding events will occur more frequently and will have a greater impact.
- 5.8.2 In light of the future uncertainties Climate Change should be accounted for within the design of all new developments. The recently published Environment Agency document *'Adapting to Climate Change: Advice for Flood and Coastal Erosion Risk Management Authorities'* supersedes Defra's policy statement on Flood Risk and Coastal Erosion Risk Management (2009) and should be used for future proposals. Climate change factors have been considered and any increase in the level of flood risk (to the site) from climate change is likely to be related to the increase in rainfall intensity and duration and its impact upon the surface water drainage system.
- 5.8.3 In accordance with the updated Climate Change projections provides estimated changes to rainfall intensity (**Table 4**) and based on the design life of the development (100yrs) the "total potential change figures for the 2080's" has been utilised.

PROJECTIONS	TOTAL POTENTIAL CHANGE ANTICIPATED FOR THE 2080'S
Upper End Estimate	40%
Central Change Factor	20%

*Table 4: Change to Extreme Rainfall Intensity Compared to 1961-1990 Baseline (Environment Agency, 2016)*

## **6.0 FOUL WATER MANAGEMENT**

---

- 6.1 Review of the Thames Water sewer records identify there to be foul sewers within the vicinity, the nearest public foul water sewer (375mm dia.) runs north, parallel to the eastern boundary of the site towards a pumping station. There is also a foul sewer system (150mm dia.) which travels westwards along Berry Hill Road.
- 6.2 Due to the nature of use onsite at present there are no existing foul water flows generated or any known foul water connections. Based on the proposals for the construction of 60no. residential units, the approximate peak foul water flows generated by the development are 2.7l/s. This is based on 4000 litres per dwelling per 24 hours; the guidance contained within Sewers for Adoption (SfA).
- 6.3 The foul water flows generated by the development are proposed to connect into the adjacent foul water sewer (375mm dia.) to the east of site. Detailed drainage design will be required to confirm this strategy and identify whether a site wide gravity connection is feasible.
- 6.4 Consents and relevant agreements will be required from Thames Water prior to commencement of works. Consultation with Thames Water will identify their preferred point(s) of connection and it is advised this early discussion is undertaken early to establish whether there are any additional constraints which need to be considered.
- 6.5 Should any off-site works be required outside of land controlled by the developer (highways), then discussions with the appropriate third parties should be obtained at an early stage.

## 7.0 SUMMARY AND CONCLUSIONS

---

7.1 This Flood Risk Assessment and Drainage Management Strategy was commissioned by Hollins Strategic Land referred to hereafter as 'the client'. This report has been prepared to support an outline planning application for the construction of a residential development on land to the north of Berry Hill Road in Adderbury.

### Flood Risk

7.2 The site covers 4.00ha and is located within Flood Zone 1 based on the Environment Agency Flood Zone Map for Planning. The proposals are for a residential development, which is more vulnerable in Table 2: Flood Risk Vulnerability Classification within the Planning Practice Guidance (PPG). This nature of development is confirmed to be appropriate within Flood Zone 1, providing there is no increase in flood risk elsewhere due to the proposals.

7.3 This report has reviewed all sources of flood risk to both the proposed development and to existing development, no historical flooding at the site was identified during the research or consultations undertaken as part of this assessment. The nearest Main River (Sor Brook) is located 80m to the north-west of the site. The flood risk associated with fluvial sources is identified to be low, furthermore the flood risk associated with surface water, tidal, groundwater, sewer and artificial flood sources are also considered to be low.

7.4 Due to the low flood risks identified, the development is considered to be appropriate in accordance with the National Planning Policy Framework and Planning Practice Guidance. The principle focus of this assessment has been the effective management of surface water run-off, so not to increase flood risk elsewhere as a result of the development, this includes consideration of sustainable management options in accordance with national and local policy.

### Drainage Strategy

7.5 In accordance with the drainage hierarchy there are three methods that have been reviewed for the appropriate management and discharge of surface water, these have been applied in the order of priority; discharge via infiltration, to a watercourse and finally to public sewerage system. Based on the ground conditions identified online, it can be considered that infiltration would likely provide a feasible surface water drainage solution for the site. In accordance with LPA's and TW requirements, Soakaway Testing to BRE365 will still be required to be undertaken to evidence that discharge to ground will be a viable solution (prior to exploring other methods in the drainage hierarchy).

7.6 As the substrata is identified via web based resources to be favourable for infiltration, the proposals are to utilise this drainage method for management of surface water run-off generated by the development. Given the residential nature of the proposals it is likely domestic soakaways will be utilised where at all feasible with an appropriate highways infiltration system being implemented following discussion with the highways authority. The specific drainage infrastructure will be confirmed during the detailed design stage following discussion with all relevant parties, it is advised that new soakaway(s) (or other infiltration methods) be implemented within the boundaries of site such being designed to BRE365 standard.



- 7.7 In terms of discharge rates, in accordance with the SuDS Manual (CIRIA 753) and the Non-Statutory Technical Standards for Sustainable Drainage Systems (March 2015) all sites should endeavour to achieve as close to pre-development greenfield rates as is viable. The proposals are to therefore discharge as close to greenfield as practical, the discharge rate will not exceed that of the existing onsite percolation rate(s).
- 7.8 Should further testing at the site identify that infiltration will not offer a feasible surface water management solution then the next method in the hierarchical approach should be to discharge to watercourse. Sor Brook is located approximately 80m north of the site and would provide an alternative connection for surface water run-off generated by the proposals. Detailed design will be required to confirm feasibility of the strategy. Consents from the Environment Agency will also be required for any new outfall structure, along with agreements of proposed rates of discharge.
- 7.9 The discharge of surface water run-off generated by the site is proposed to be restricted to 5.0l/s. The restricted flow will generate a storm water storage requirement during the extreme events. The estimated attenuation would be 253cu.m-353cu.m for the 1 in 30-year storm event and 541cu.m-724cu.m for a 100 year (+40% climate change).
- 7.10 This report has been prepared in consultation with the relevant interested parties and incorporates their comments where possible. The Flood Risk Assessment & Drainage Management Strategy is considered to be commensurate with the scale and nature of the development proposals and in summary, the development can be considered appropriate in accordance with the Planning Practice Guidance.

## 8.0 RECOMMENDATIONS

---

- 8.1 Given the low flood risks identified, provided finished floor levels are raised a minimum of 150mm above the external levels, the proposals will be safeguarded the proposed dwellings against flooding from fluvial/tidal sources and other sources leading to potential overland flows. Any overland flows generated by the proposed development must be controlled, safe avenues directing overland flow away from any existing buildings is advised.
- 8.2 To minimise the flood risk to the neighbouring property and proposed dwellings it is proposed that the surface water run-off generated by the proposals be managed effectively with the peak rates of run-off being restricted in accordance with the NPPF and Non-Technical Standards for SuDS.
- 8.3 Detailed drainage design will be required to confirm the exact infiltration methods to be used within the development site following further design and discussion. Early discussion with all relevant parties including highways is advised at an early stage, this will identify any additional considerations.
- 8.4 Consideration is recommended into the stormwater attenuation requirements due to restricting the surface water discharge from the site. The proposed onsite surface water drainage system will need to be sized to contain the 30yr return period event wholly below ground with overland run-off from storm events up to and including the 1 in 100yr return period storm event with an allowance for climate change being contained onsite. Based on the design life this allowance for CC is in the form of a 40% increase in rainfall intensity.
- 8.5 It is important that should any drainage systems not be offered for adoption to either the Water Company or the Local Authority then an appropriate maintenance regime should be scheduled with a suitably qualified management company for these private drainage systems.

## **BIBLIOGRAPHY & REFERENCES**

---

- Adapting to Climate Change: Advice for Flood and Coastal Erosion Risk Management Authorities  
– Environment Agency/DEFRA 2016
- CIRIA 522: Sustainable urban drainage systems – design manual for England and Wales (2000).  
CIRIA 523: Sustainable urban drainage systems – best practice manual (2001).  
CIRIA 609: Sustainable drainage systems. Hydraulic, structural and water quality advice (2004).  
CIRIA 624: Development and flood risk – guidance for the construction industry (2004).  
CIRIA 635: Designing for Exceedance in urban drainage: Good practice (2006).  
CIRIA 644: Building Greener (2007).  
CIRIA 753: The SUDS manual (2015).  
Flood Risk to People – Phase 2 (FD2321/TR2), DEFRA and the Environment Agency (2006).  
Flood estimation for small catchments: Institute of Hydrology Report No.124, NERC (1994).  
Flood Estimation Handbook, Centre for Ecology and Hydrology (1999).  
Planning Policy Statement 25: Development and Flood Risk (2006).  
Sewers for Adoption 7th Edition, WRc (2012).  
Technical Guidance to the National Planning Policy Framework, CLG (2012).

### **Web-based References**

- Bingmaps – <http://www.bing.com/Maps/>  
British Geological Survey – <http://www.bgs.ac.uk/opengeoscience/home.html>  
Chronology of British Hydrological Events – [www.dundee.ac.uk/](http://www.dundee.ac.uk/)  
CIRIA – <http://www.ciria.org/>  
Cranfield University – <http://www.landis.org.uk/soilscapes/>  
Environment Agency – [www.environment-agency.gov.uk/](http://www.environment-agency.gov.uk/)  
FloodProBE – <http://www.floodprobe.eu/>  
Flood Forum – <http://www.floodforum.org.uk/>  
Google Maps – <http://maps.google.co.uk/>  
Streetmap – <http://www.streetmap.co.uk/>  
Thames Water - <https://www.thameswater.co.uk/>

This page has been left intentionally blank

## **APPENDIX A: NPFF EXTRACTS**

---

This page has been left intentionally blank

**Table 1: Flood zones**

(Note: These flood zones refer to the probability of river and sea flooding, ignoring the presence of defences)

<p><b>Zone 1 - low probability</b></p> <p><b>Definition</b> This zone comprises land assessed as having a less than 1 in 1,000 annual probability of river or sea flooding (&lt;0.1%).</p> <p><b>Appropriate uses</b> All uses of land are appropriate in this zone.</p> <p><b>Flood risk assessment requirements</b> For development proposals on sites comprising one hectare or above the vulnerability to flooding from other sources as well as from river and sea flooding, and the potential to increase flood risk elsewhere through the addition of hard surfaces and the effect of the new development on surface water run-off, should be incorporated in a flood risk assessment. This need only be brief unless the factors above or other local considerations require particular attention.</p> <p><b>Policy aims</b> In this zone, developers and local authorities should seek opportunities to reduce the overall level of flood risk in the area and beyond through the layout and form of the development, and the appropriate application of sustainable drainage systems<sup>2</sup>.</p>
<p><b>Zone 2 - medium probability</b></p> <p><b>Definition</b> This zone comprises land assessed as having between a 1 in 100 and 1 in 1,000 annual probability of river flooding (1% – 0.1%), or between a 1 in 200 and 1 in 1,000 annual probability of sea flooding (0.5% – 0.1%) in any year.</p> <p><b>Appropriate uses</b> Essential infrastructure and the water-compatible, less vulnerable and more vulnerable uses, as set out in table 2, are appropriate in this zone. The highly vulnerable uses are <i>only</i> appropriate in this zone if the Exception Test is passed.</p> <p><b>Flood risk assessment requirements</b> All development proposals in this zone should be accompanied by a flood risk assessment.</p> <p><b>Policy aims</b> In this zone, developers and local authorities should seek opportunities to reduce the overall level of flood risk in the area through the layout and form of the development, and the appropriate application of sustainable drainage systems.</p>
<p><b>Zone 3a - high probability</b></p> <p><b>Definition</b> This zone comprises land assessed as having a 1 in 100 or greater annual probability of river flooding (&gt;1%), or a 1 in 200 or greater annual probability of flooding from the sea (&gt;0.5%) in any year.</p> <p><b>Appropriate uses</b> The water-compatible and less vulnerable uses of land (table 2) are appropriate in this zone. The highly vulnerable uses should not be permitted in this zone.</p> <p>The more vulnerable uses and essential infrastructure should only be permitted in this zone if the Exception Test is passed. Essential infrastructure permitted in this zone should be designed and constructed to remain operational and safe for users in times of flood.</p> <p><b>Flood risk assessment requirements</b> All development proposals in this zone should be accompanied by a flood risk assessment.</p> <p><b>Policy aims</b> In this zone, developers and local authorities should seek opportunities to:</p> <ul style="list-style-type: none"><li>• reduce the overall level of flood risk in the area through the layout and form of the development and the appropriate application of sustainable drainage systems;</li></ul>



- relocate existing development to land in zones with a lower probability of flooding; and
- create space for flooding to occur by restoring functional floodplain and flood flow pathways and by identifying, allocating and safeguarding open space for flood storage.

### **Zone 3b - the functional floodplain**

#### **Definition**

This zone comprises land where water *has* to flow or be stored in times of flood.

Local planning authorities should identify in their Strategic Flood Risk Assessments areas of functional floodplain and its boundaries accordingly, in agreement with the Environment Agency. The identification of functional floodplain should take account of local circumstances and not be defined solely on rigid probability parameters. But land which would flood with an annual probability of 1 in 20 (5%) or greater in any year, or is designed to flood in an extreme (0.1%) flood, should provide a starting point for consideration and discussions to identify the functional floodplain.

#### **Appropriate uses**

Only the water-compatible uses and the essential infrastructure listed in table 2 that has to be there should be permitted in this zone. It should be designed and constructed to:

- remain operational and safe for users in times of flood;
- result in no net loss of floodplain storage;
- not impede water flows; and
- not increase flood risk elsewhere.

Essential infrastructure in this zone should pass the Exception Test.

#### **Flood risk assessment requirements**

All development proposals in this zone should be accompanied by a flood risk assessment.

#### **Policy aims**

In this zone, developers and local authorities should seek opportunities to:

- reduce the overall level of flood risk in the area through the layout and form of the development and the appropriate application of sustainable drainage systems;
- relocate existing development to land with a lower probability of flooding.

**Table 2: Flood risk vulnerability classification**

<p><b>Essential infrastructure</b></p> <ul style="list-style-type: none"> <li>• Essential transport infrastructure (including mass evacuation routes) which has to cross the area at risk.</li> <li>• Essential utility infrastructure which has to be located in a flood risk area for operational reasons, including electricity generating power stations and grid and primary substations; and water treatment works that need to remain operational in times of flood.</li> <li>• Wind turbines.</li> </ul>
<p><b>Highly vulnerable</b></p> <ul style="list-style-type: none"> <li>• Police stations, ambulance stations and fire stations and command centres and telecommunications installations required to be operational during flooding.</li> <li>• Emergency dispersal points.</li> <li>• Basement dwellings.</li> <li>• Caravans, mobile homes and park homes intended for permanent residential use<sup>3</sup>.</li> <li>• Installations requiring hazardous substances consent<sup>4</sup>. (Where there is a demonstrable need to locate such installations for bulk storage of materials with port or other similar facilities, or such installations with energy infrastructure or carbon capture and storage installations, that require coastal or water-side locations, or need to be located in other high flood risk areas, in these instances the facilities should be classified as "essential infrastructure")<sup>5</sup>.</li> </ul>
<p><b>More vulnerable</b></p> <ul style="list-style-type: none"> <li>• Hospitals.</li> <li>• Residential institutions such as residential care homes, children's homes, social services homes, prisons and hostels.</li> <li>• Buildings used for dwelling houses, student halls of residence, drinking establishments, nightclubs and hotels.</li> <li>• Non-residential uses for health services, nurseries and educational establishments.</li> <li>• Landfill and sites used for waste management facilities for hazardous waste<sup>6</sup>.</li> <li>• Sites used for holiday or short-let caravans and camping, <i>subject to a specific warning and evacuation plan</i>.<sup>7</sup></li> </ul>
<p><b>Less vulnerable</b></p> <ul style="list-style-type: none"> <li>• Police, ambulance and fire stations which are <i>not</i> required to be operational during flooding.</li> <li>• Buildings used for shops, financial, professional and other services,</li> </ul>
<p>restaurants and cafes, hot food takeaways, offices, general industry, storage and distribution, non-residential institutions not included in "more vulnerable", and assembly and leisure.</p> <ul style="list-style-type: none"> <li>• Land and buildings used for agriculture and forestry.</li> <li>• Waste treatment (except landfill and hazardous waste facilities).</li> <li>• Minerals working and processing (except for sand and gravel working).</li> <li>• Water treatment works which do <i>not</i> need to remain operational during times of flood.</li> <li>• Sewage treatment works (if adequate measures to control pollution and manage sewage during flooding events are in place).</li> </ul>
<p><b>Water-compatible development</b></p> <ul style="list-style-type: none"> <li>• Flood control infrastructure.</li> <li>• Water transmission infrastructure and pumping stations.</li> <li>• Sewage transmission infrastructure and pumping stations.</li> <li>• Sand and gravel working.</li> <li>• Docks, marinas and wharves.</li> <li>• Navigation facilities.</li> <li>• Ministry of Defence defence installations.</li> <li>• Ship building, repairing and dismantling, dockside fish processing and refrigeration and compatible activities requiring a waterside location.</li> <li>• Water-based recreation (excluding sleeping accommodation).</li> <li>• Lifeguard and coastguard stations.</li> <li>• Amenity open space, nature conservation and biodiversity, outdoor sports and recreation and essential facilities such as changing rooms.</li> <li>• Essential ancillary sleeping or residential accommodation for staff required by uses in this category, <i>subject to a specific warning and evacuation plan</i>.</li> </ul>



## **APPENDIX B: EA INFORMATION & CORRESPONDENCE**

---

This page has been left intentionally blank

## Patrick Taylor

---

**From:** Enquiries\_THM <enquiries\_THM@environment-agency.gov.uk>  
**Sent:** 22 June 2017 16:15  
**To:** Patrick Taylor  
**Subject:** THM51091 Product 4 BERRY HILL ROAD, ADDERBURY  
**Attachments:** Historic Flood Map.pdf; Flood Map.pdf

Dear Patrick

### **Our Reference: THM51091**

Thank you for your email requesting product 4 data/modelled flood levels\*.

We unfortunately do not have any detailed flood risk modelling in this location.

We are sorry that we are therefore unable to provide modelled flood levels and extents for your site.

We have attached a copy of our Flood Map for Planning and a map showing the historic flood event outlines we have records for Berry Hill Road, Adderbury.

I trust this is helpful.

### **How we have considered your request**

We have considered your request under the provisions of the Freedom of Information Act 2000 / Environmental Information Regulations 2004 (EIR). The Act requires that we respond to requests by advising you whether or not information is held, and if so by providing you with that information.

EIR Regulation 3(2) states that information is held if it is in our possession and has been produced or received by us, or it is held by another person on our behalf at the time the request is received.

### **Information not held**

In this case, the information you have requested is not held by the Environment Agency, and we are therefore refusing your request on the grounds that there is no information we can provide.

Where a request is for environmental information, the Regulations allow us to refuse to disclose it if the exception at EIR Regulation 12(4)(a) applies. The regulation states that a public authority may refuse to disclose environmental information to the extent that it does not hold that information when an applicant's request is received.

It is not possible for us to conduct a public interest balancing test because the reason for non-disclosure is that the information is not held.

I hope that we have correctly interpreted your request. Please refer to our Open Government Licence for the permitted use of the supplied data:

<http://www.nationalarchives.gov.uk/doc/open-government-licence/version/3/>

**Please be aware that many of our datasets are now available online. Simply visit [environment.data.gov.uk](http://environment.data.gov.uk)**

We respond to requests for recorded information that we hold under the Freedom of Information Act 2000 (FOIA) and the associated Environmental Information Regulations 2004 (EIR).

We are committed to providing a professional customer service. Please help us understand more about what is important to you by completing our [two minute survey](#).

Please get in touch if you have any further queries or contact us within two months if you'd like us to review the information we have sent.

Yours sincerely

Alyson Barnes  
Customers & Engagement Officer  
Direct Dial: 0208 474 8836  
Internal: 48836

**Environment Planning & Engagement Team**  
**Thames Area**  
**Red Kite House, Howbery Park, Wallingford OX10 8BD**

---

**From:** Patrick Taylor [mailto:patricktaylor@betts-associates.co.uk]  
**Sent:** 22 June 2017 11:36  
**To:** Enquiries\_THM <enquiries\_THM@environment-agency.gov.uk>  
**Cc:** Enquiries, Unit <enquiries@environment-agency.gov.uk>  
**Subject:** FRA ADVICE: BERRY HILL ROAD, ADDERBURY

To whom it may concern,

***BERRY HILL ROAD, ADDERBURY.***

Please could you confirm whether you have any information that you feel would be valuable to a Flood Risk Assessment for the above site (location plan attached), including details of historical flooding and water levels (PRODUCT 4); this would be greatly appreciated. Please do not hesitate to contact me on the details below to discuss further should you require additional information or clarification.

Kind Regards

**Patrick Taylor** BSc(Hons)  
*Graduate Flood Risk Analyst*

**BETTS HYDRO**  
*Specialists in Drainage and Flood Risk*  
Old Marsh Farm Barns, Welsh Road, Sealand, Flintshire, CH5 2LY  
CHESTER OFFICE - 01244 289041

[patricktaylor@betts-associates.co.uk](mailto:patricktaylor@betts-associates.co.uk)  
[www.betts-associates.co.uk](http://www.betts-associates.co.uk)

CIVIL | STRUCTURAL | GEO-ENVIRONMENTAL | HYDROLOGY | FLOOD RISK MANAGEMENT  
SUDS | STRUCTURAL SURVEYS | PARTY WALL DUTIES | INFILTRATION | GEO-TECHNICAL


 Please consider the environment before printing this email.

**ELECTRONICALLY TRANSMITTED INFORMATION**

This electronic transmission is strictly confidential and intended solely for the addressee. It may contain information which is covered by legal, professional or other privilege. If you are not the intended addressee, you must not disclose, copy or take any action in reliance of this transmission. If you have received this transmission in error, please notify us as soon as possible. All emails transmitted by Betts Associates, Betts Geo or Betts Hydro are virus checked. This does not guarantee that transmissions are virus free. Reference should always be made to the hard copy of any electronically transmitted files. Electronic data does not constitute contract documentation. Use of the content of our files is at your own risk. You remain responsible for anything produced using all or part of the data supplied

This message has been scanned and no issues were discovered.  
Click [here](#) to report this email as spam

# Flood Map for Planning centred on Berry Hill Road, Adderbury OX17 3HF Created on 22/06/17 REF: THM51091

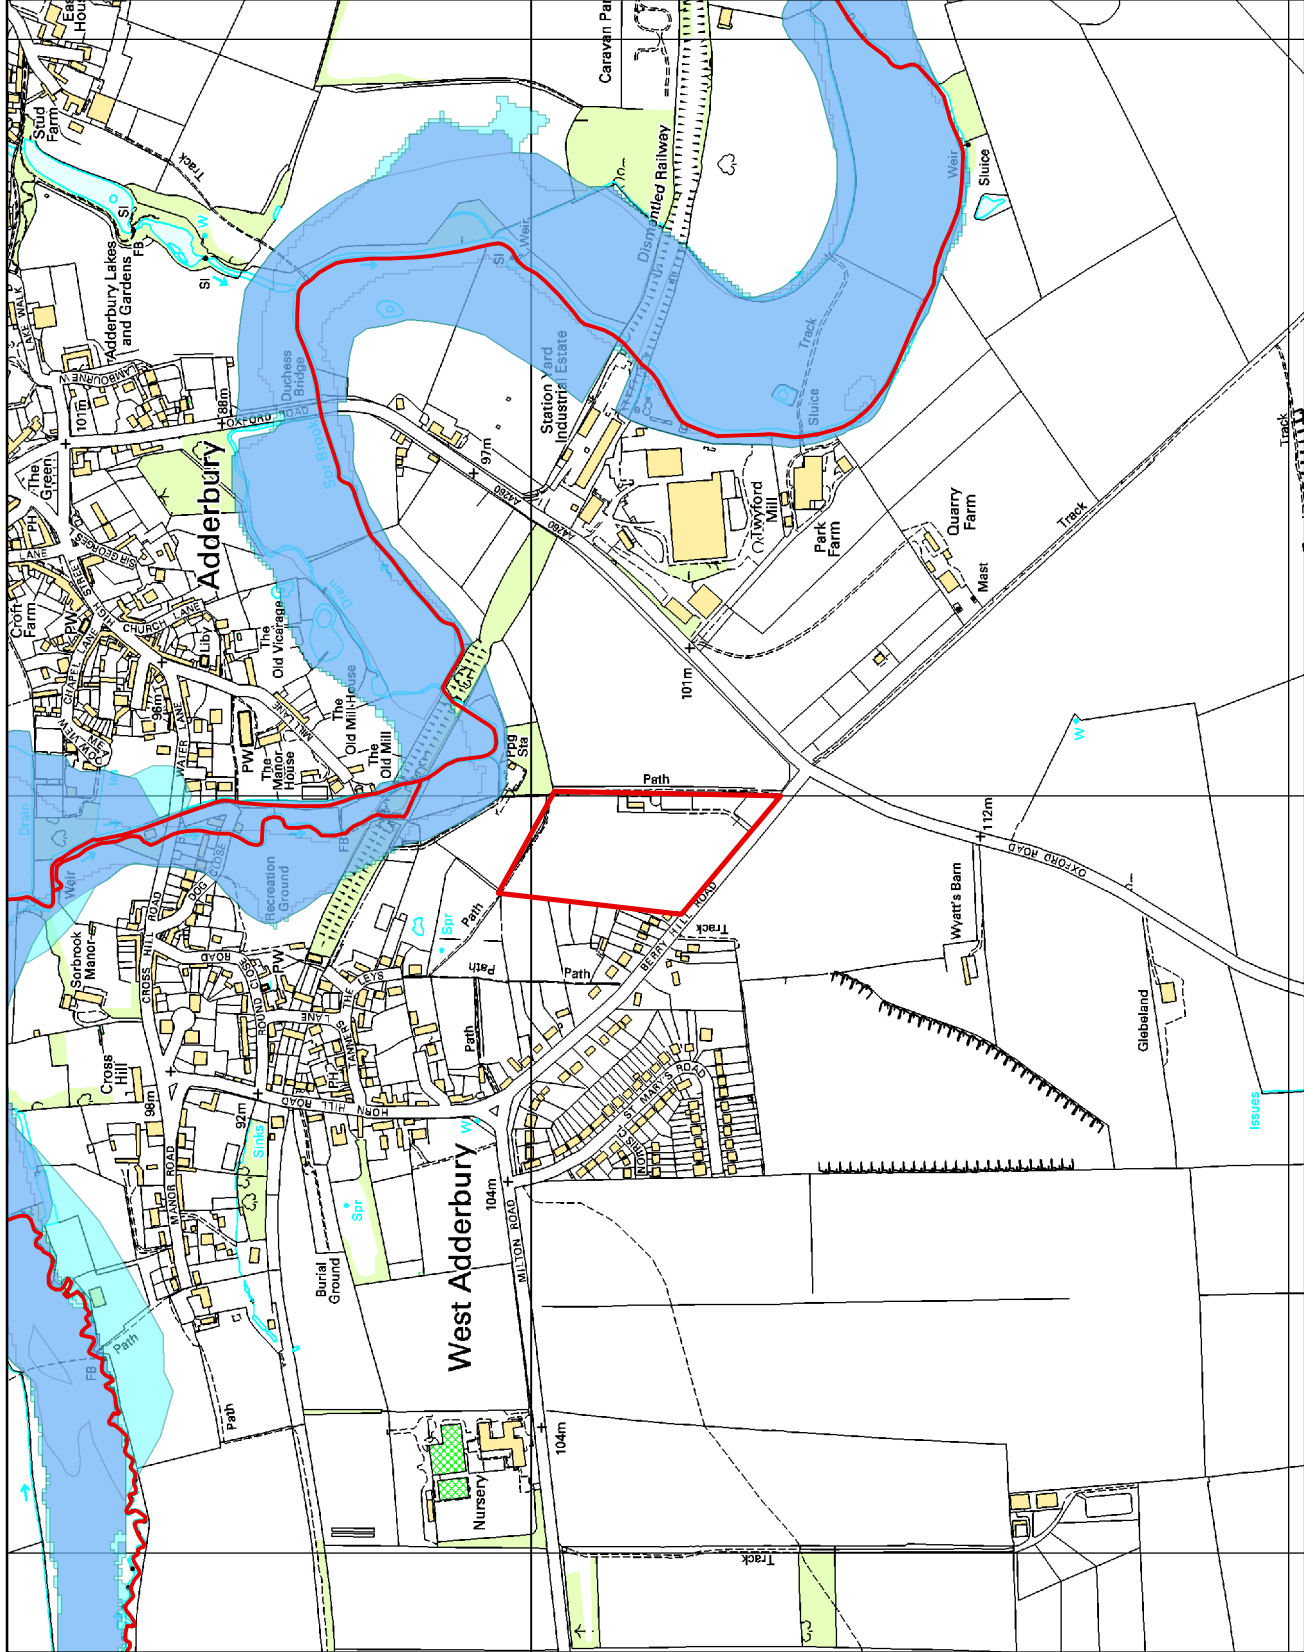

### Legend

- Main River
- Flood defences
- Areas benefiting from flood defences
- Flooding from rivers or sea (FZ3)
- Extent of extreme flood (FZ2)
- Flood Map - flood storage areas


Flooding from rivers or sea without defences (Flood Zone 3) shows the area that could be affected by flooding:

- from the sea with a 1 in 200 or greater chance of happening each year
- or from a river with a 1 in 100 or greater chance of happening each year.

The Extent of an extreme flood (Flood Zone 2) shows the extent of an extreme flood from rivers or the sea with up to a 1 in 1000 chance of occurring each year.

# Historic Flood Map centred on Berry Hill Road, Adderbury OX17 3HF

Created on 22/06/17 REF: THM51091

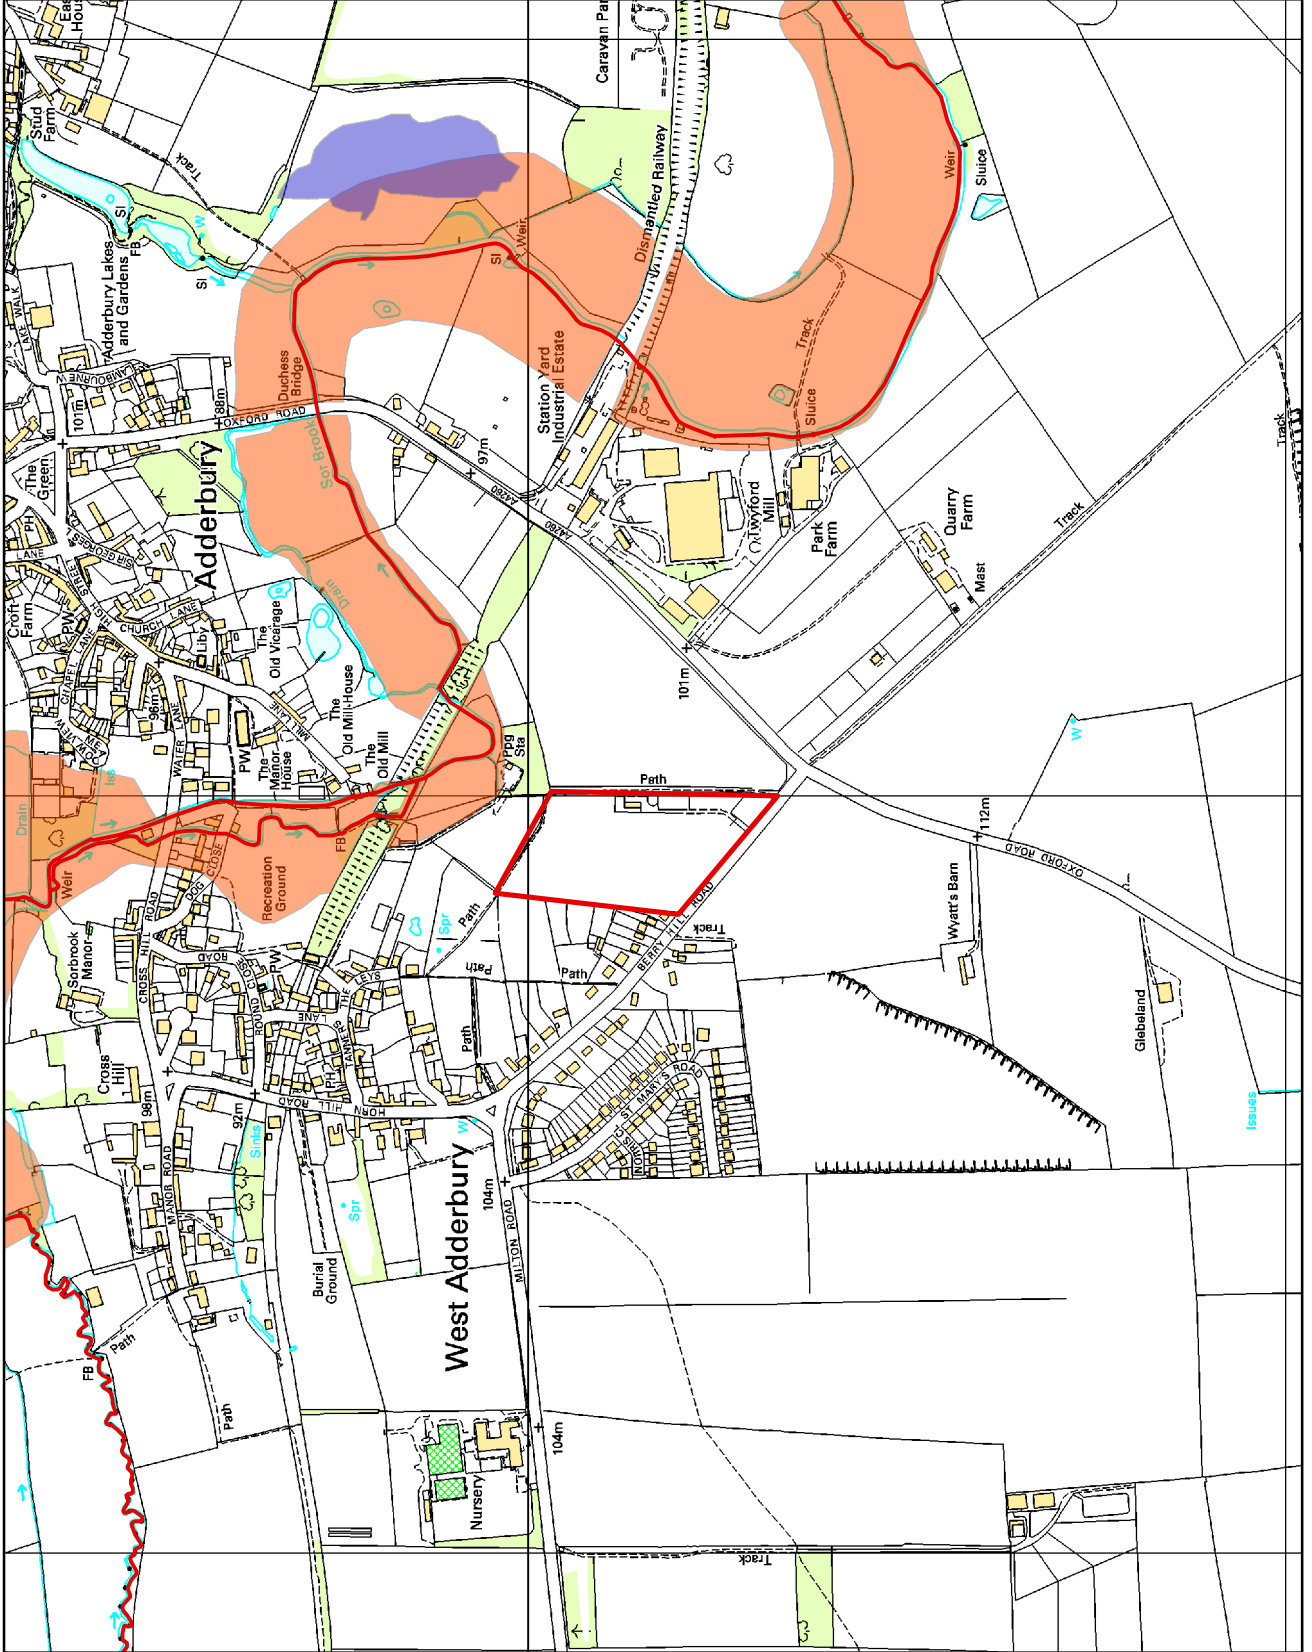

### Legend

— Main River

### Historic Flood Events

year	color/pattern
1947	White with black cross-hatch pattern
1992	Blue
1998	Orange
2002	Brown
2007	Pink
2014	Green

Flooding from rivers or sea without defences (Flood Zone 3) shows the area that could be affected by flooding:  
 - from the sea with a 1 in 200 or greater chance of happening each year  
 - or from a river with a 1 in 100 or greater chance of happening each year.

The Extent of an extreme flood (Flood Zone 2) shows the extent of an extreme flood from rivers or the sea with up to a 1 in 1000 chance of occurring each year.



This service will be closing on July 27, 2017

For more information and where the data can now be found please see the [information pages](#).

Enter a postcode or place name:

Other topics for this area...






















Groundwater

Adderbury, Oxfordshire



Groundwater

#### Map legend


<input checked="" type="checkbox"/>	Groundwater source protection zones 
	Inner zone (Zone 1)
	Inner zone - subsurface activity only (Zone 1c)
	Outer zone (Zone 2)
	Outer zone - subsurface activity only (Zone 2c)
	Total catchment (Zone 3)
	Total catchment - subsurface activity only (Zone 3c)
	Special interest (Zone 4)
<input checked="" type="checkbox"/>	BGS Aquifer Maps - Superficial Deposits Designation 
	Principal
	Secondary A
	Secondary B
	Secondary (undifferentiated)
	Unknown (lakes and landslip)
<input type="checkbox"/>	BGS Aquifer Maps - Bedrock Designation 
	Principal
	Secondary A
	Secondary B
	Secondary (undifferentiated)
<input checked="" type="checkbox"/>	Groundwater Vulnerability Zones 
<input checked="" type="checkbox"/>	Other national environmental organisations 

Adderbury, Oxfordshire at scale 1:75,000

[Other maps](#)

[Data search](#)

[Text only version](#)

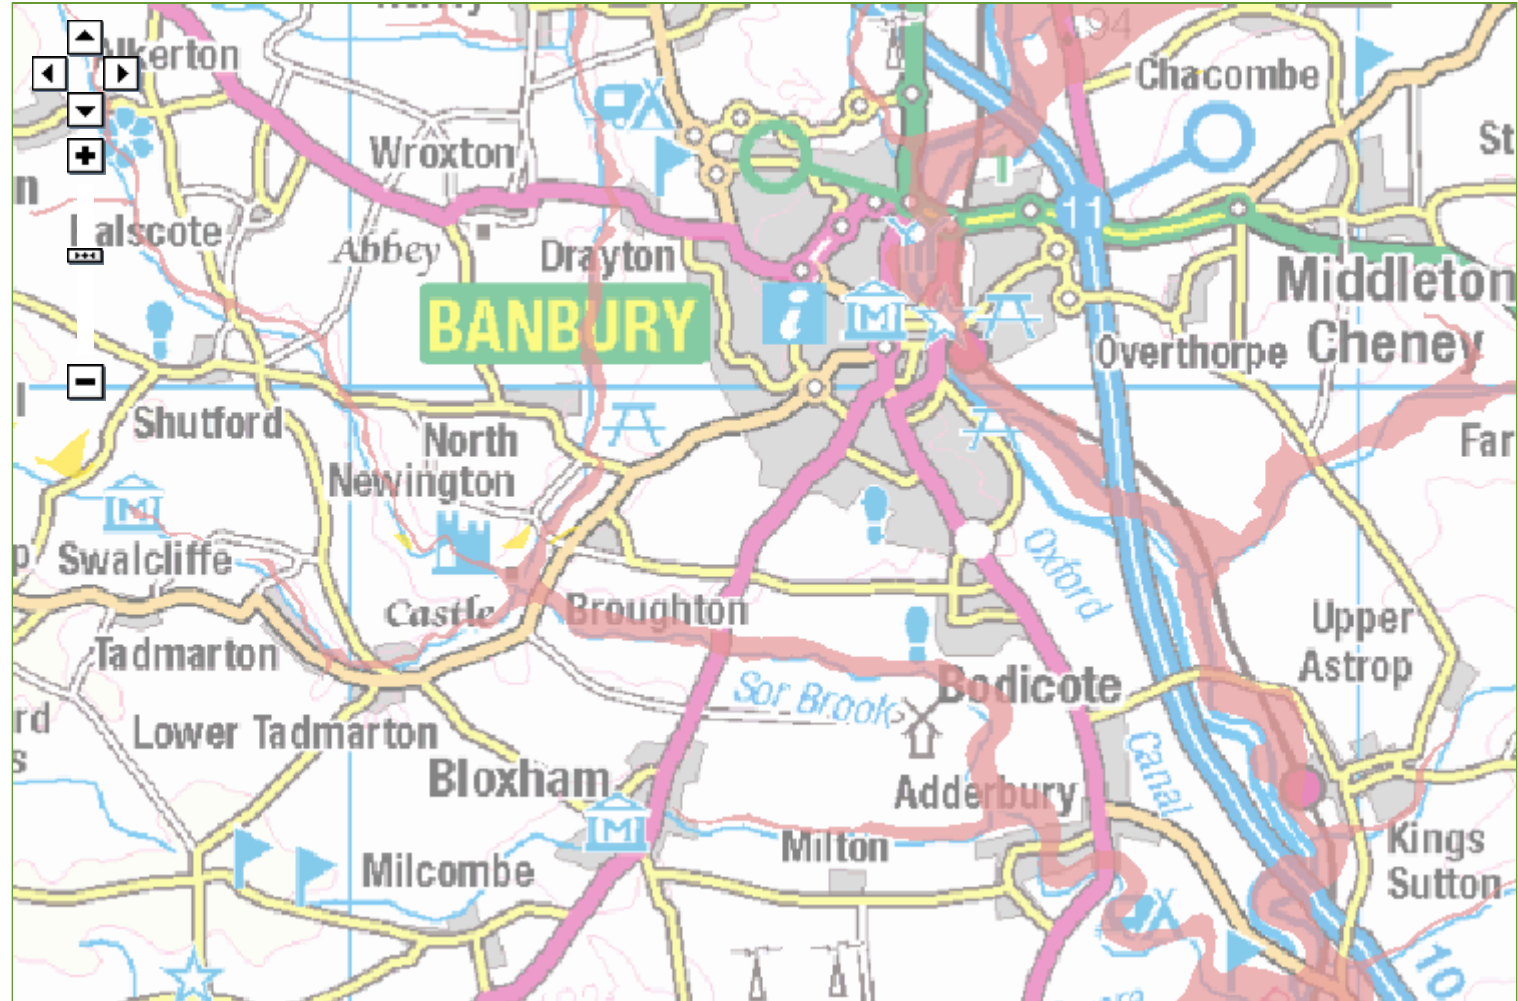

© Environment Agency copyright and database rights 2017. © Ordnance Survey Crown copyright. All rights reserved. Environment Agency, 100024198. Contains Royal Mail data © Royal Mail copyright and database right 2017.

This service is designed to inform members of the public, in line with our [terms and conditions](#). For business or commercial use, please [contact us](#).

#### More about Groundwater

##### Groundwater Source Protection Zones:

Groundwater provides a third of our drinking water. We ensure that your water is safe to drink defining Source Protection Zones. These zones help to monitor the risk of contamination from any activities that might cause pollution in the area.

The Source Protection Zones are not displayed at scales greater than 1:20,000 (Ordnance Survey 1:50,000 scale) as the data was only modelled to this level and is not accurate past this. They should not be compared against field boundaries.

[Understanding Groundwater Source Protection Zones maps](#)

##### British Geological Survey's Aquifer Maps:

From 1st April 2010 new aquifer designations replace the old system of classifying aquifers as Major, Minor and Non-Aquifer. This new system is in line with our Groundwater Protection Policy (GP3) and the Water Framework Directive (WFD) and is based on British Geological Survey mapping.

The Aquifer Extents are not displayed at scales greater than 1:75,000 (Ordnance Survey 1:250,000 scale) as the data was only modelled to this level and is not accurate past this.

[Understanding the British Geological Survey's Aquifer maps](#)

##### Groundwater Vulnerability Maps:

We are currently updating our groundwater vulnerability maps to reflect improvements in data mapping and understanding of the factors affecting vulnerability. The new maps will be released later in 2017.

The 'New groundwater vulnerability mapping methodology' report provides technical information about how the new maps have been created.

The [user guide](#) outlines the kinds of activities the new maps can be used for.

These reports have been published on [GOV.UK](#) in advance of the release of the new maps to give users time to understand the new approach and how this differs from the previous groundwater vulnerability maps.

[Understanding Groundwater Vulnerability maps](#)

This service will be closing on July 27, 2017

For more information and where the data can now be found please see the [information pages](#).

Enter a postcode or place name:

Other topics for this area...






























Groundwater

Adderbury, Oxfordshire



Groundwater

#### Map legend


<input checked="" type="checkbox"/>	Groundwater source protection zones 
	Inner zone (Zone 1)
	Inner zone - subsurface activity only (Zone 1c)
	Outer zone (Zone 2)
	Outer zone - subsurface activity only (Zone 2c)
	Total catchment (Zone 3)
	Total catchment - subsurface activity only (Zone 3c)
	Special interest (Zone 4)
<input type="checkbox"/>	BGS Aquifer Maps - Superficial Deposits Designation 
	Principal
	Secondary A
	Secondary B
	Secondary (undifferentiated)
	Unknown (lakes and landslip)
<input type="checkbox"/>	BGS Aquifer Maps - Bedrock Designation 
	Principal
	Secondary A
	Secondary B
	Secondary (undifferentiated)
<input checked="" type="checkbox"/>	Groundwater Vulnerability Zones 
	Major Aquifer High
	Major Aquifer Intermediate
	Major Aquifer Low
	Minor Aquifer High
	Minor Aquifer Intermediate
	Minor Aquifer Low
<input checked="" type="checkbox"/>	Other national environmental organisations 
	Natural Resources Wales Area of responsibility
	Scottish Environment Protection Agency Area of responsibility

Adderbury, Oxfordshire at scale 1:10,000

[Other maps](#)

[Data search](#)

[Text only version](#)

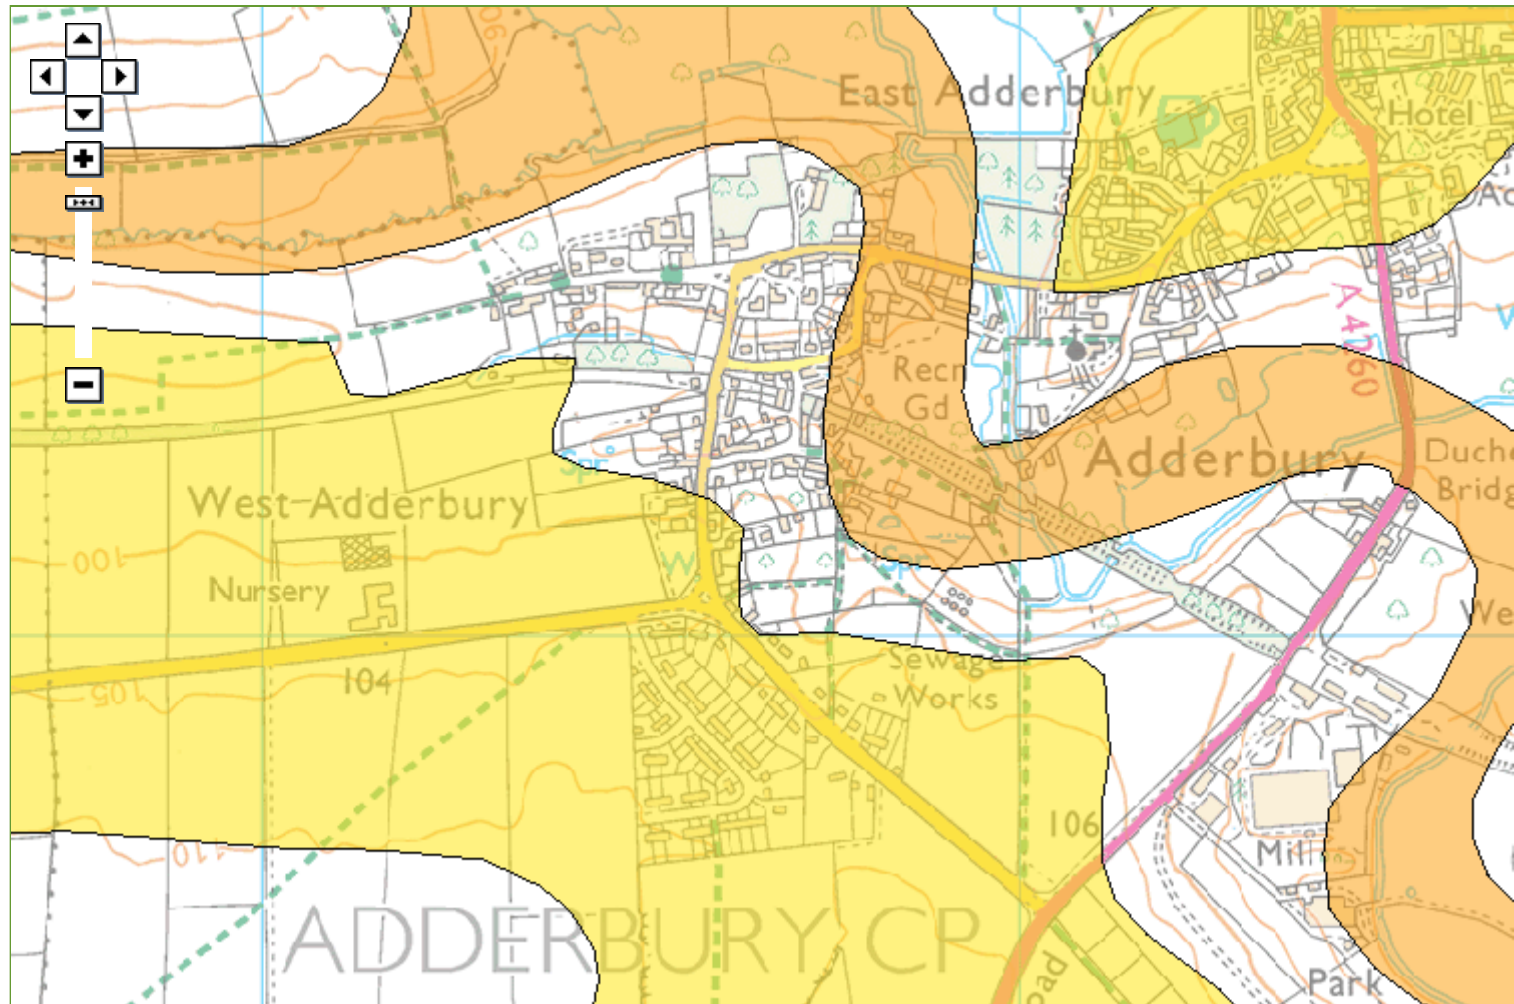

© Environment Agency copyright and database rights 2017. © Ordnance Survey Crown copyright. All rights reserved. Environment Agency, 100024198. Contains Royal Mail data © Royal Mail copyright and database right 2017.

This service is designed to inform members of the public, in line with our [terms and conditions](#). For business or commercial use, please [contact us](#).

#### More about Groundwater

##### Groundwater Source Protection Zones:

Groundwater provides a third of our drinking water. We ensure that your water is safe to drink defining Source Protection Zones. These zones help to monitor the risk of contamination from any activities that might cause pollution in the area.

The Source Protection Zones are not displayed at scales greater than 1:20,000 (Ordnance Survey 1:50,000 scale) as the data was only modelled to this level and is not accurate past this. They should not be compared against field boundaries.

[Understanding Groundwater Source Protection Zones maps](#)

##### British Geological Survey's Aquifer Maps:

From 1st April 2010 new aquifer designations replace the old system of classifying aquifers as Major, Minor and Non-Aquifer. This new system is in line with our Groundwater Protection Policy (GP3) and the Water Framework Directive (WFD) and is based on British Geological Survey mapping.

The Aquifer Extents are not displayed at scales greater than 1:75,000 (Ordnance Survey 1:250,000 scale) as the data was only modelled to this level and is not accurate past this.

[Understanding the British Geological Survey's Aquifer maps](#)

##### Groundwater Vulnerability Maps:

We are currently updating our groundwater vulnerability maps to reflect improvements in data mapping and understanding of the factors affecting vulnerability. The new maps will be released later in 2017.

The 'New groundwater vulnerability mapping methodology' report provides technical information about how the new maps have been created.

The [user guide](#) outlines the kinds of activities the new maps can be used for.

These reports have been published on [GOV.UK](#) in advance of the release of the new maps to give users time to understand the new approach and how this differs from the previous groundwater vulnerability maps.

[Understanding Groundwater Vulnerability maps](#)





This service will be closing on July 27, 2017

For more information and where the data can now be found please see the [information pages](#).

Enter a postcode or place name:

Other topics for this area...

Groundwater

Adderbury, Oxfordshire



Groundwater

#### Map legend


Adderbury, Oxfordshire at scale 1:75,000

[Other maps](#)

[Data search](#)

[Text only version](#)

<input checked="" type="checkbox"/>	Groundwater source protection zones <a href="#">i</a>
	Inner zone (Zone 1)
	Inner zone - subsurface activity only (Zone 1c)
	Outer zone (Zone 2)
	Outer zone - subsurface activity only (Zone 2c)
	Total catchment (Zone 3)
	Total catchment - subsurface activity only (Zone 3c)
	Special interest (Zone 4)
<input type="checkbox"/>	BGS Aquifer Maps - Superficial Deposits Designation <a href="#">i</a>
	Principal
	Secondary A
	Secondary B
	Secondary (undifferentiated)
	Unknown (lakes and landslip)
<input checked="" type="checkbox"/>	BGS Aquifer Maps - Bedrock Designation <a href="#">i</a>
	Principal
	Secondary A
	Secondary B
	Secondary (undifferentiated)
<input type="checkbox"/>	Groundwater Vulnerability Zones <a href="#">i</a>
<input type="checkbox"/>	Other national environmental organisations <a href="#">i</a>

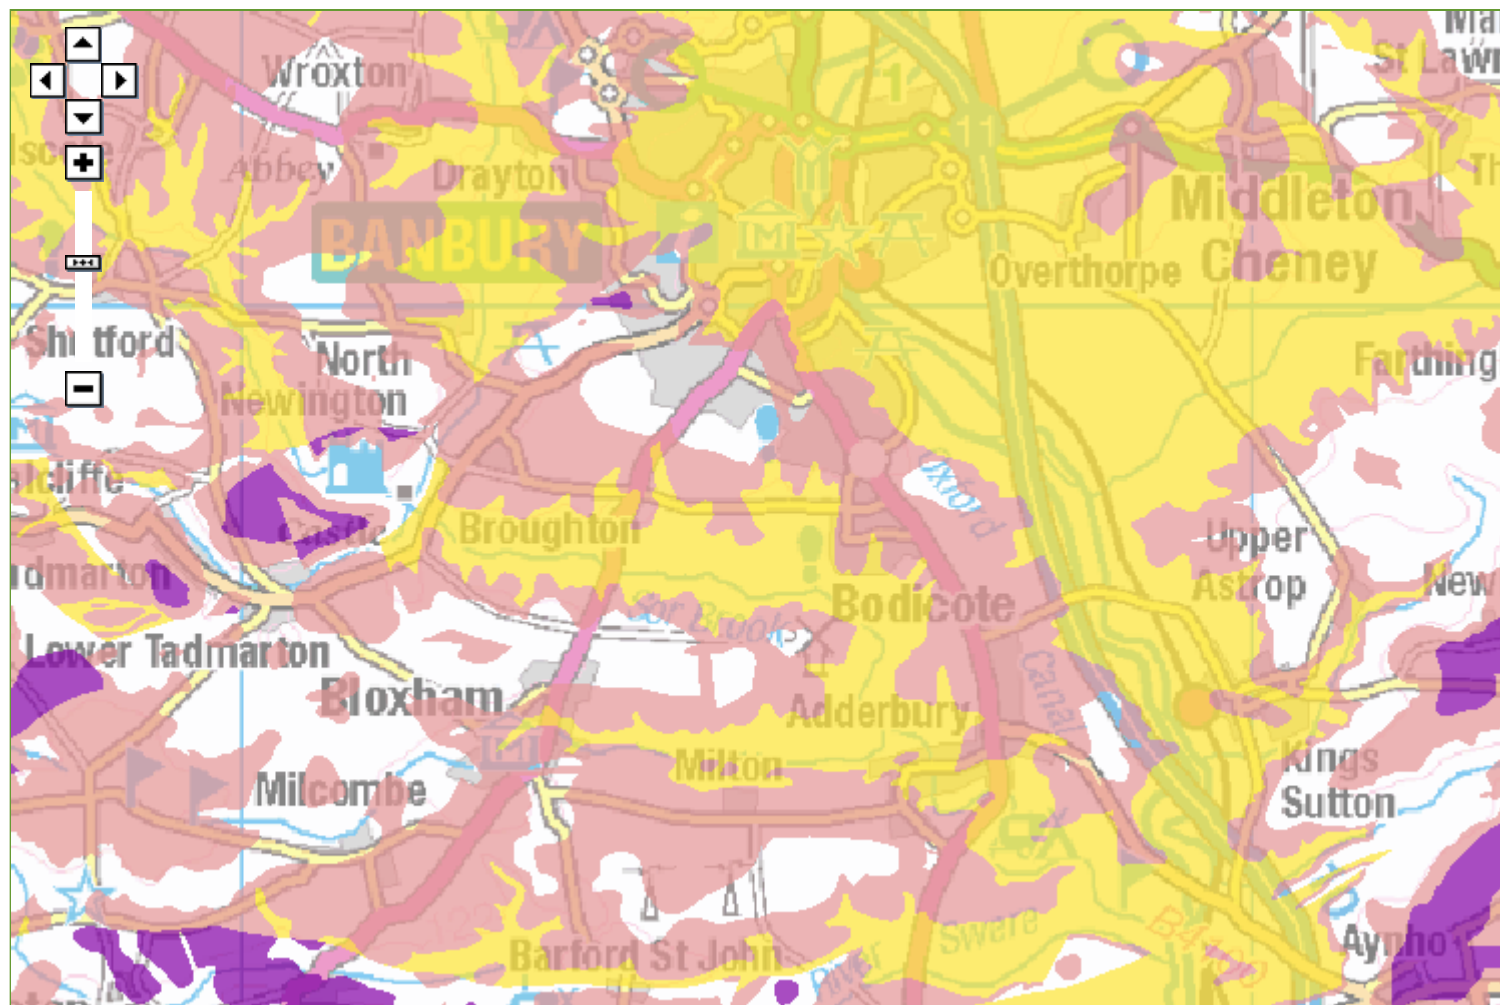

© Environment Agency copyright and database rights 2017. © Ordnance Survey Crown copyright. All rights reserved. Environment Agency, 100024198. Contains Royal Mail data © Royal Mail copyright and database right 2017.

This service is designed to inform members of the public, in line with our terms and conditions. For business or commercial use, please contact us.

#### More about Groundwater

##### Groundwater Source Protection Zones:

Groundwater provides a third of our drinking water. We ensure that your water is safe to drink defining Source Protection Zones. These zones help to monitor the risk of contamination from any activities that might cause pollution in the area.

The Source Protection Zones are not displayed at scales greater than 1:20,000 (Ordnance Survey 1:50,000 scale) as the data was only modelled to this level and is not accurate past this. They should not be compared against field boundaries.

[Understanding Groundwater Source Protection Zones maps](#)

##### British Geological Survey's Aquifer Maps:

From 1st April 2010 new aquifer designations replace the old system of classifying aquifers as Major, Minor and Non-Aquifer. This new system is in line with our Groundwater Protection Policy (GP3) and the Water Framework Directive (WFD) and is based on British Geological Survey mapping.

The Aquifer Extents are not displayed at scales greater than 1:75,000 (Ordnance Survey 1:250,000 scale) as the data was only modelled to this level and is not accurate past this.

[Understanding the British Geological Survey's Aquifer maps](#)

##### Groundwater Vulnerability Maps:

We are currently updating our groundwater vulnerability maps to reflect improvements in data mapping and understanding of the factors affecting vulnerability. The new maps will be released later in 2017.


The 'New groundwater vulnerability mapping methodology' report provides technical information about how the new maps have been created.

The [user guide](#) outlines the kinds of activities the new maps can be used for.


These reports have been published on [GOV.UK](#) in advance of the release of the new maps to give users time to understand the new approach and how this differs from the previous groundwater vulnerability maps.

[Understanding Groundwater Vulnerability maps](#)

## Flood Map for Planning

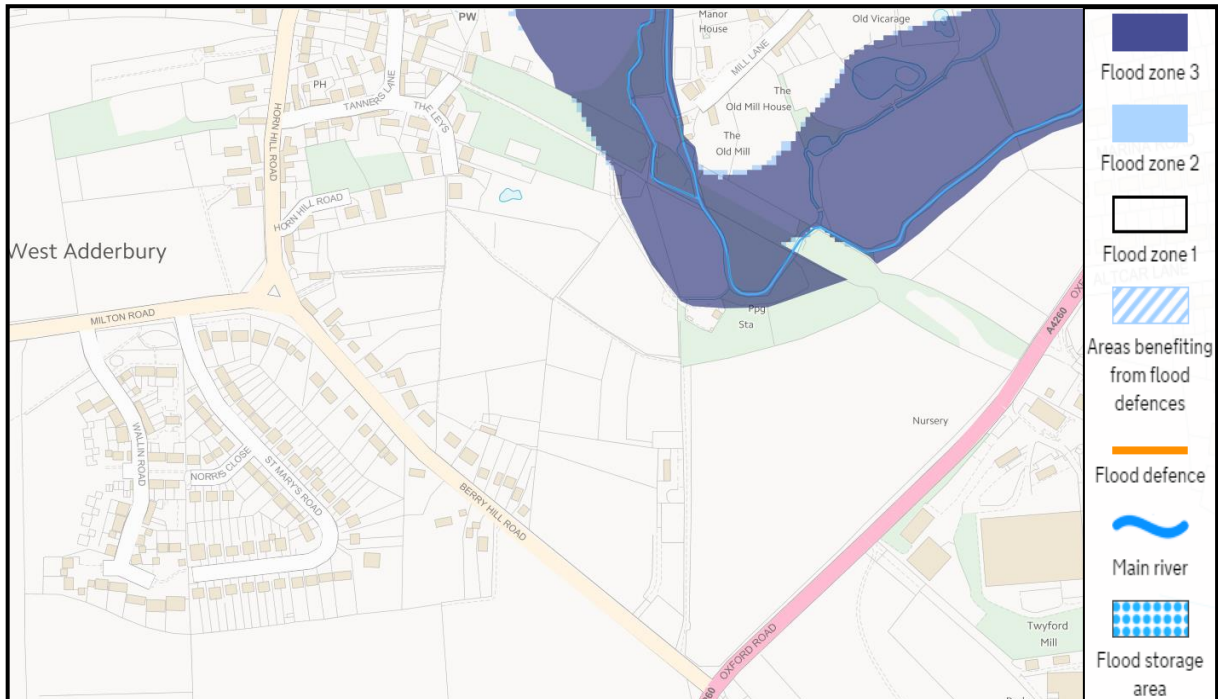


## Long Term Flood Risk - Rivers or Sea

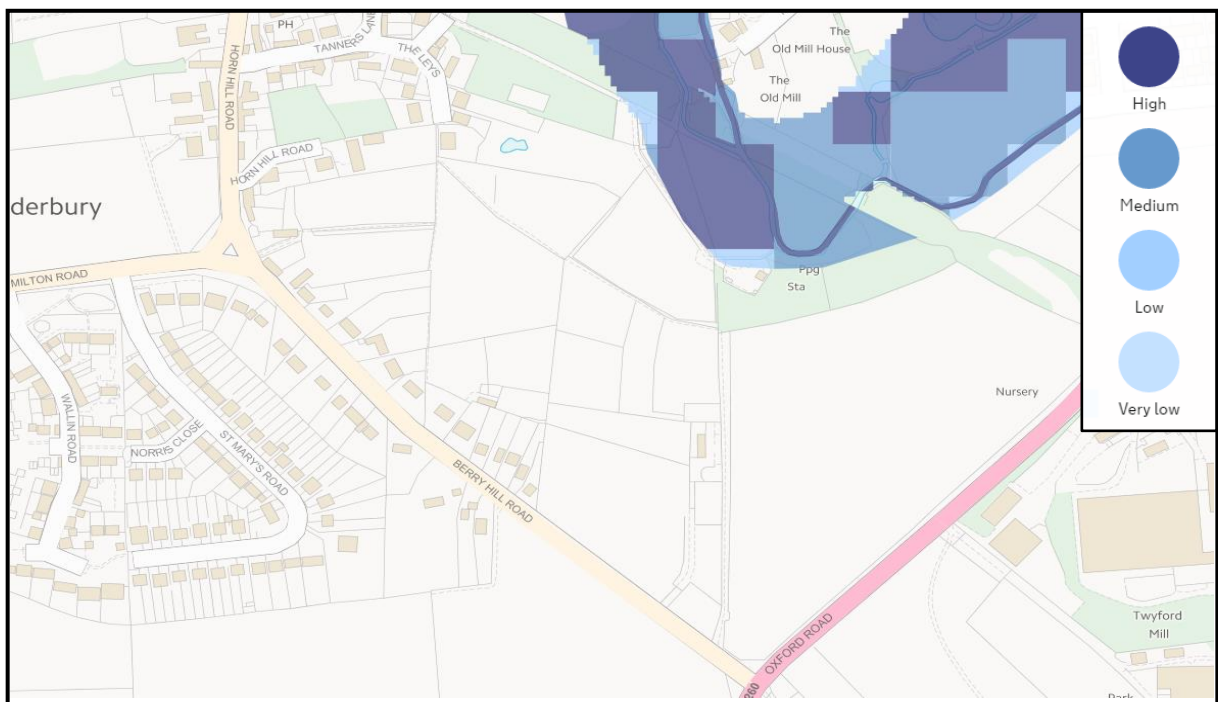




## Long Term Flood Risk - Surface Water

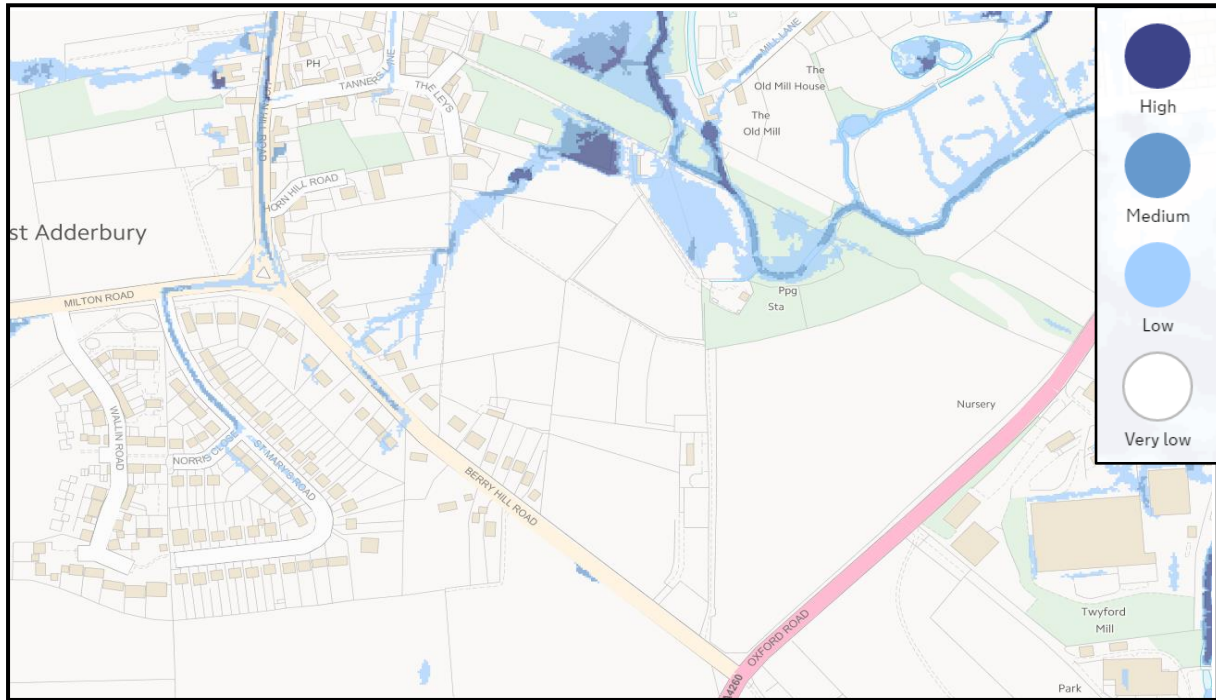

## Long Term Flood Risk - Reservoirs

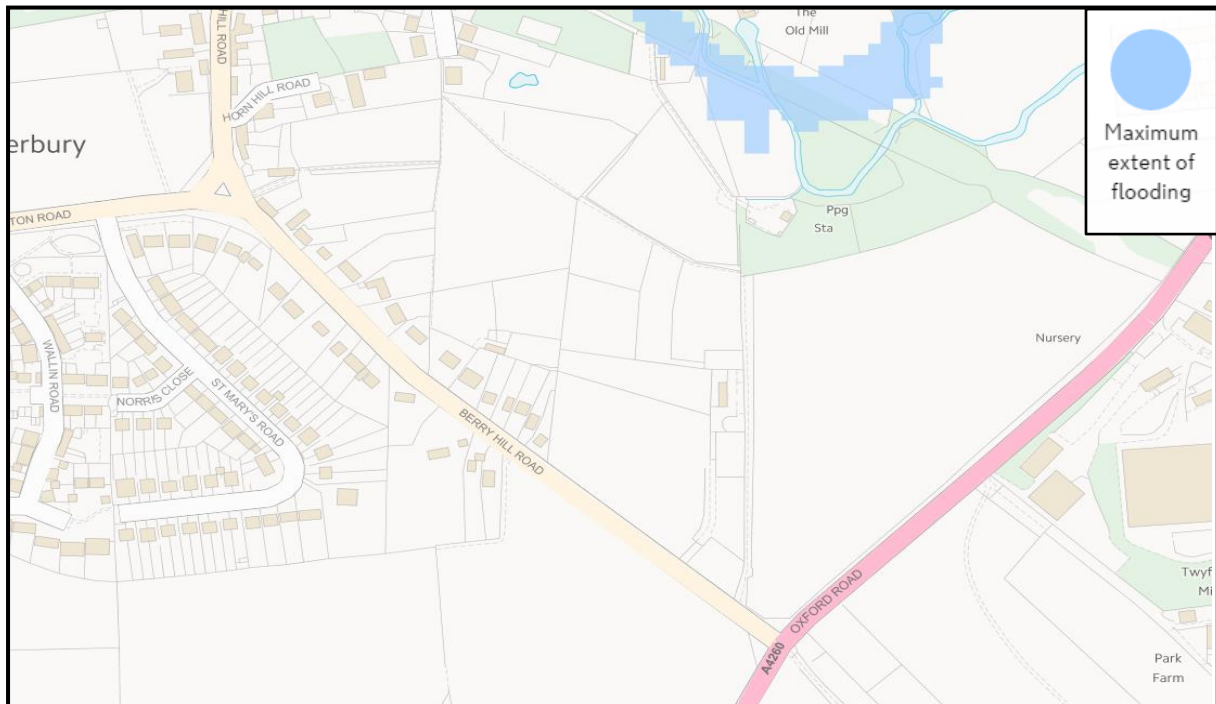

## **APPENDIX C: TW CORRESPONDENCE**

---

This page has been left intentionally blank

## Patrick Taylor

---

**From:** Patrick Taylor  
**Sent:** 22 June 2017 14:59  
**To:** 'DEVELOPER.SERVICES@THAMESWATER.CO.UK'  
**Subject:** FRA ADVICE: BERRY HILL ROAD, ADDERBURY  
**Attachments:** HYD250 Location Plan.pdf

To whom it may concern,

### ***BERRY HILL ROAD, ADDERBURY.***

Please could you confirm whether you have any information that you feel would be valuable to a Flood Risk Assessment for the above site (location plan attached), including details of historical flooding and water levels; this would be greatly appreciated. Please do not hesitate to contact me on the details below to discuss further should you require additional information or clarification.

Kind Regards

**Patrick Taylor** BSc(Hons)  
*Graduate Flood Risk Analyst*

### **BETTS HYDRO**

*Specialists in Drainage and Flood Risk*

Old Marsh Farm Barns, Welsh Road, Sealand, Flintshire, CH5 2LY

CHESTER OFFICE - 01244 289041

[patricktaylor@betts-associates.co.uk](mailto:patricktaylor@betts-associates.co.uk)

[www.betts-associates.co.uk](http://www.betts-associates.co.uk)

CIVIL | STRUCTURAL | GEO-ENVIRONMENTAL | HYDROLOGY | FLOOD RISK MANAGEMENT  
SUDS | STRUCTURAL SURVEYS | PARTY WALL DUTIES | INFILTRATION | GEO-TECHNICAL




Please consider the environment before printing this email.

#### ELECTRONICALLY TRANSMITTED INFORMATION

This electronic transmission is strictly confidential and intended solely for the addressee. It may contain information which is covered by legal, professional or other privilege. If you are not the intended addressee, you must not disclose, copy or take any action in reliance of this transmission. If you have received this transmission in error, please notify us as soon as possible. All emails transmitted by Betts Associates, Betts Geo or Betts Hydro are virus checked. This does not guarantee that transmissions are virus free. Reference should always be made to the hard copy of any electronically transmitted files. Electronic data does not constitute contract documentation. Use of the content of our files is at your own risk. You remain responsible for anything produced using all or part of the data supplied

Asset Location Search Sewer Map - ALS/ALS/24/2017\_3599711

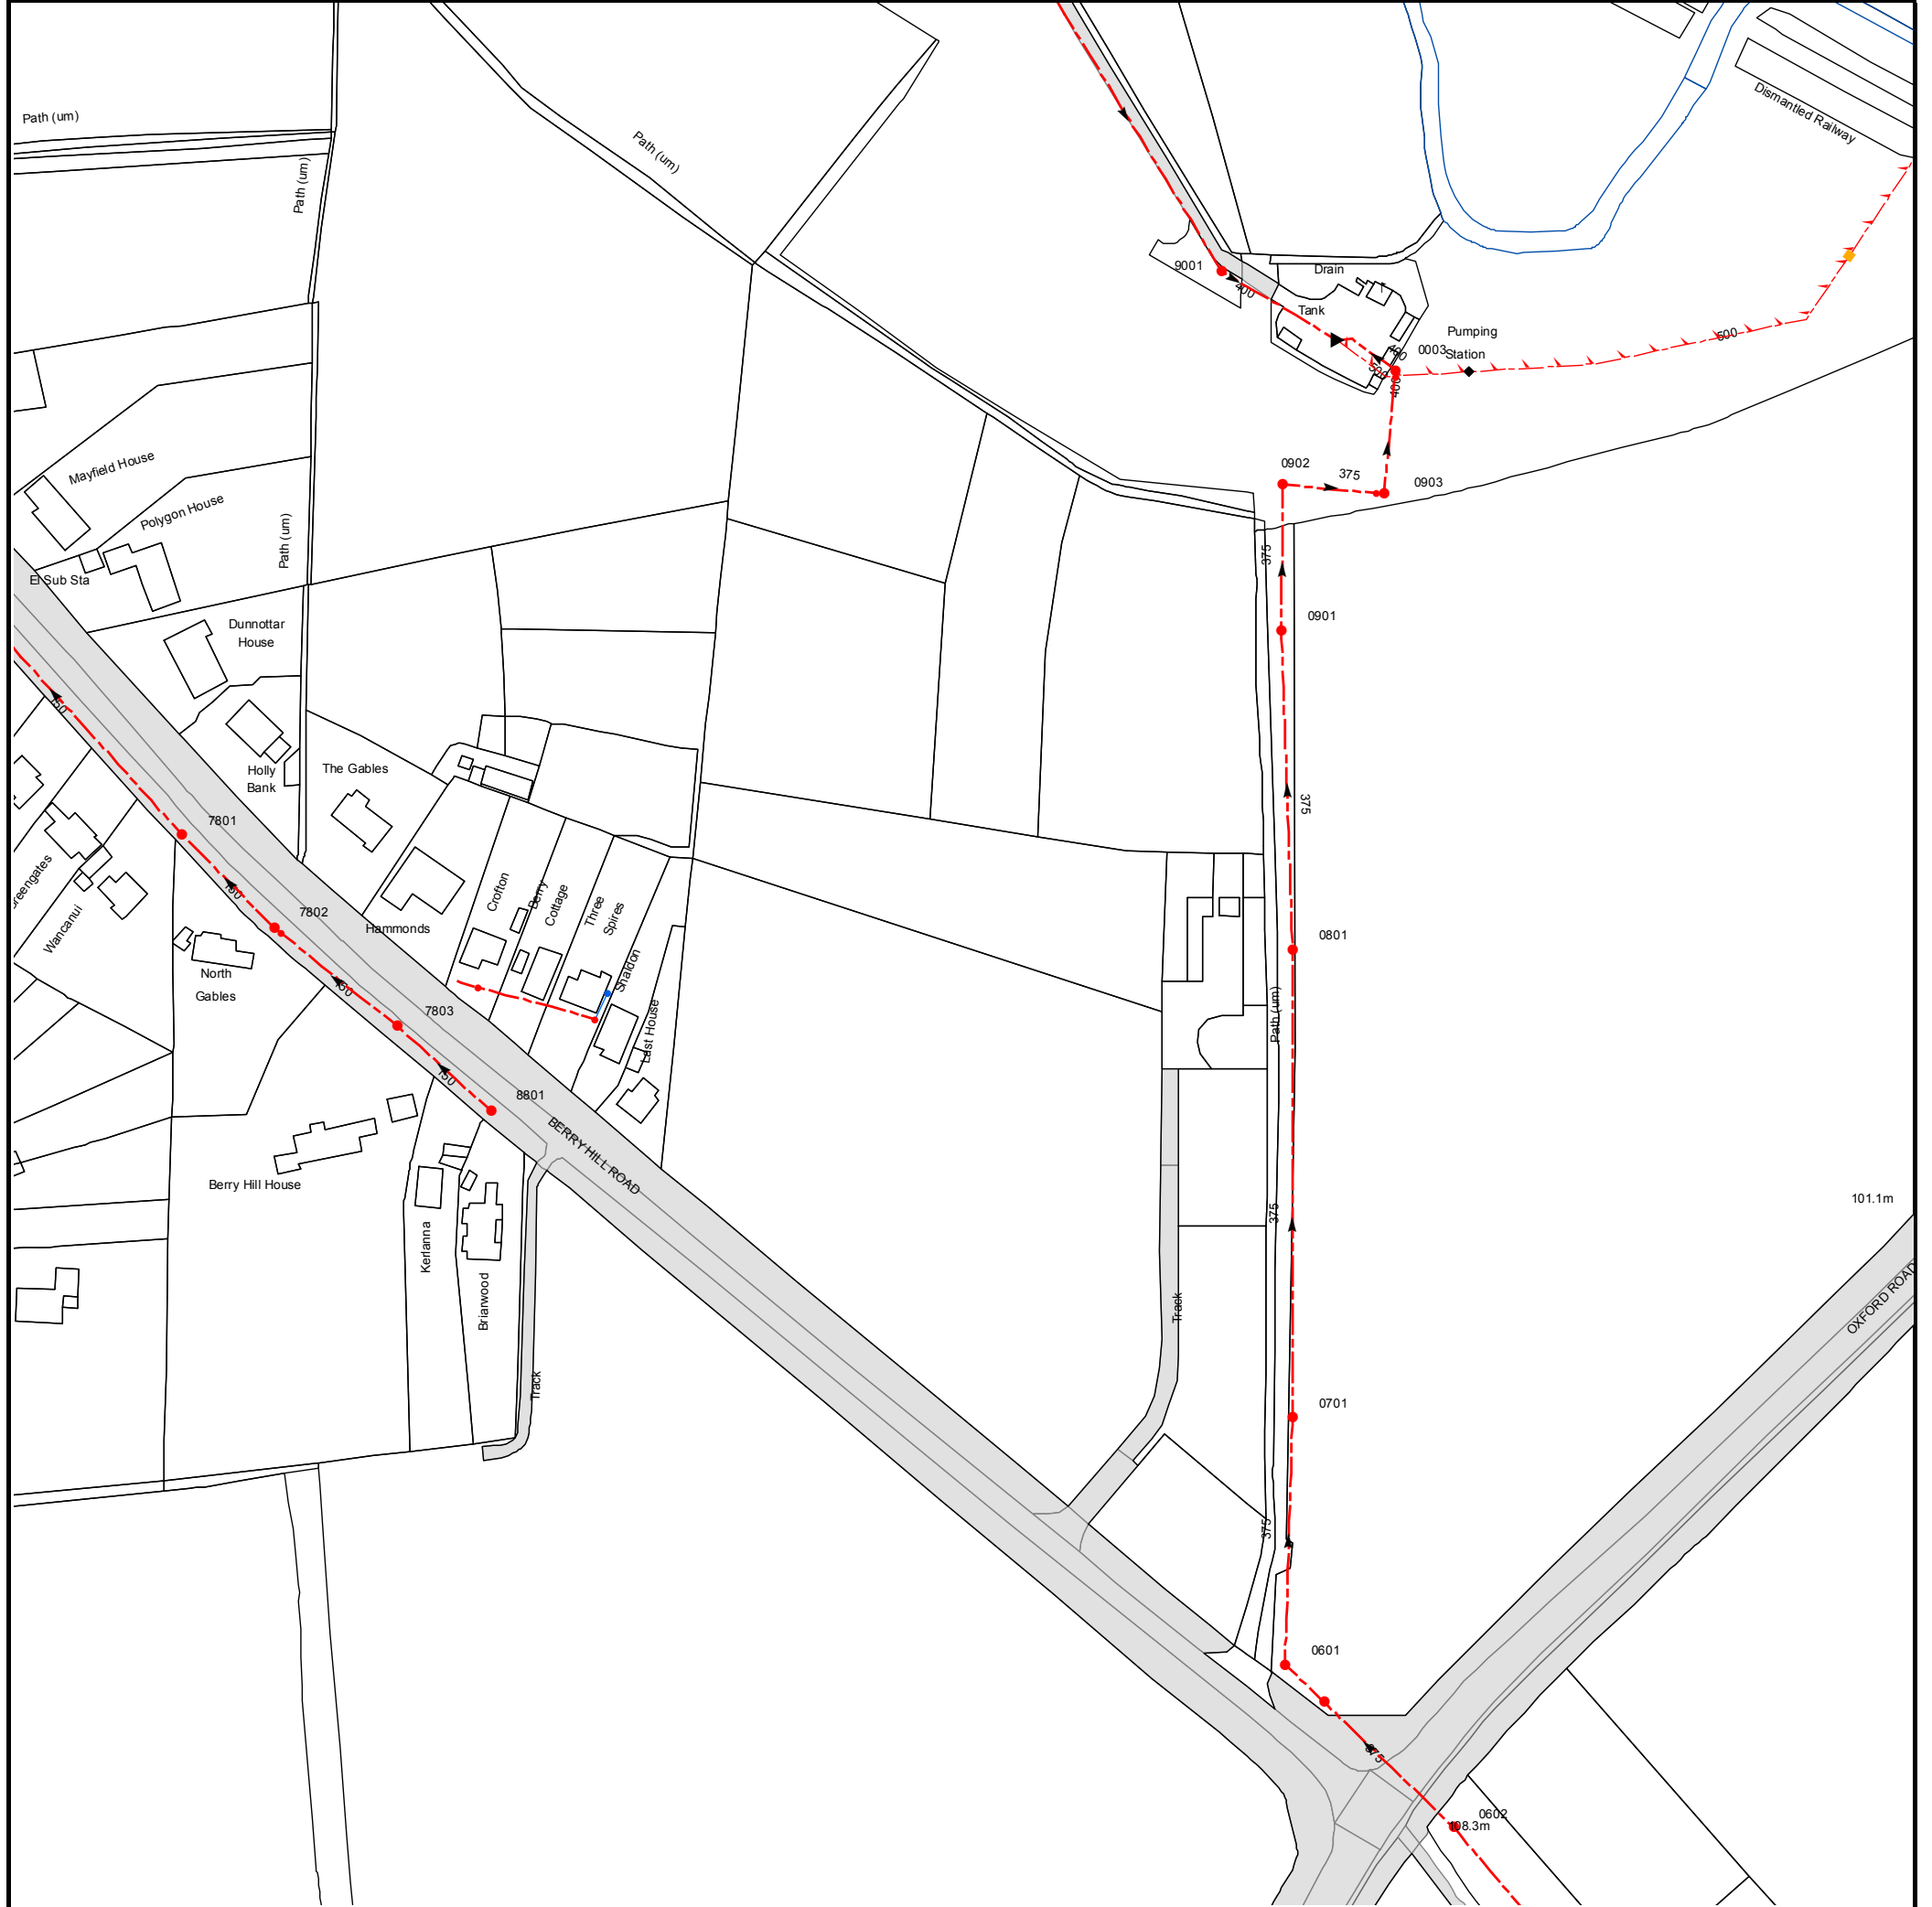

The width of the displayed area is 500 m and the centre of the map is located at OS coordinates 446926,234859

The position of the apparatus shown on this plan is given without obligation and warranty, and the accuracy cannot be guaranteed. Service pipes are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Thames Water for any error or omission. The actual position of mains and services must be verified and established on site before any works are undertaken.

Based on the Ordnance Survey Map with the Sanction of the controller of H.M. Stationery Office, License no. 100019345 Crown Copyright Reserved.



This page has been left intentionally blank

## **APPENDIX D: LPA/LLFA CORRESPONDENCE**

---

This page has been left intentionally blank

## Patrick Taylor

---

**From:** Patrick Taylor  
**Sent:** 22 June 2017 11:45  
**To:** 'foi@oxfordshire.gov.uk'  
**Subject:** FRA ADVICE: BERRY HILL ROAD, ADDERBURY  
**Attachments:** HYD250 Location Plan.pdf

To whom it may concern,

### ***BERRY HILL ROAD, ADDERBURY.***

Please could you confirm whether you have any information that you feel would be valuable to a Flood Risk Assessment for the above site (location plan attached), including details of historical flooding and water levels(PRODUCT 4); this would be greatly appreciated. Please do not hesitate to contact me on the details below to discuss further should you require additional information or clarification.

Kind Regards

**Patrick Taylor** BSc(Hons)  
*Graduate Flood Risk Analyst*

### **BETTS HYDRO**

*Specialists in Drainage and Flood Risk*

Old Marsh Farm Barns, Welsh Road, Sealand, Flintshire, CH5 2LY

CHESTER OFFICE - 01244 289041

[patricktaylor@betts-associates.co.uk](mailto:patricktaylor@betts-associates.co.uk)

[www.betts-associates.co.uk](http://www.betts-associates.co.uk)

CIVIL | STRUCTURAL | GEO-ENVIRONMENTAL | HYDROLOGY | FLOOD RISK MANAGEMENT  
SUDS | STRUCTURAL SURVEYS | PARTY WALL DUTIES | INFILTRATION | GEO-TECHNICAL



Please consider the environment before printing this email.

#### ELECTRONICALLY TRANSMITTED INFORMATION

This electronic transmission is strictly confidential and intended solely for the addressee. It may contain information which is covered by legal, professional or other privilege. If you are not the intended addressee, you must not disclose, copy or take any action in reliance of this transmission. If you have received this transmission in error, please notify us as soon as possible. All emails transmitted by Betts Associates, Betts Geo or Betts Hydro are virus checked. This does not guarantee that transmissions are virus free. Reference should always be made to the hard copy of any electronically transmitted files. Electronic data does not constitute contract documentation. Use of the content of our files is at your own risk. You remain responsible for anything produced using all or part of the data supplied

## Patrick Taylor

---

**From:** FOI - E&E <FOI-E&E@Oxfordshire.gov.uk>  
**Sent:** 12 July 2017 16:43  
**To:** Patrick Taylor  
**Cc:** FOI - E&E  
**Subject:** 1231 EIR - Berry Hill Road, Adderbury  
**Attachments:** 12131 EIR - Berry Hill Road Adderbury.pdf

Dear Mr Taylor,

Please find attached our response to your Environmental Information Request.

Kind Regards

E&E FOI/EIR Co-ordinators

This email, including attachments, may contain confidential information. If you have received it in error, please notify the sender by reply and delete it immediately. Views expressed by the sender may not be those of Oxfordshire County Council. Council emails are subject to the Freedom of Information Act 2000.  
<http://www.oxfordshire.gov.uk/emaildisclaimer>.

**Our reference: 12131 EIR**

12 July 2017

Dear Mr Taylor,

Thank you for your request of 22 June 2017 in which you asked for the following information. Please find our response below in bold:

***BERRY HILL ROAD, ADDERBURY.***

Please could you confirm whether you have any information that you feel would be valuable to a Flood Risk Assessment for the above site (location plan attached), including details of historical flooding and water levels(PRODUCT 4); this would be greatly appreciated. Please do not hesitate to contact me on the details below to discuss further should you require additional information or clarification.

**Oxfordshire County Council as Lead local Flood Authority has now set up a Flood Tool Kit on our website that provides information for developers regarding Flood Risk Assessments. The attached link directs you to the Flood Tool Kit that contains the information that we hold as well as links to other bodies e.g. the Environment Agency and the District Councils for further information relating to flood events and flood zone maps.**

**<https://www.oxfordshirefloodtoolkit.com/>**

Internal review

If you are dissatisfied with the service or response to your request you can ask for an internal review as follows:

- Contact the Complaints & Freedom of Information team in Law & Governance : [foi@oxfordshire.gov.uk](mailto:foi@oxfordshire.gov.uk)
- Use the online complaints form on our website: [www.oxfordshire.gov.uk/complaints](http://www.oxfordshire.gov.uk/complaints)
- Write to the Complaints & Freedom of Information team at the FREEPOST address:

Corporate Complaints Team  
Oxfordshire County Council  
FREEPOST (RTLL-ECKS-GLUA)  
Oxford OX1 1YA


If you remain dissatisfied with the handling of your request or complaint, you have a right to appeal to the Information Commissioner at:

The Information Commissioner's Office, Wycliffe House, Water Lane, Wilmslow, Cheshire, SK9 5AF.

Telephone: 0303 123 1113 Website: <https://ico.org.uk>

Please let me know if you have further enquiries. I would be grateful if you could use the reference number given at the top of this email.

Yours sincerely



Hugh Potter  
Team Leader – Area Operations Hub  
Communities  
Oxfordshire County Council  
Email: [hugh.potter@oxfordshire.gov.uk](mailto:hugh.potter@oxfordshire.gov.uk)  
[www.oxfordshire.gov.uk](http://www.oxfordshire.gov.uk)



## Patrick Taylor

---

**From:** Patrick Taylor  
**Sent:** 22 June 2017 11:39  
**To:** 'customer.service@cherwell-dc.gov.uk'  
**Subject:** FRA ADVICE: BERRY HILL ROAD, ADDERBURY  
**Attachments:** HYD250 Location Plan.pdf

To whom it may concern,

### ***BERRY HILL ROAD, ADDERBURY.***

Please could you confirm whether you have any information that you feel would be valuable to a Flood Risk Assessment for the above site (location plan attached), including details of historical flooding and water levels(PRODUCT 4); this would be greatly appreciated. Please do not hesitate to contact me on the details below to discuss further should you require additional information or clarification.

Kind Regards

**Patrick Taylor** BSc(Hons)  
*Graduate Flood Risk Analyst*

### **BETTS HYDRO**

*Specialists in Drainage and Flood Risk*

Old Marsh Farm Barns, Welsh Road, Sealand, Flintshire, CH5 2LY

CHESTER OFFICE - 01244 289041

[patricktaylor@betts-associates.co.uk](mailto:patricktaylor@betts-associates.co.uk)

[www.betts-associates.co.uk](http://www.betts-associates.co.uk)

CIVIL | STRUCTURAL | GEO-ENVIRONMENTAL | HYDROLOGY | FLOOD RISK MANAGEMENT  
SUDS | STRUCTURAL SURVEYS | PARTY WALL DUTIES | INFILTRATION | GEO-TECHNICAL



Please consider the environment before printing this email.

#### ELECTRONICALLY TRANSMITTED INFORMATION

This electronic transmission is strictly confidential and intended solely for the addressee. It may contain information which is covered by legal, professional or other privilege. If you are not the intended addressee, you must not disclose, copy or take any action in reliance of this transmission. If you have received this transmission in error, please notify us as soon as possible. All emails transmitted by Betts Associates, Betts Geo or Betts Hydro are virus checked. This does not guarantee that transmissions are virus free. Reference should always be made to the hard copy of any electronically transmitted files. Electronic data does not constitute contract documentation. Use of the content of our files is at your own risk. You remain responsible for anything produced using all or part of the data supplied


## **APPENDIX E: LOCATION PLAN**

---

This page has been left intentionally blank

## Location Plan

BERRY HILL ROAD, ADDERBURY.

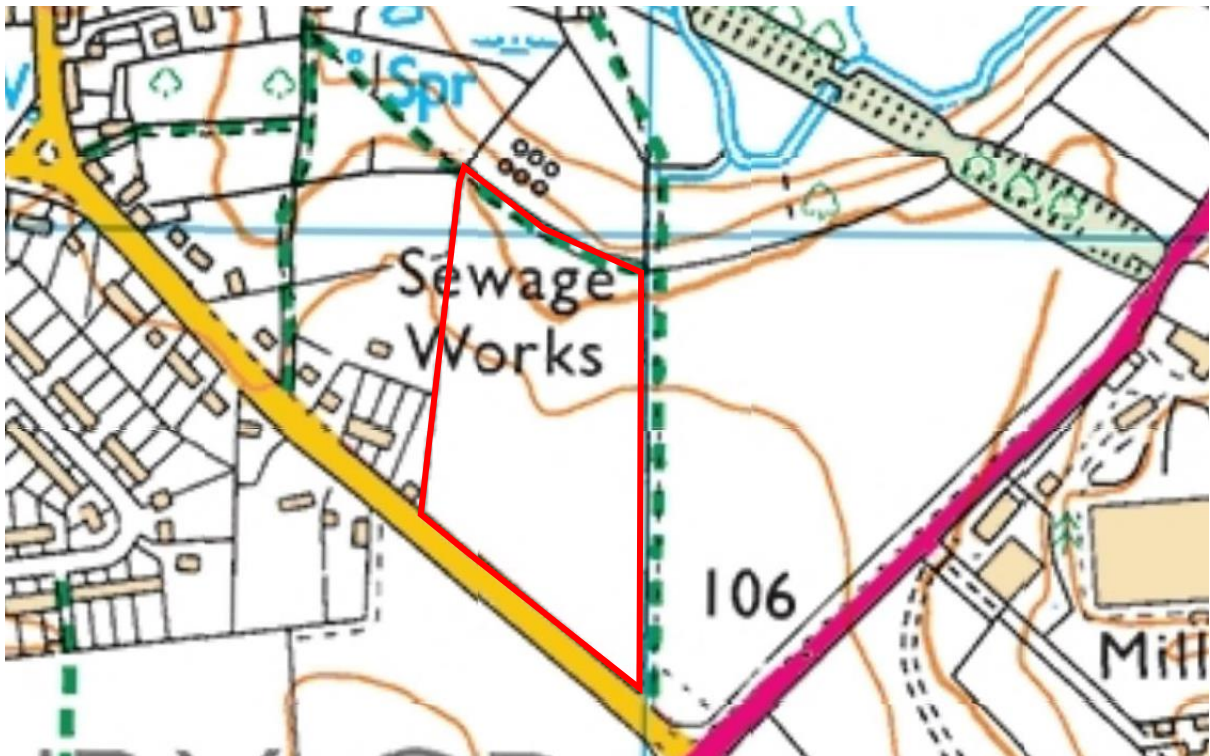

OS X (Eastings)	446877
OS Y (Northings)	234796
Nearest Post Code	OX17 3HF
Lat (WGS84)	N52:00:35 (52.009624)
Long (WGS84)	W1:19:06 (-1.318446)
Lat, Long	52.009624, -1.318446
Nat Grid	SP468347 / SP4687734796
mX	-146768
mY	6768168

## **APPENDIX F: TOPOGRAPHIC SURVEY**

---

This page has been left intentionally blank





## **APPENDIX G: PLANNING LAYOUT**

---

This page has been left intentionally blank





Berry Hill Road, Adderbury - Site Plan - Rev E



Architectural  
Design  
Consultants


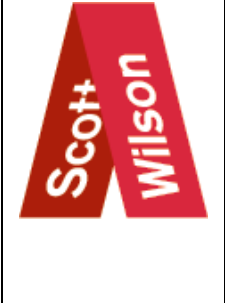



## **APPENDIX H: PFRA/SFRA INFORMATION**

---


This page has been left intentionally blank

# Cherwell District Council: Level 1 SFRA

		<p>Potential LDF Village Cluster: <b>Adderbury</b></p>
<p>Potential LDF Categorisation: <b>Type A</b></p>	<p>Existing NSCLP Categorisation: <b>Category 1</b></p>	<p>Potential LDF Categorisation: <b>Adderbury</b></p>
<p><b>Preliminary Core Strategy Assessment</b></p>		
<p><b>Flood Zone</b></p>	<p>The majority of development sites are located in Flood Zone 1. Development to the east may be affected by Flood Zones 2 and 3 associated with Sor Brook.</p>	
<p><b>Data Information</b></p>	<p>The SFRA will inform the preparation of the LDF. The current planning policy framework for the settlement as contained in the Non-Statutory Cherwell Local Plan (NSCLP) 2011 is set out below. The existing policy framework for the settlement, including the potential for housing and employment allocations, is being reviewed through the preparation of the Core Strategy and Delivery DPDs. This review includes the possibility of clustering some settlements in recognition of existing and potential linkages between villages.</p>	
<p><b>Potential Housing Allocation</b></p>	<p>The NSCLP identifies Adderbury as a Category 1 village. Policy H15 of the NSCLP states that residential development in Category 1 villages is restricted to i) infilling, ii) minor development comprising small groups of dwellings on sites within the built up area of the village and iii) the conversion of non-residential buildings in accordance with Policy H22.</p>	
<p><b>Potential Employment Allocation</b></p>	<p>The NSCLP identifies Adderbury as a Category 1 village, considered to be one of the more sustainable locations in the rural areas. New site proposals for small scale development generating employment will only be permitted subject to NSCLP Policy EMP3 i.e. the proposal must be carried out without detriment to local environment; it must not give rise to excessive traffic and must either be for small firms or those whose markets make the location necessary.</p>	
<p><b>Main River</b></p>	<p>Sor Brook flows through the centre of Adderbury in a south easterly direction. Approximately 1.5km to the east of Adderbury, the River Cherwell flows in a southerly direction, forming the eastern parish boundary. The Oxford canal runs parallel to the River Cherwell on its western bank.  The River Swere forms the southern boundary of the parish. To the north of West Adderbury, Bloxham Brook converges with Sor Brook.</p>	
<p><b>Flood Record Information</b></p>	<p>Eleven properties in Adderbury experienced flooding in July 2007. These were located in Dog Close adjacent Sor Brook. The Parish Council are currently researching flood mitigation measures through consultation with the EA.</p>	
<p>N.B. Flood Zones at this location are derived from EA National Generalised Hydraulic Modelling.</p>		
<p>This map is reproduced from Ordnance Survey material with the permission of Ordnance Survey on behalf of the Controller of Her Majesty's Stationary Office © Crown Copyright. Unauthorised reproduction infringes Crown Copyright and may lead to prosecution or civil proceedings. (LA 100024316). 2008. © Environment Agency copyright. All rights reserved 2008.</p>		

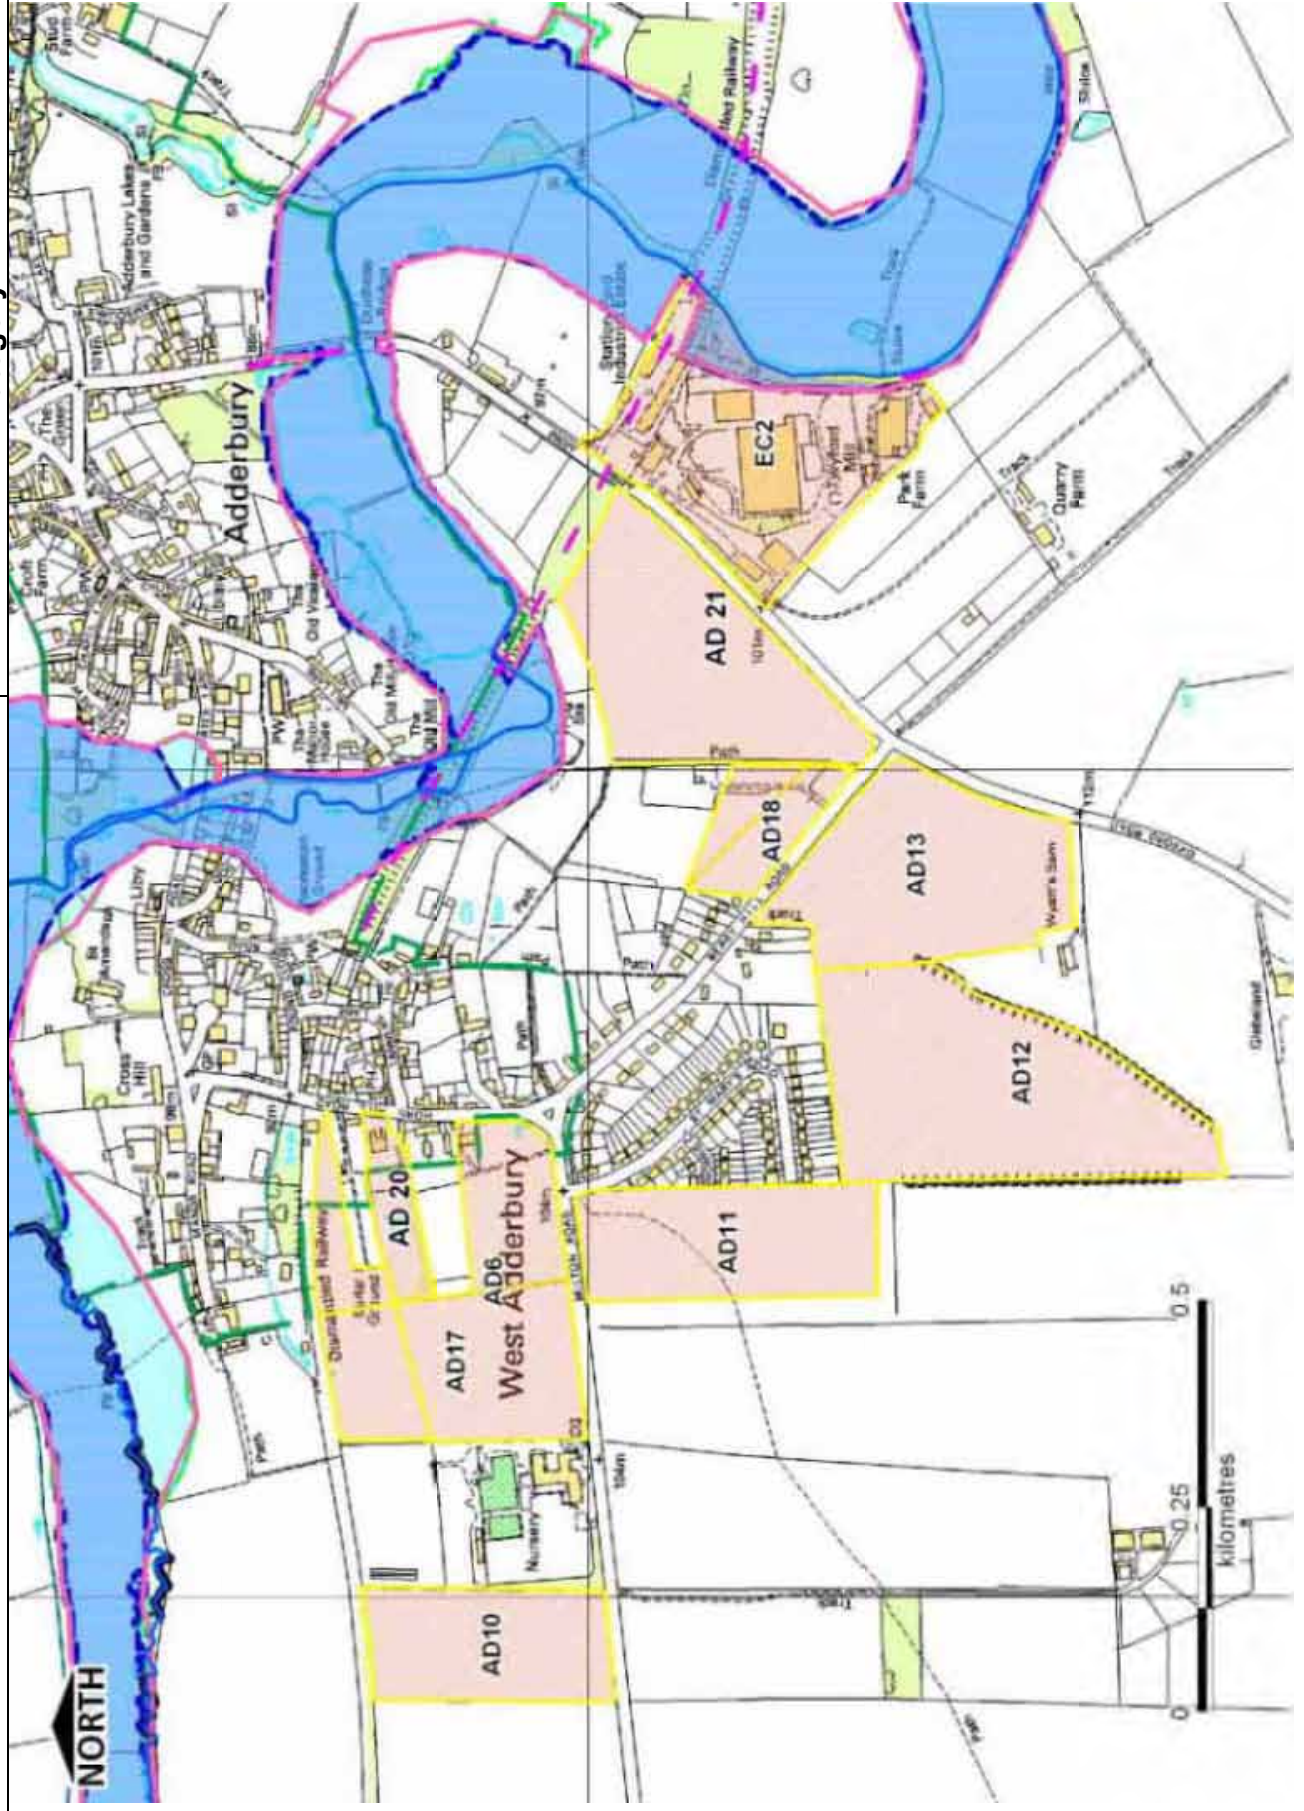



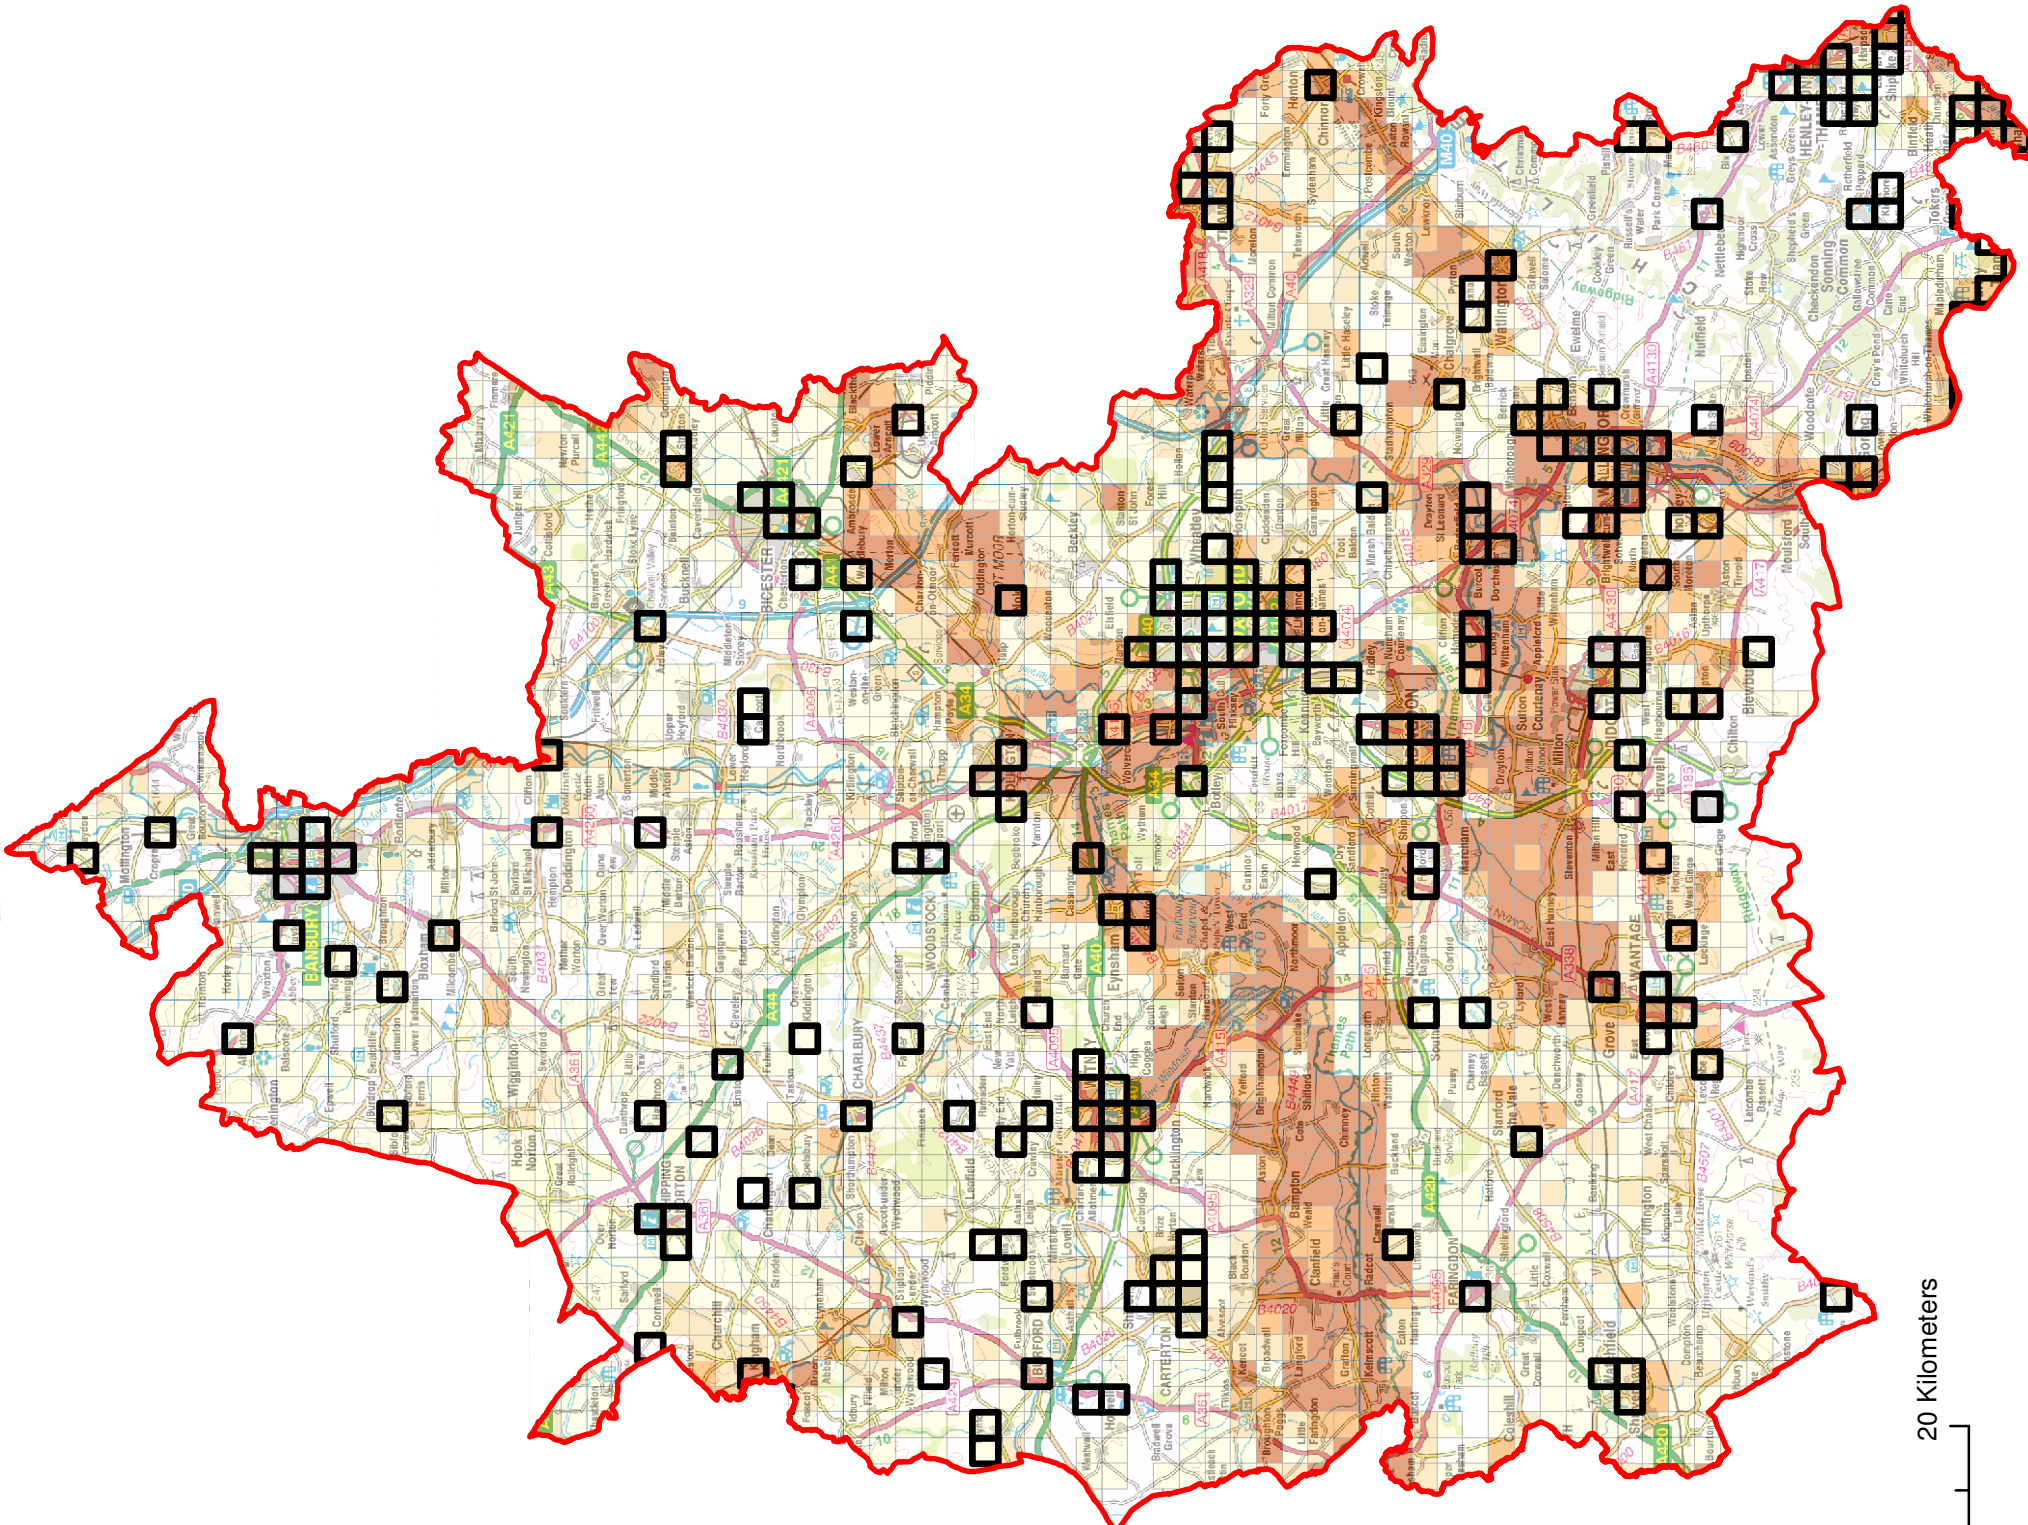

**Legend**

□ Surface water hotspots

Areas Susceptible to Groundwater Flooding

- >= 75%
- >= 50% < 75%
- >= 25% < 50%
- < 25%

Proportion of each 1km square that is susceptible to groundwater emergence

© Crown Copyright and database rights 2011 100023343  
© Environment Agency



Crowmarsh Battle Barns  
100 Preston Crowmarsh  
Wallingford  
OX10 6SL  
www.jbaconsulting.co.uk  
t +44 (0)1491 836688  
f +44 (0)870 0519307  
e info@jbaconsulting.co.uk

Other offices at Atherton, Doncaster, Edinburgh, Haywards Heath, Limerick, Newcastle upon Tyne, Newport, Northallerton, Salford, Skipton & Tadcaster

for

**OXFORDSHIRE COUNTY COUNCIL**

**PRELIMINARY FLOOD RISK ASSESSMENT**

**Map 7: Areas Susceptible to Groundwater Flooding**


This document is the property of Jeremy Bern Associates Ltd. It shall not be reproduced in whole or in part, nor disclosed to a third party, without the permission of Jeremy Bern Associates

Drawn by: AB  
Date: 09/06/2011  
Status: FINAL  
File Name: N/A

Scale: Not to scale

Drawing Number: Map 7



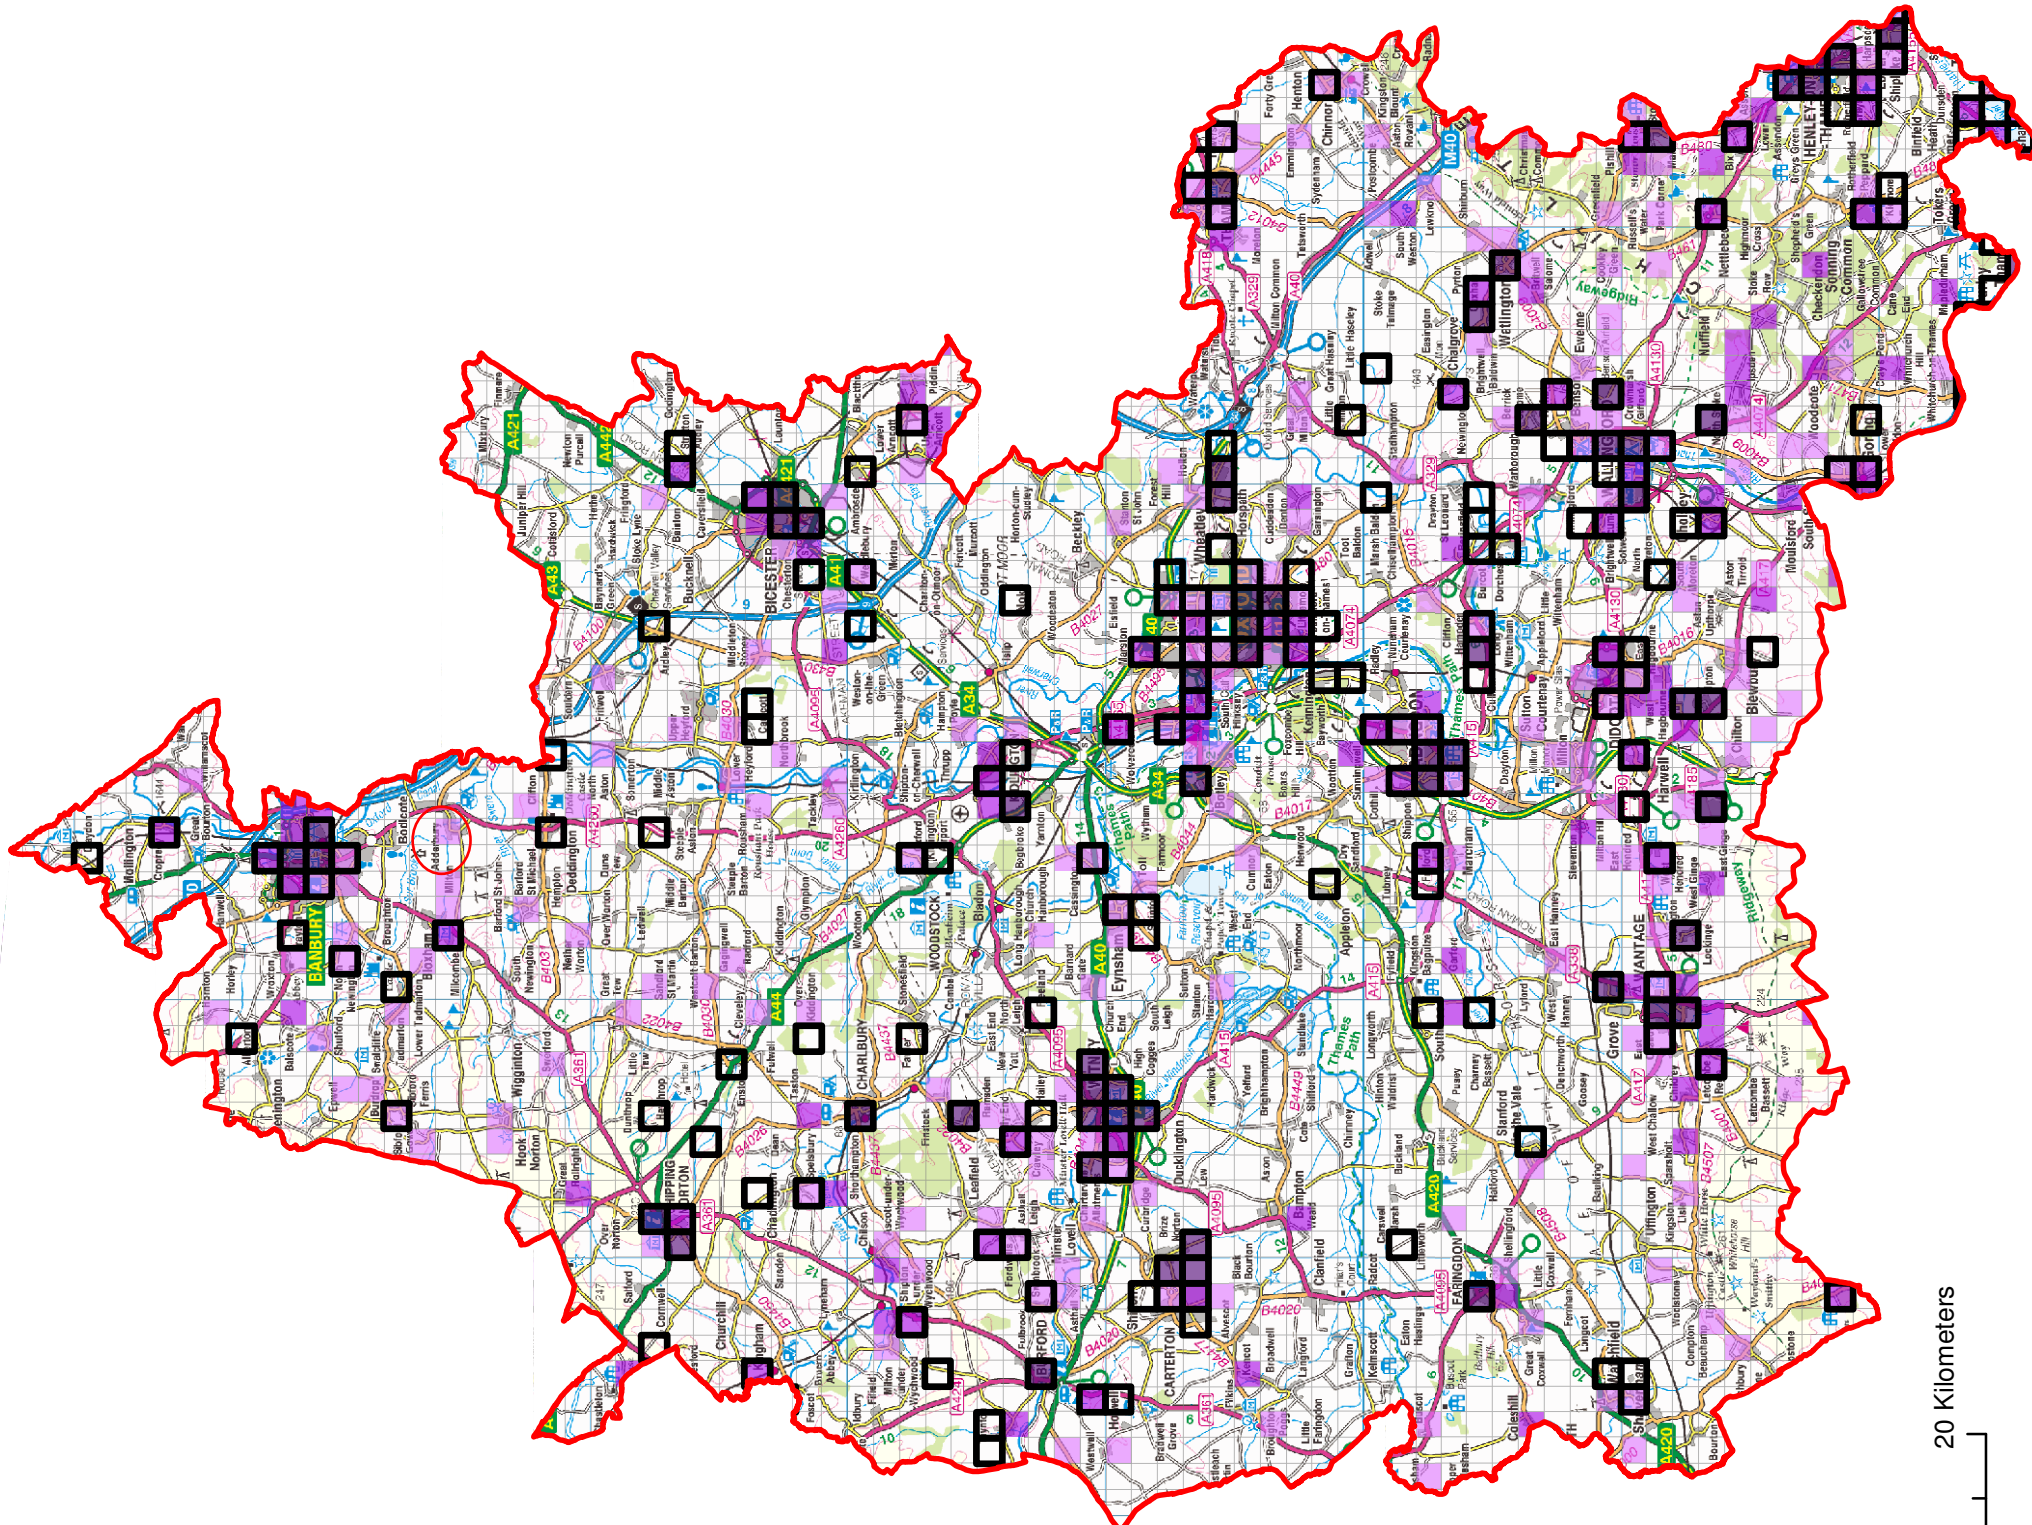

**Explanatory note:**  
 Maps 6a to 6c show the spatial distribution of three receptors (people, critical services and non-residential properties) that may be affected by future surface water flooding in an event with a 1 in 200 chance of occurring in any given year.

This map shows the number of non-residential properties affected, which can be considered an indicator of the consequences of flooding for economic activity. Non-residential properties are defined in the Environment Agency's PFRA and property count guidance, and include all industrial, commercial, retail, public buildings etc. Calculations for each 1km square were carried out using the Flood Map for Surface Water (1 in 200 >0.3m), Environment Agency's detailed method of counting (based on property outlines) and the National Receptors Database v1.1.


The 1km squares are shaded from light to dark purple as the number of non-residential properties affected in each square increases. Also overlaid on the map are surface water flooding 'hot spots', or areas where the consequences of a surface water event are likely to be more severe. These have been defined as 1km grid squares where at least one of the three indicators is above the threshold given below (thresholds defined by Defra guidance):

- More than 200 people affected
- One or more critical services affected
- More than 20 non-residential properties affected

The maps show that:  
 • The main hotspots are in more urban locations due to the concentration of population, industrial and commercial buildings, and critical services.

• Several more rural communities have less people affected but will still experience an adverse impact, particularly those where local critical services are affected. More detail is given in the main report.

**Legend**



Hotspots

**Non-residential properties**



< 5  
 Number of non-residential properties affected per 1km grid square



5 - 10



10 - 20



> 20

© Crown Copyright and database rights 2011 100023343  
 © Environment Agency



Crowmarsh Battle Barns  
 100 Preston Crowmarsh  
 Wallingford  
 OX10 6SL



www.jbaconsulting.co.uk  
 t +44 (0)1491 836688  
 f +44 (0)870 0519307  
 e info@jbaconsulting.co.uk

Other offices at Atherstone, Doncaster, Edinburgh, Haywards Heath, Limerick, Newcastle upon Tyne, Newport, Northallerton, Salford, Skipton & Tadcaster

for

**OXFORDSHIRE COUNTY COUNCIL**  
**PRELIMINARY FLOOD RISK ASSESSMENT**  
 Map 6c: Non-residential properties affected by flooding in a rainfall event with a 1 in 200 chance of occurring in any given year

This document is the property of Jeremy Bem Associates Ltd. It shall not be reproduced in whole or in part, nor disclosed to a third party, without the permission of Jeremy Bem Associates

Drawn by: AC

Date: 09/06/2011

Status: FINAL


File Name: N/A

Scale: Not to scale

0 5 10 20 Kilometers

Drawing Number: Map 6c



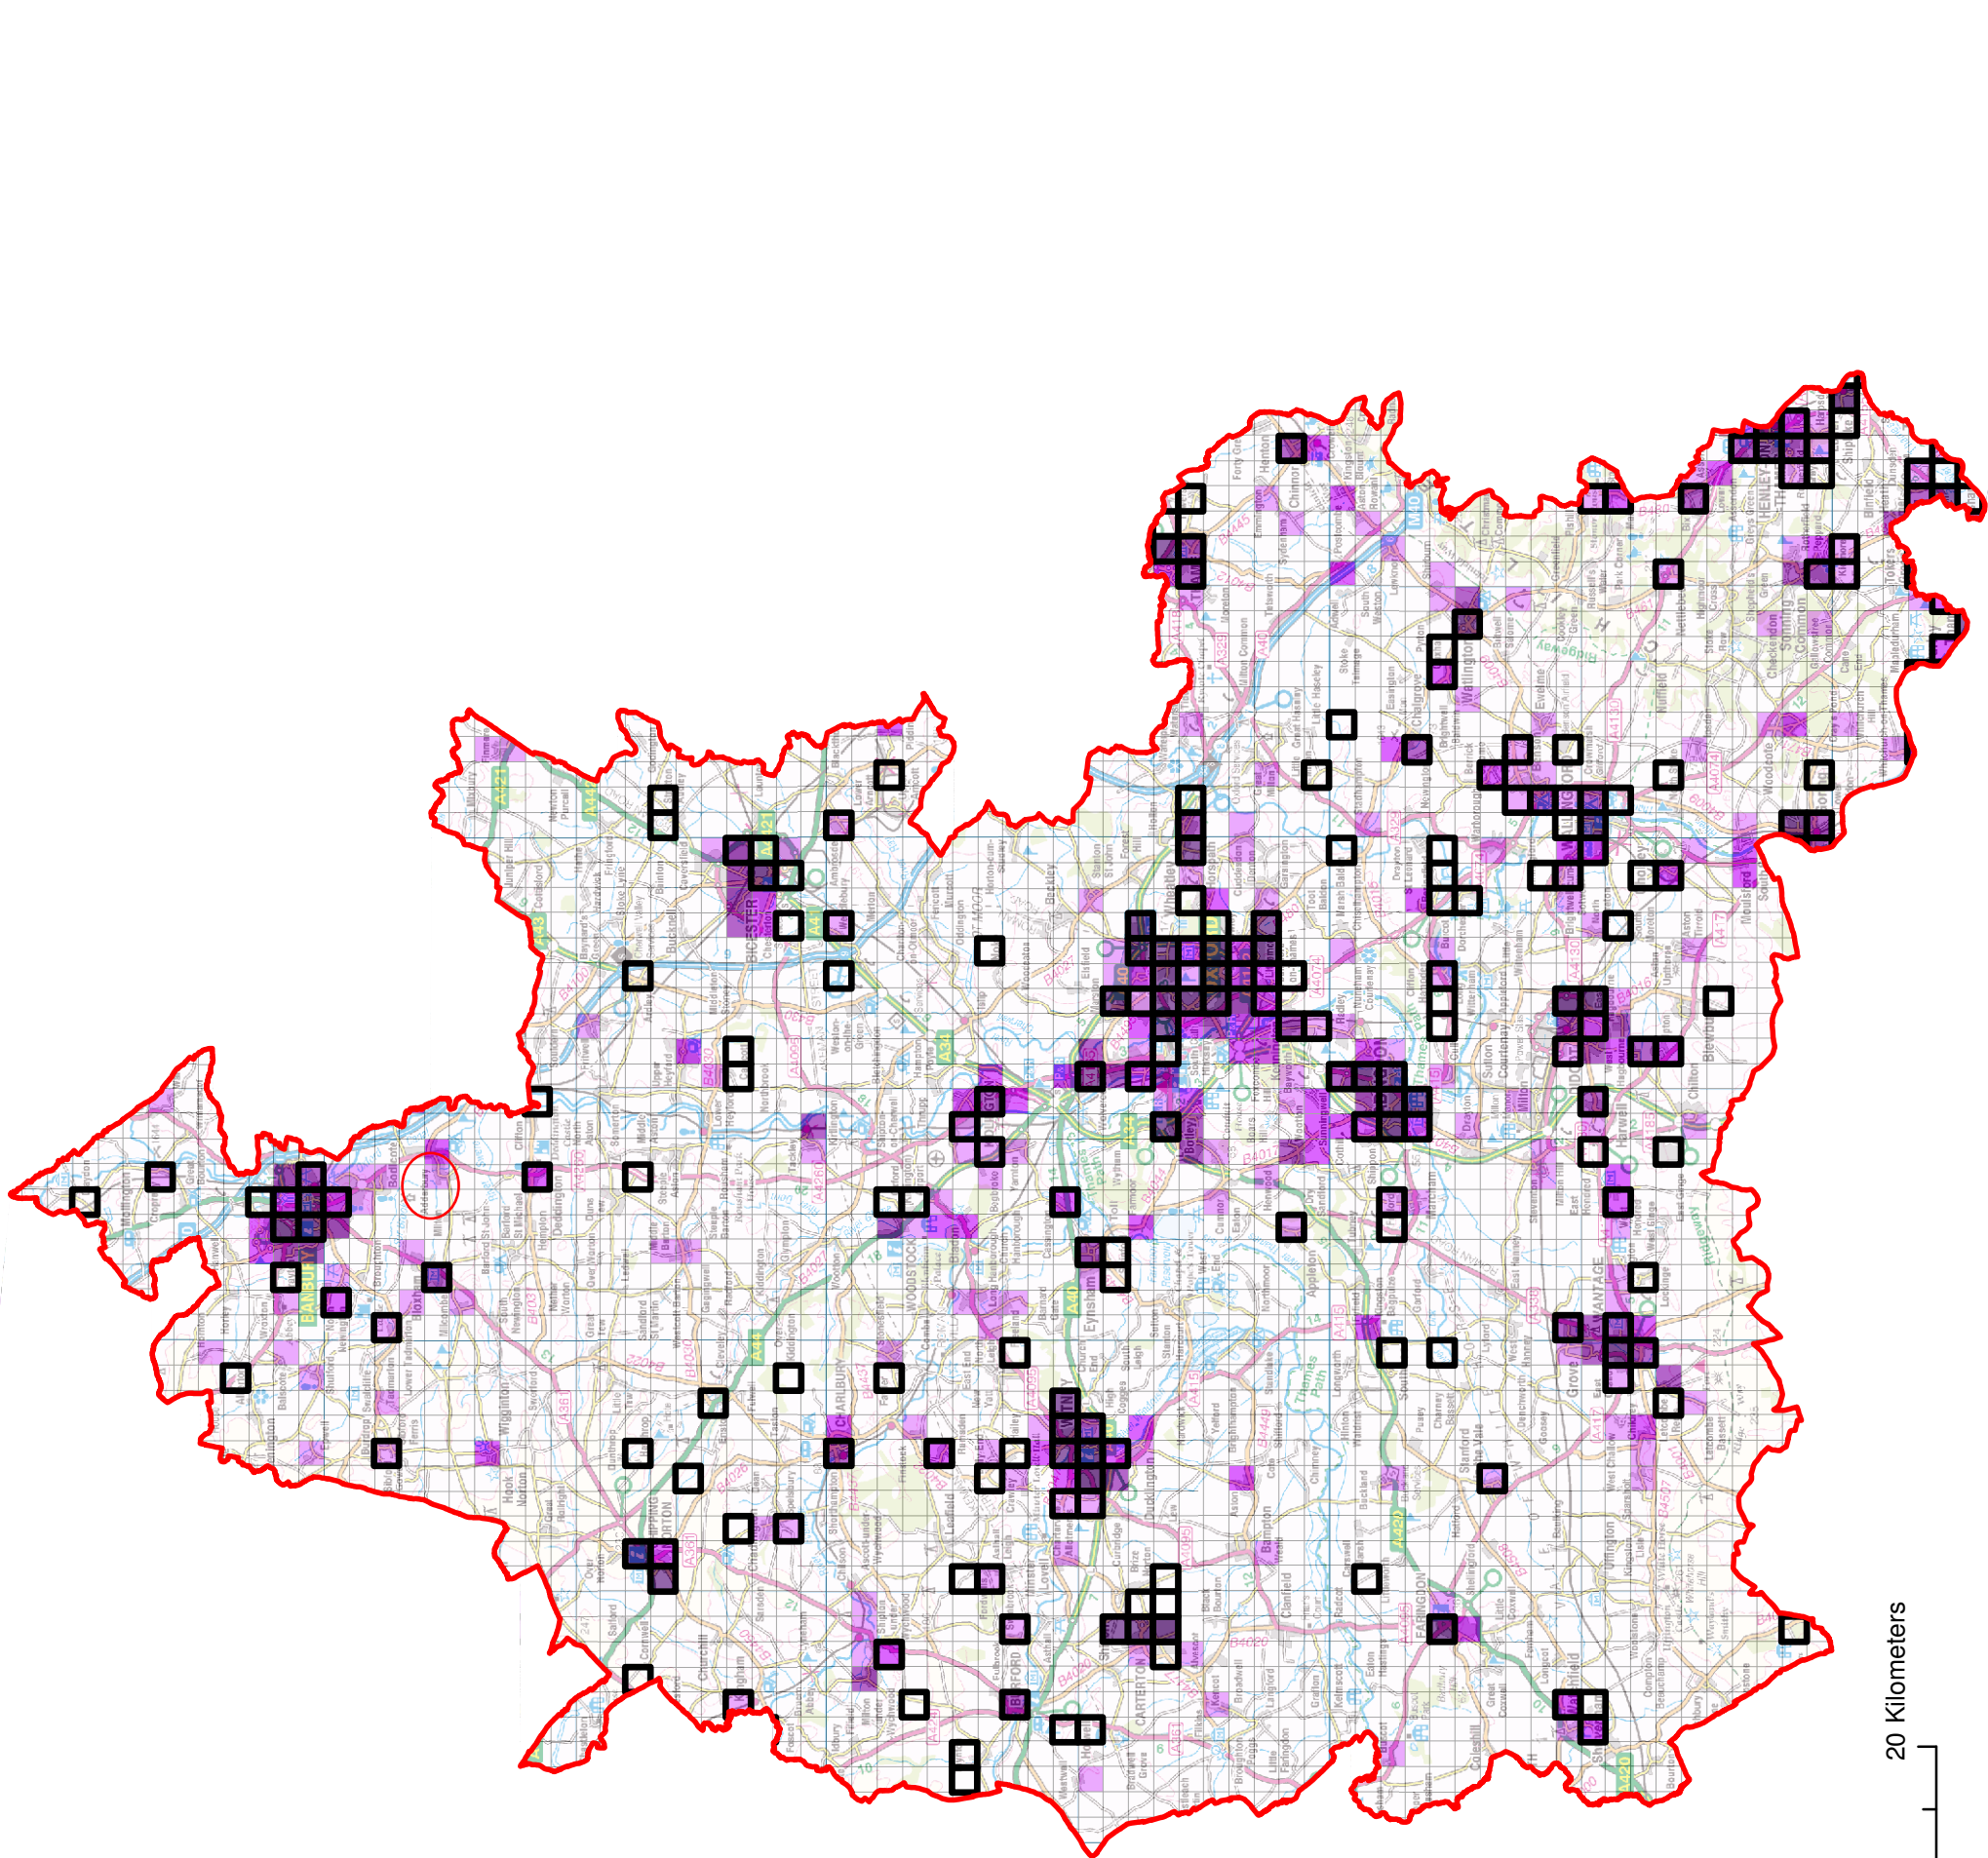

**Explanatory note:**  
 Maps 6a to 6c show the spatial distribution of three receptors (people, critical services and non-residential properties) that may be affected by future surface water flooding in an event with a 1 in 200 chance of occurring in any given year.


This map shows the number of people affected, which can be considered an indicator of the consequences of flooding for human health. The number of people is defined by the Environment Agency guidance as the number of residential (housing) properties multiplied by 2.34.

Calculations for each 1km square were carried out using the Flood Map for Surface Water (1 in 200 >0.3m), Environment Agency's detailed method of counting (based on property outlines) and the National Receptors Database v1.1.

The 1km squares are shaded from light to dark purple as the number of people affected in each square increases. Also overlaid on the map are surface water flooding 'hot spots', or areas where the consequences of a surface water event are likely to be more severe. These have been defined as 1km grid squares where at least one of the three indicators is above the threshold given below (thresholds defined by Defra guidance):

- More than 200 people affected
  - One or more critical services affected
  - More than 20 non-residential properties affected
- The maps show that:
- The main hotspots are in more urban locations due to the concentration of population, industrial and commercial buildings, and critical services.
  - Several more rural communities have less people affected but will still experience an adverse impact, particularly those where local critical services are affected. More detail is given in the main report.

**Legend**



Hotspots

Number of people



< 20



20 - 50



50 - 100



100 - 200



> 200

Number of people affected per 1km grid square

© Crown Copyright and database rights 2011 100023343  
 © Environment Agency



Crowmarsh Battle Barns  
 100 Preston Crowmarsh  
 Wallingford  
 OX10 6SL



www.jbaconsulting.co.uk  
 t +44 (0)1491 836688  
 f +44 (0)870 0519307  
 e info@jbaconsulting.co.uk

Other offices at Atherstone, Doncaster, Edinburgh, Haywards Heath, Limerick, Newcastle upon Tyne, Newport, Northallerton, Salford, Skipton & Tadcaster

for  
**OXFORDSHIRE COUNTY COUNCIL**  
**PRELIMINARY FLOOD RISK ASSESSMENT**  
 Map 6a: People affected by flooding in a rainfall event with a 1 in 200 chance of occurring in any given year

This document is the property of Jeremy Benn Associates Ltd. It shall not be reproduced in whole or in part, nor disclosed to a third party, without the permission of Jeremy Benn Associates

Drawn by: AC

Date: 09/06/2011

Status: FINAL

File Name: N/A


Scale:

Not to scale



Drawing Number: Map 6a



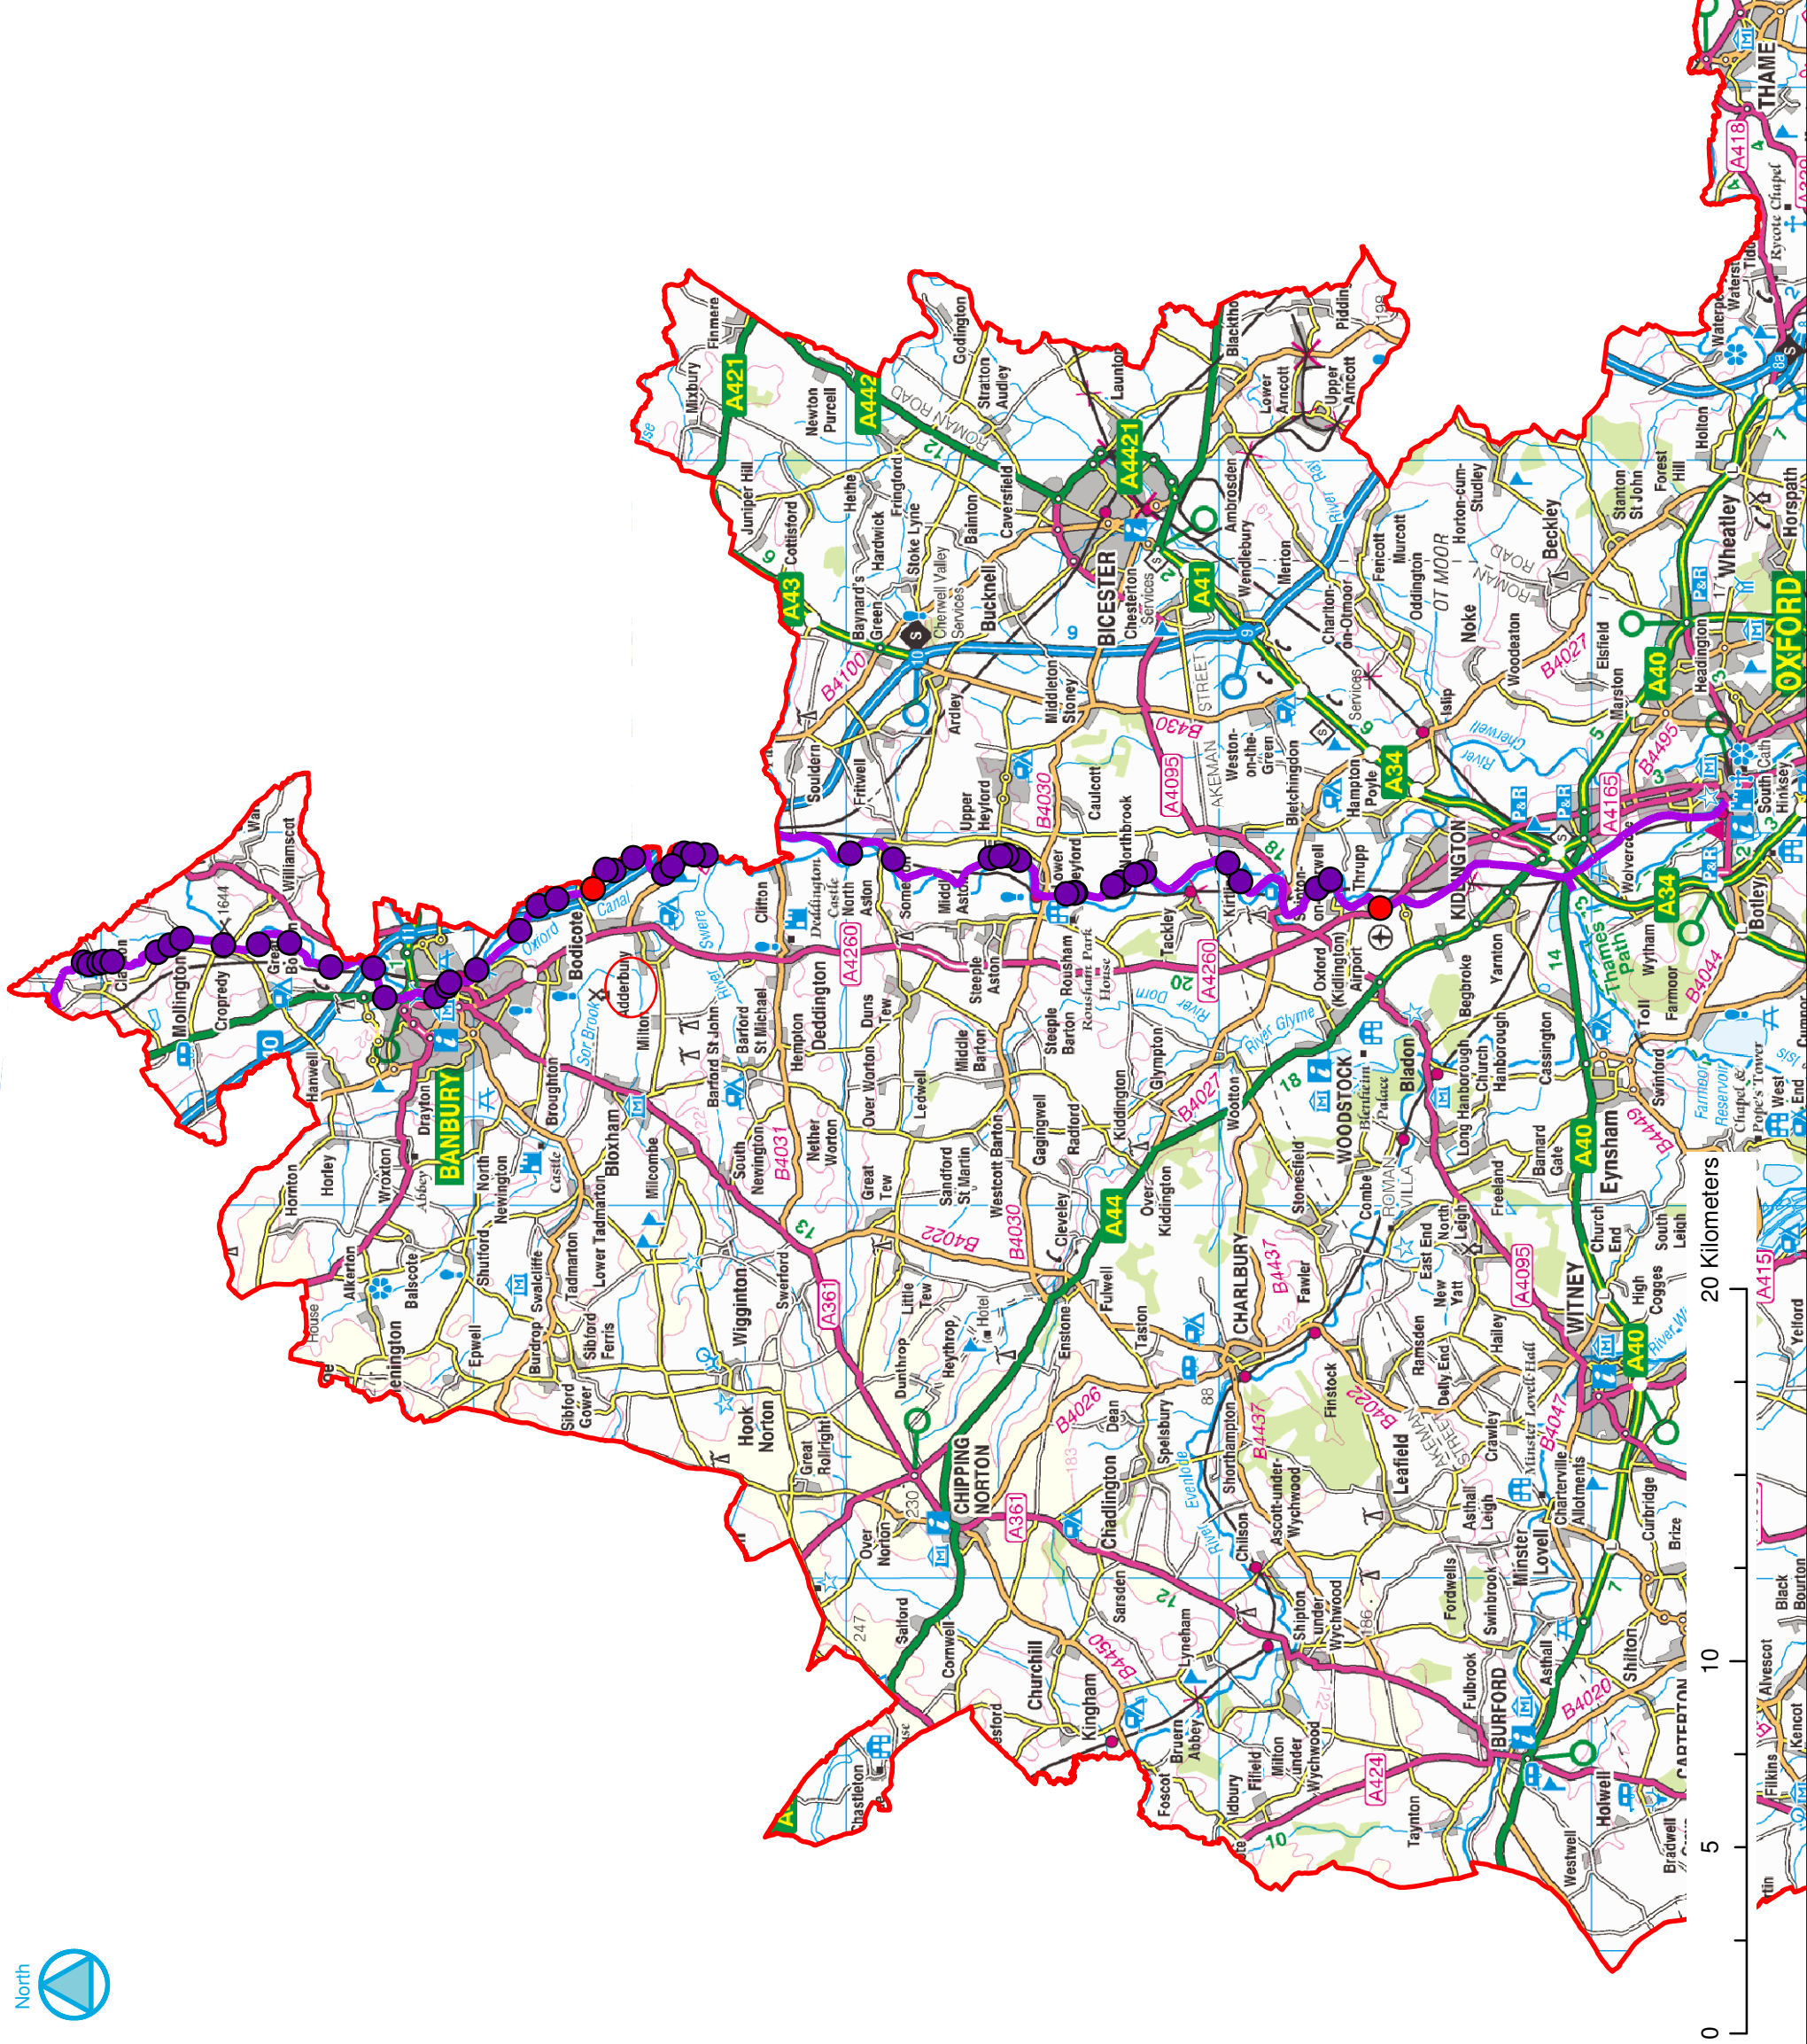

- Legend**
- Breach location
  - Overflowing location
  - Oxford Canal

© Crown Copyright and database rights 2011 100023343  
© British Waterways



Crowmarsh Battle Barns  
100 Preston Crowmarsh  
Wallingford  
OX10 6SL  
www.jbaconsulting.co.uk  
t +44 (0)1491 836688  
f +44 (0)870 0519307  
e info@jbaconsulting.co.uk

Other offices at Atherton, Doncaster, Edinburgh, Haywards Heath, Limerick, Newcastle upon Tyne, Newport, Northallerton, Salford, Skipton & Tadcaster


for  
**OXFORDSHIRE COUNTY COUNCIL**  
**PRELIMINARY FLOOD RISK ASSESSMENT**

**Map 4: Past flooding - Canal flooding in July 2007**

This document is the property of Jeremy Benn Associates Ltd. It shall not be reproduced in whole or in part, nor disclosed to a third party, without the permission of Jeremy Benn Associates

Drawn by: AB	Scale:
Date: 09/06/2011	Not to scale
Status: FINAL	
File Name: N/A	
Drawing Number: Map 4	



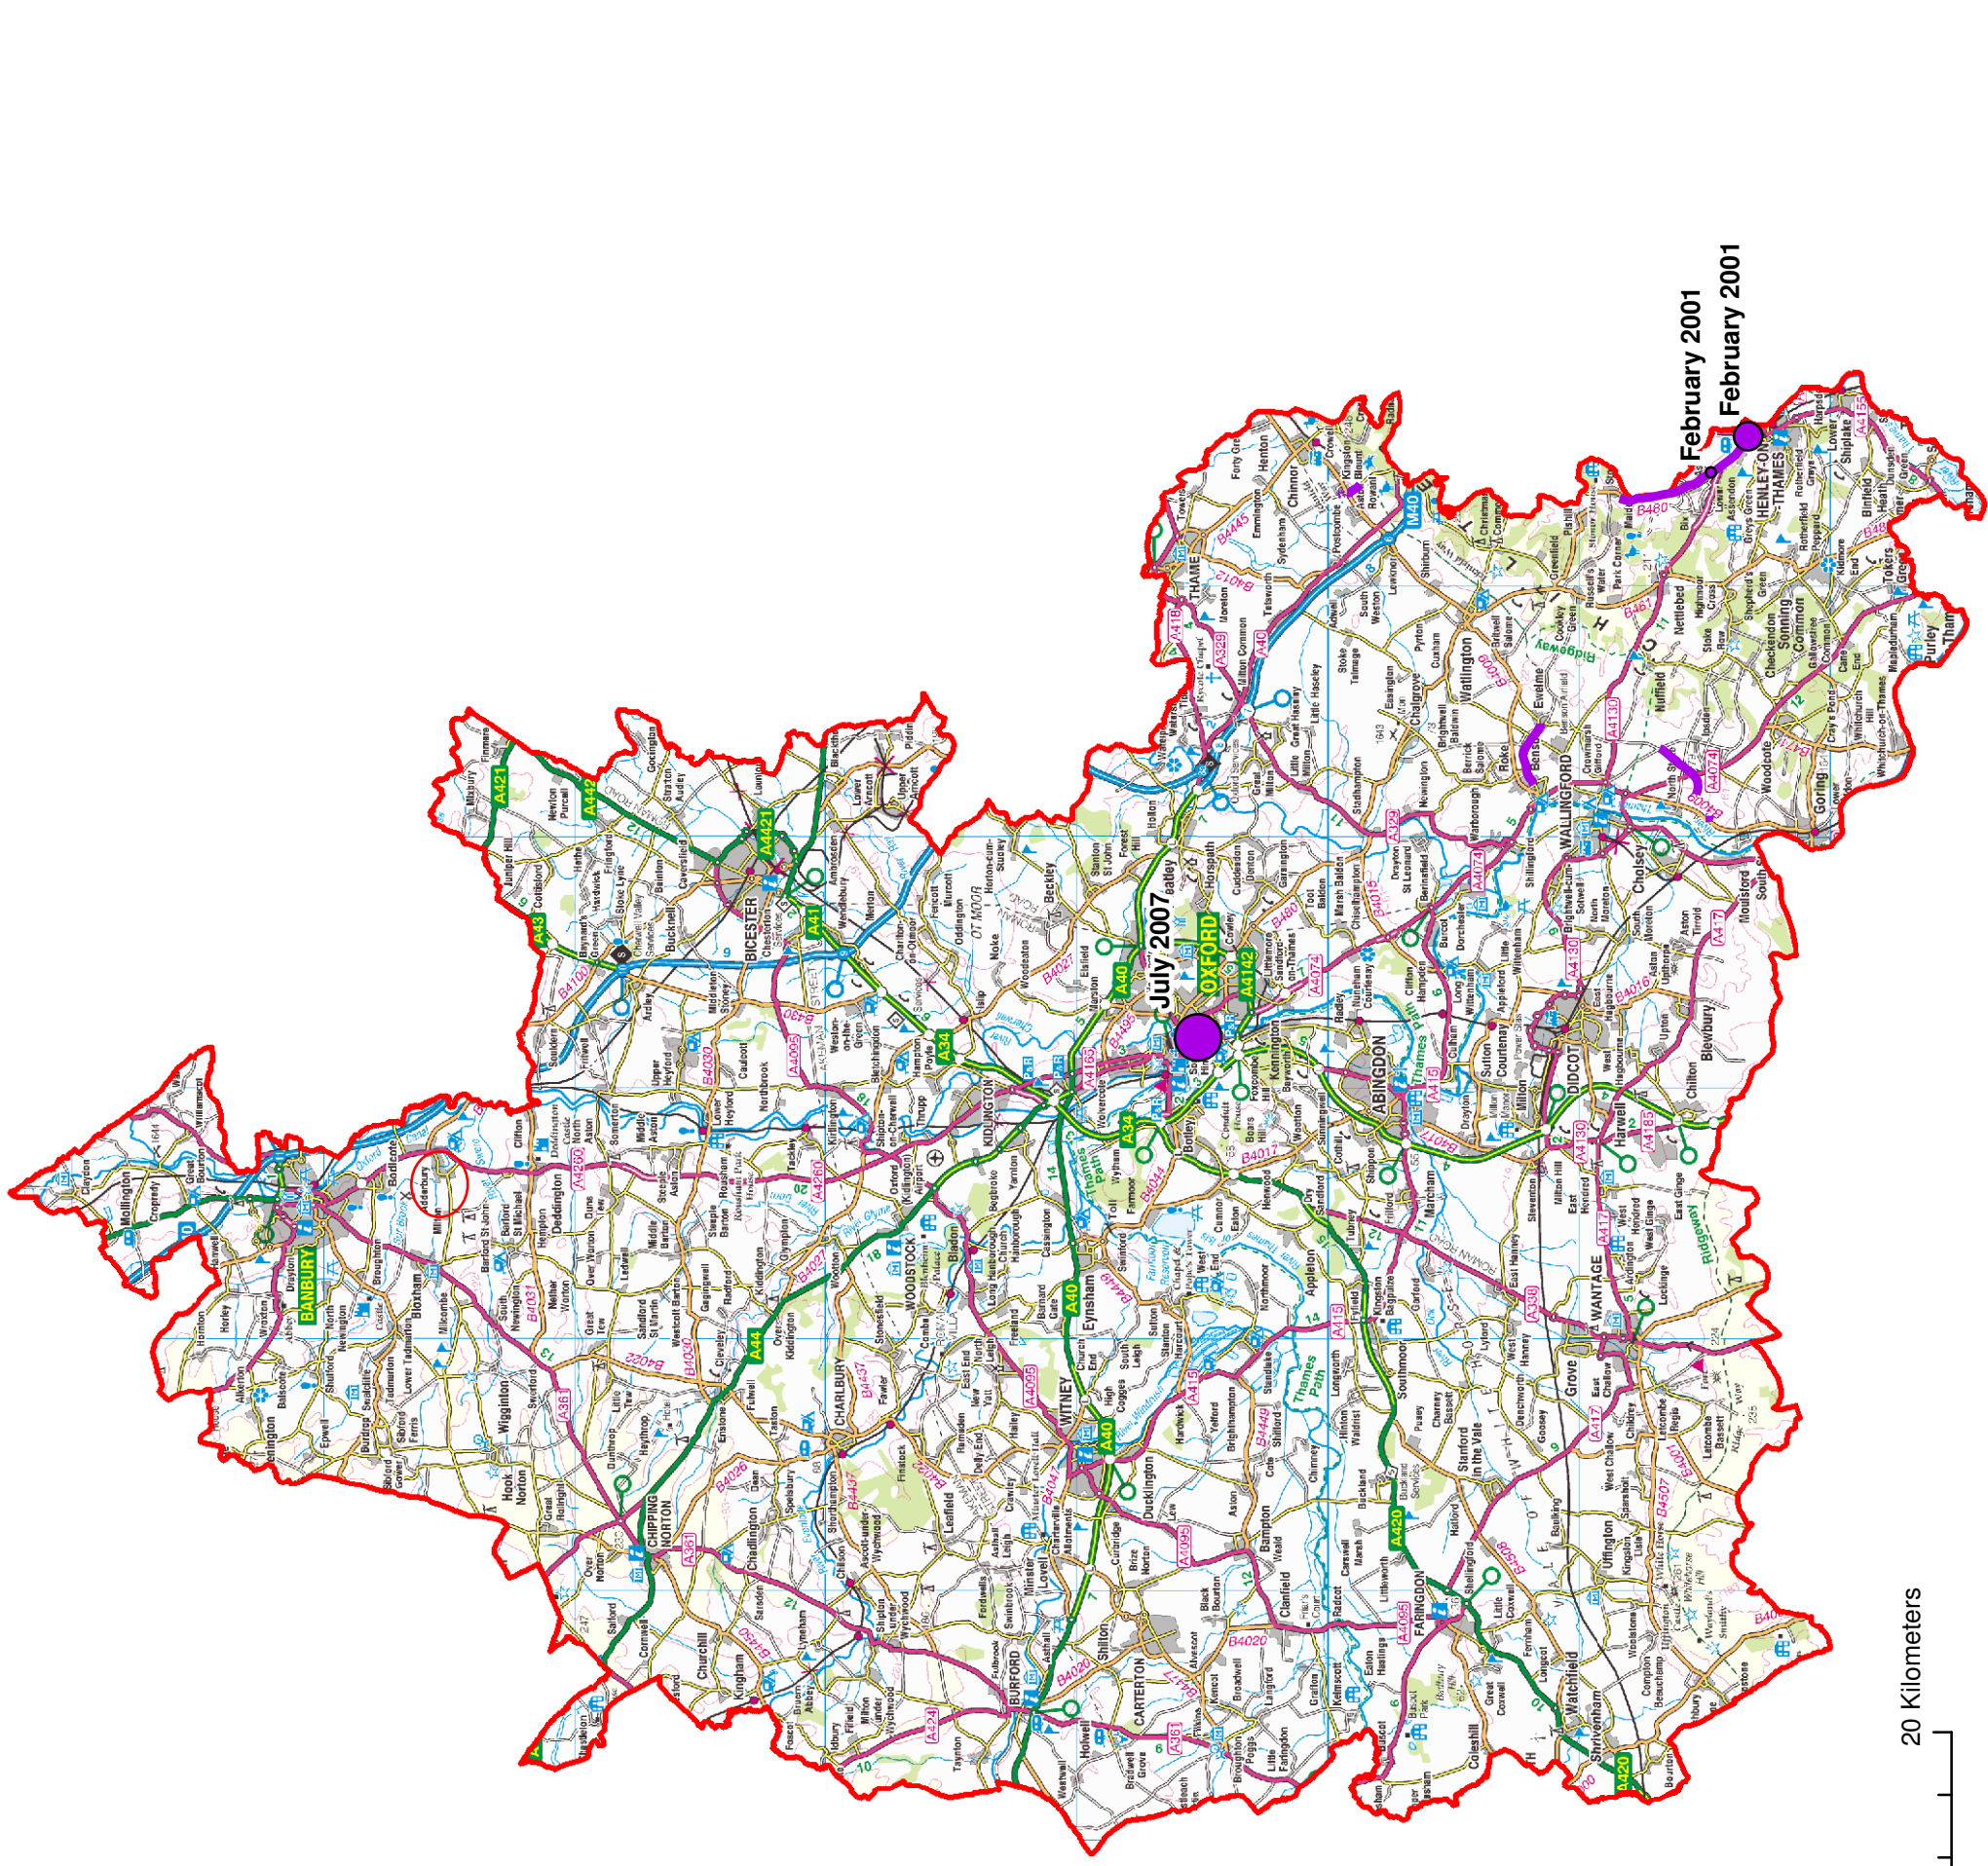

**Legend**

Past flooding from groundwater

Number of properties

- 0 to 10
- 11 to 20
- 21 to 200

Groundwater flooding locations (2001)

Note: Points are an indication of the approximate location of the settlement affected. NOT the location of individual properties flooded.

© Crown Copyright and database rights 2011 100023343  
 Contains Environment Agency information © Environment Agency and database right



Crowmarsh Battle Barns  
 100 Preston Crowmarsh  
 Wallingford  
 OX10 6SL  
 www.jbaconsulting.co.uk  
 t +44 (0)1491 836688  
 f +44 (0)870 0519307  
 e info@jbaconsulting.co.uk



Other offices at Atherstone, Doncaster, Edinburgh, Haywards Heath, Limerick, Newcastle upon Tyne, Newport, Northallerton, Salford, Skipton & Tadcaster

for

**OXFORDSHIRE COUNTY COUNCIL  
 PRELIMINARY FLOOD RISK ASSESSMENT**


Map 3: Past flooding - Ground water

This document is the property of Jeremy Benn Associates Ltd. It shall not be reproduced in whole or in part, nor disclosed to a third party, without the permission of Jeremy Benn Associates

Drawn by: AB	Scale:
Date: 09/06/2011	Not to scale
Status: FINAL	
File Name: N/A	

Drawing Number: Map 3



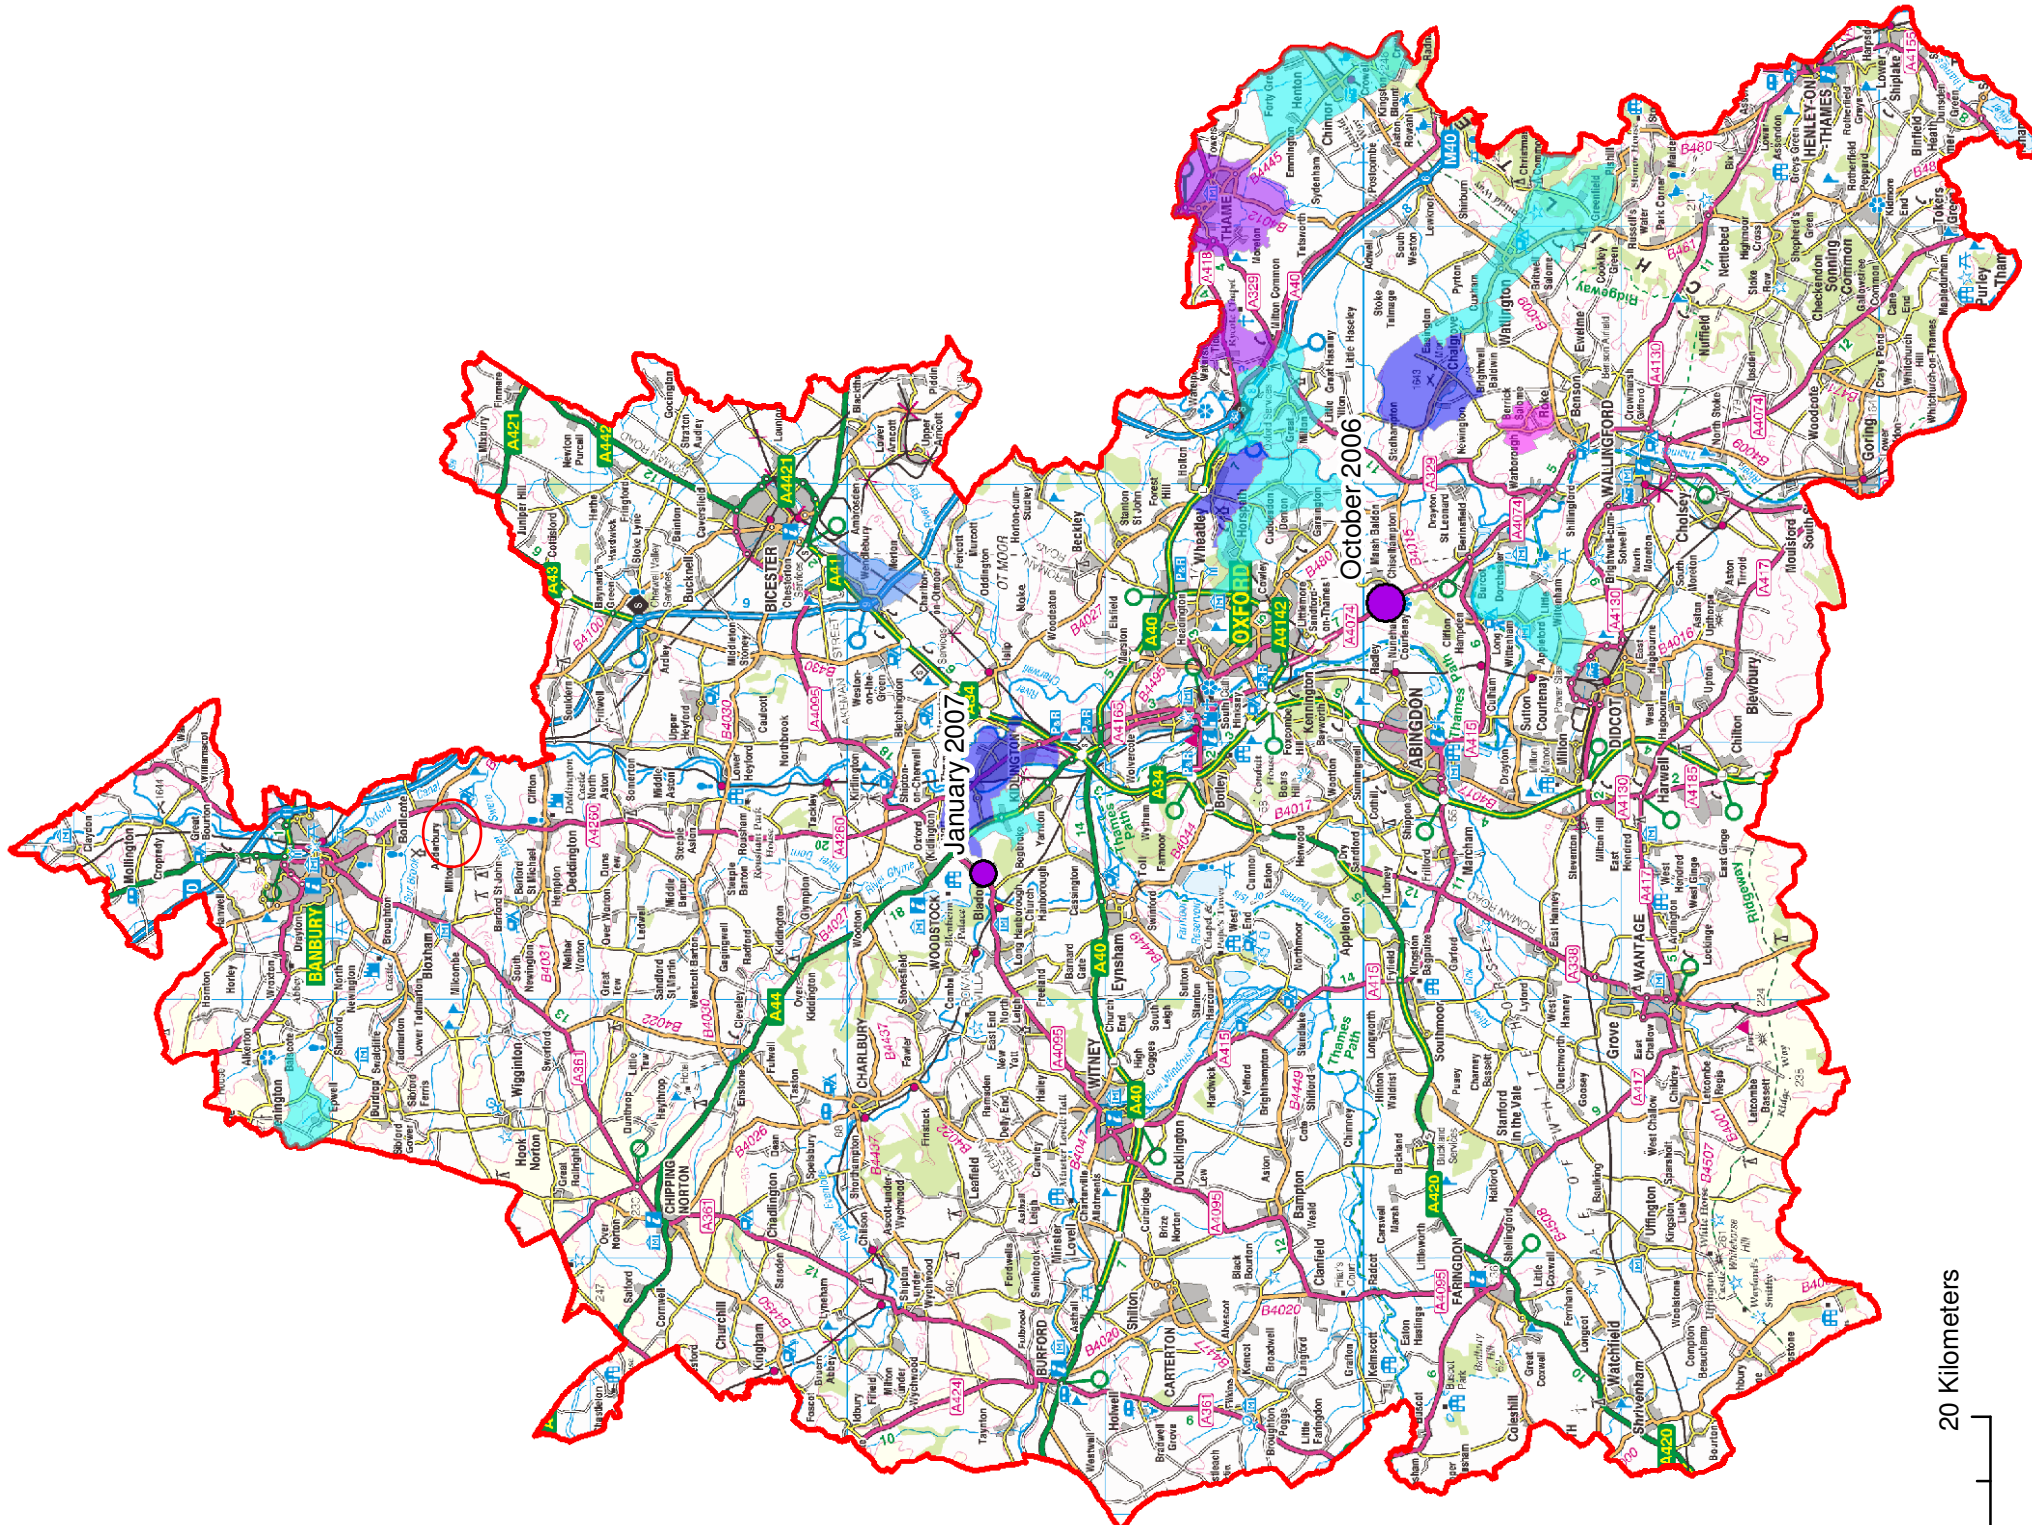

**Legend**

June 2008

**Number of properties flooded by parish**

- Less than 2
- 2 to 5
- 5 to 10
- 10 to 15
- 15 to 20

**Number of properties flooded by other events**

- 20
- 25

Note: Points are an indication of the approximate location of the settlement affected, NOT the location of individual properties flooded.

© Crown Copyright and database rights 2011 100023943



Crowmarsh Battle Barns  
100 Preston Crowmarsh  
Wallingford  
OX10 6SL  
www.jbaconsulting.co.uk  
t +44 (0)1491 836688  
f +44 (0)870 0519307  
e info@jbaconsulting.co.uk



Other offices at Atherton, Doncaster, Edinburgh, Haywards Heath, Limerick, Newcastle upon Tyne, Newport, Northallerton, Salford, Skipton & Tadcaster

for

**OXFORDSHIRE COUNTY COUNCIL  
PRELIMINARY FLOOD RISK ASSESSMENT**

**Map 2: Past flooding - Surface water in other events**

This document is the property of Jeremy Benn Associates Ltd. It shall not be reproduced in whole or in part, nor disclosed to a third party, without the permission of Jeremy Benn Associates

Drawn by: AB

Date: 09/06/2011

Status: FINAL

File Name: N/A


Drawing Number: Map 2

Scale:

Not to scale

0 5 10 20 Kilometers



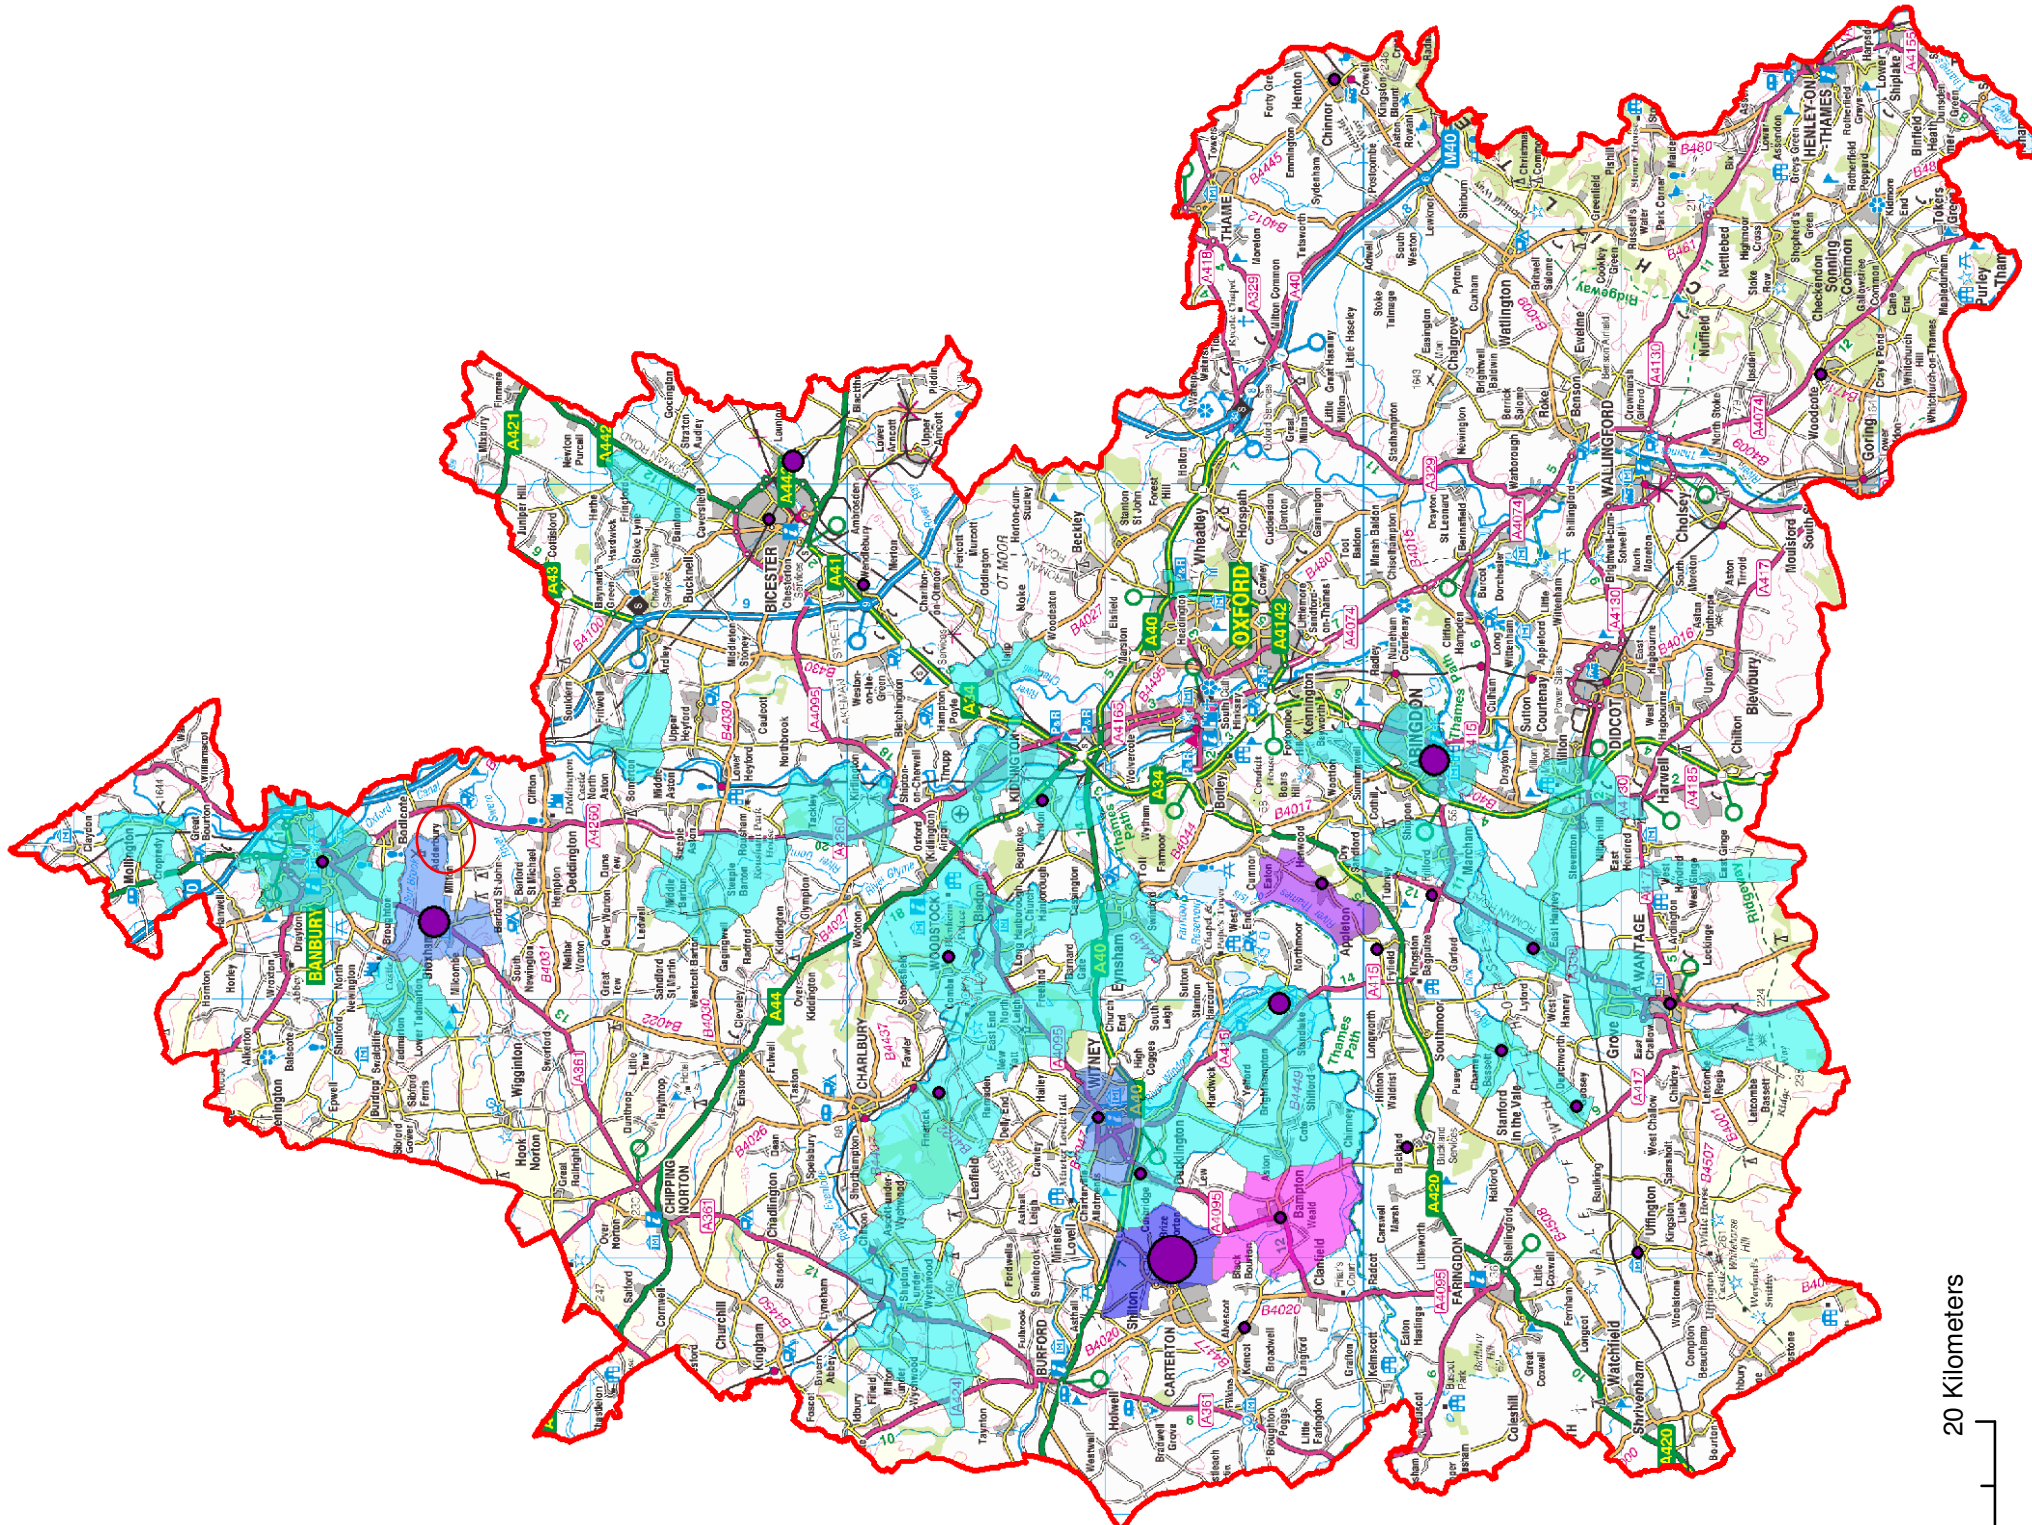

- Legend**
- July 2007 (Environment Agency)**
- 1 - 5 Number of properties flooded internally by 'surface water' (by settlement). Note: Points are an indication of the approximate location of the settlement affected NOT the location of individual properties flooded.
  - 6 - 10
  - 11 - 15
  - 16 - 20
  - 21 - 24
- July 2007 (Fire and Rescue Service)**
- 1-5 Number of properties flooded internally by 'drainage' and 'ordinary watercourse' (by parish)
  - 6-10
  - 11-20
  - 21-50
  - 51-125

© Crown Copyright and database rights 2011 100023343  
 Contains Environment Agency information © Environment Agency and database right



**OXFORDSHIRE COUNTY COUNCIL**  
 www.oxfordshire.gov.uk

Crowmarsh Battle Barns  
 100 Preston Crowmarsh  
 Wallingford  
 OX10 6SL

www.jbaconsulting.co.uk  
 t +44 (0)1491 836688  
 f +44 (0)1870 0519307  
 e info@jbaconsulting.co.uk

Other offices at Atherstone, Doncaster, Edinburgh, Haywards Heath, Limerick, Newcastle upon Tyne, Newport, Northallerton, Salford, Skipton & Tadcaster

for

**OXFORDSHIRE COUNTY COUNCIL**  
**PRELIMINARY FLOOD RISK ASSESSMENT**

Map 1: Past flooding - Surface water in July 2007

This document is the property of Jeremy Benn Associates Ltd. It shall not be reproduced in whole or in part, nor disclosed to a third party, without the permission of Jeremy Benn Associates

Drawn by: AB  
 Date: 09/06/2011  
 Status: FINAL  
 File Name: N/A

Scale:  
 Not to scale

Drawing Number: Map 1

This page has been left intentionally blank


## **APPENDIX I: SURFACE WATER RUN-OFF CALCULATIONS**

---

This page has been left intentionally blank



# SURFACE WATER RUN-OFF CALCULATION SHEET

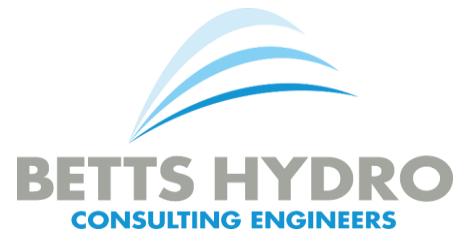

<b>Development</b>	Berry Hill Road. Adderbury
<b>Project No.</b>	HYD250

<b>Revision</b>	A	<b>Completed by</b>	PT
<b>Date</b>	27.06.17	<b>Checked by</b>	KW

Areas		Catchment Characteristics	
Total Site	4.000 ha	SAAR	655 mm
Development Area (for SW Strategy)	1.970 ha	SPR	10 %
Existing Impermeable	0.110 ha	$i_1$	14.1 mm/hr
Existing Impermeable (for SW Strategy)	0.000 ha	$i_{30}$	31.1 mm/hr
Existing Pervious	3.890 ha	$i_{100}$	40.4 mm/hr
Existing Pervious (for SW Strategy)	1.970 ha		
Proposed Impermeable (total)	0.886 ha		
Proposed Impermeable (domestic only)	ha		

Run-off Rates				Volumes					
<i>Pre-development</i>				<i>Pre-development</i>					
Impermeable	1yr	0.0 l/s		Impermeable	1yr	0.0 cu.m			
	30yr	0.0 l/s			100yr	0.0 cu.m			
	100yr	0.0 l/s			Pervious	1yr	12.6 cu.m		
	50mm/hr	0.0 l/s		100yr		83.6 cu.m			
	Pervious	1yr	0.6 l/s			Total	1yr	12.6 cu.m	
		30yr	1.7 l/s				100yr	83.6 cu.m	
		100yr	2.4 l/s						
	QBar	0.7 l/s							
Total	1yr	0.6 l/s							
	30yr	1.7 l/s							
	100yr	2.4 l/s							
<i>Post-development</i>									
Impermeable (total)	1yr	34.7 l/s							
	30yr	76.6 l/s							
	100yr+CC	129.3 l/s							
Impermeable (domestic only)	1yr	l/s							
	30yr	l/s							
	100yr+CC	l/s							

Quick storage Estimates		low	high	mean	Imp. Area (ha)	Max. Discharge (l/s)	Rainfall	CC
Return Period	1yr	82	131	106.5	0.886	5.0	FEH	0
Return Period	30yr	253	353	303	0.886	5.0	FEH	0
Return Period	100yr+CC	445	599	522	0.886	5.0	FEH	20%
Return Period	100yr+CC	541	724	632.5	0.886	5.0	FEH	40%

Old Marsh Farm Barns  
Welsh Road  
Sealand Flintshire CH5 2LY



Date 27/06/2017 16:21  
File

Designed by patricktaylor  
Checked by


Micro Drainage

Network 2014.1.1

Rainfall profile

Storm duration (mins) 360

FSR Data  
Region England and Wales  
M5-60 (mm) 20.000  
Ratio R 0.411  
Peak Intensity (mm/hr) 40.405  
Ave. Intensity (mm/hr) 10.307  
Return Period (years) 100

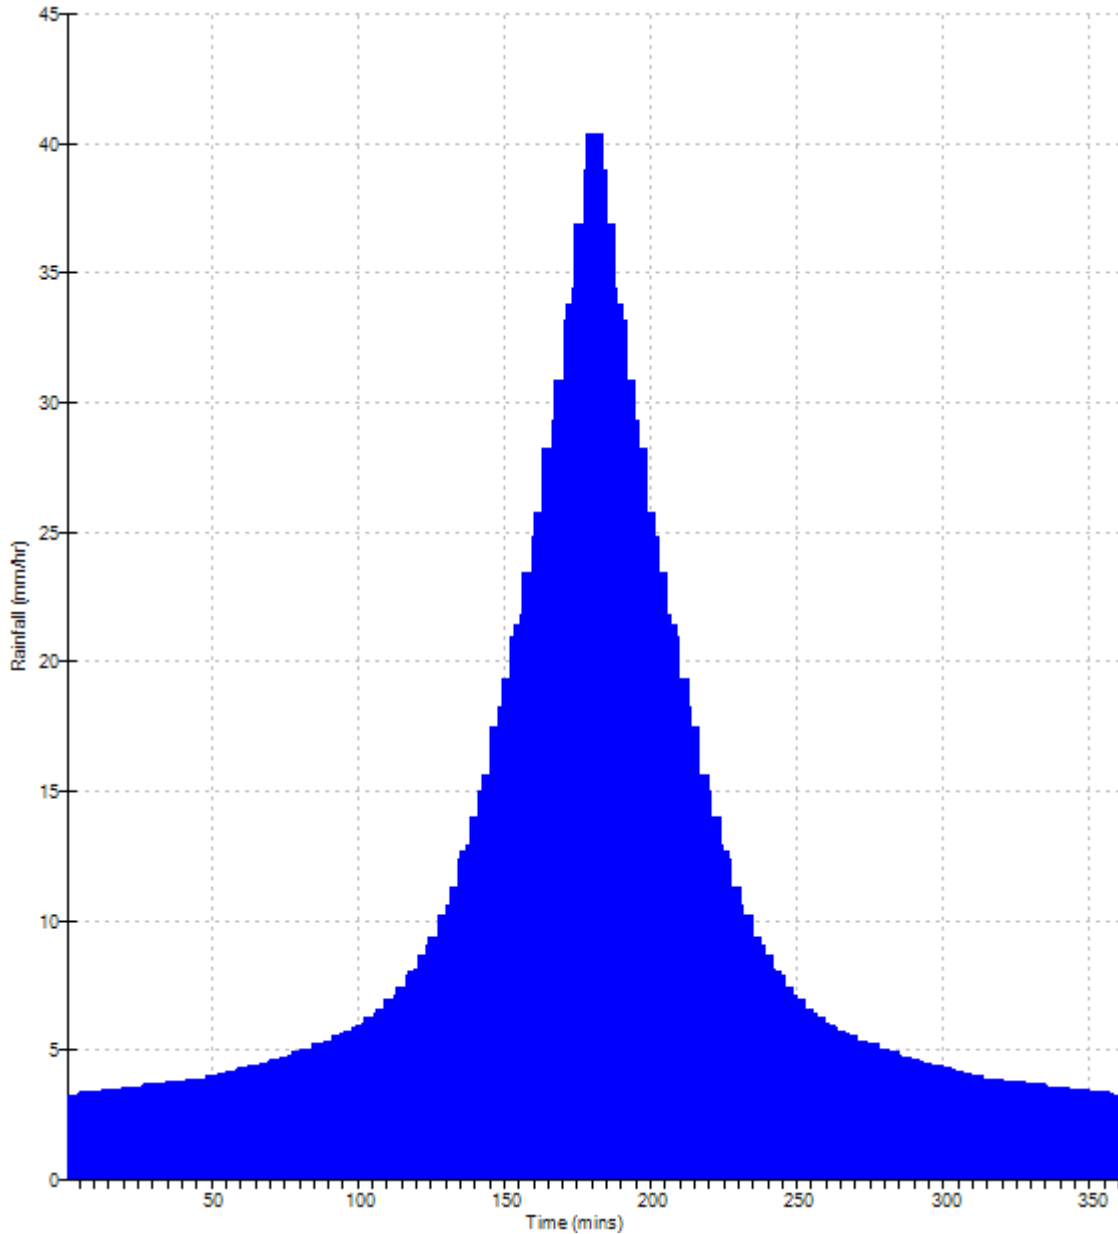

Old Marsh Farm Barns  
Welsh Road  
Sealand Flintshire CH5 2LY



Date 27/06/2017 16:23  
File

Designed by patricktaylor  
Checked by


Micro Drainage

Network 2014.1.1

Rainfall profile

Storm duration (mins) 360

FSR Data  
Region England and Wales  
M5-60 (mm) 20.000  
Ratio R 0.411  
Peak Intensity (mm/hr) 31.140  
Ave. Intensity (mm/hr) 7.944  
Return Period (years) 30

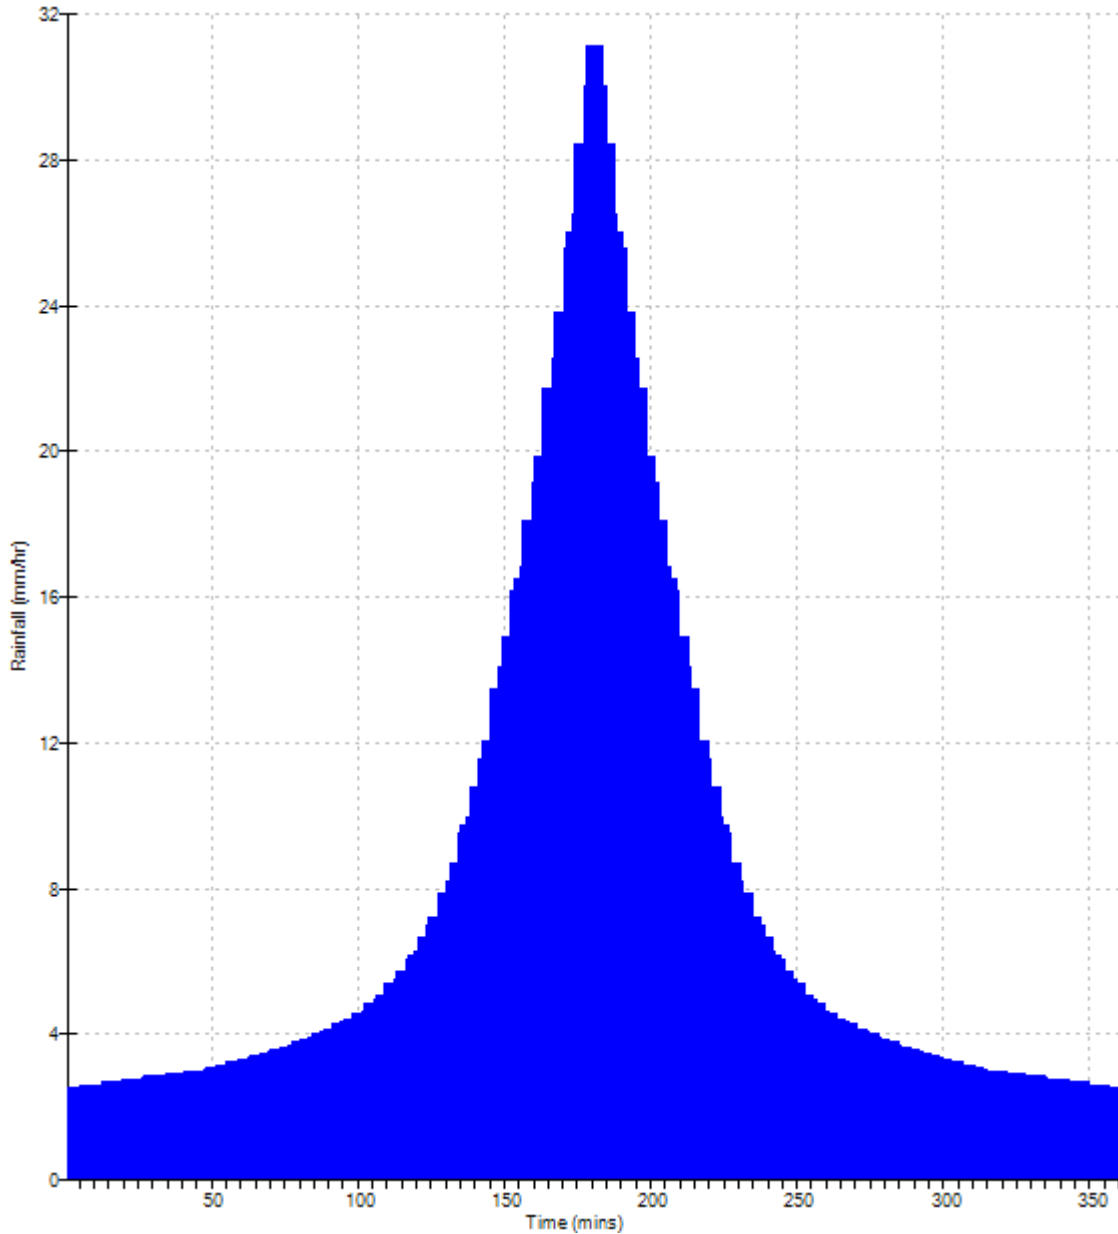

Old Marsh Farm Barns  
Welsh Road  
Sealand Flintshire CH5 2LY



Date 27/06/2017 16:20  
File

Designed by patricktaylor  
Checked by


Micro Drainage

Network 2014.1.1

Rainfall profile

Storm duration (mins) 360

FSR Data  
Region England and Wales  
M5-60 (mm) 20.000  
Ratio R 0.411  
Peak Intensity (mm/hr) 14.100  
Ave. Intensity (mm/hr) 3.597  
Return Period (years) 1

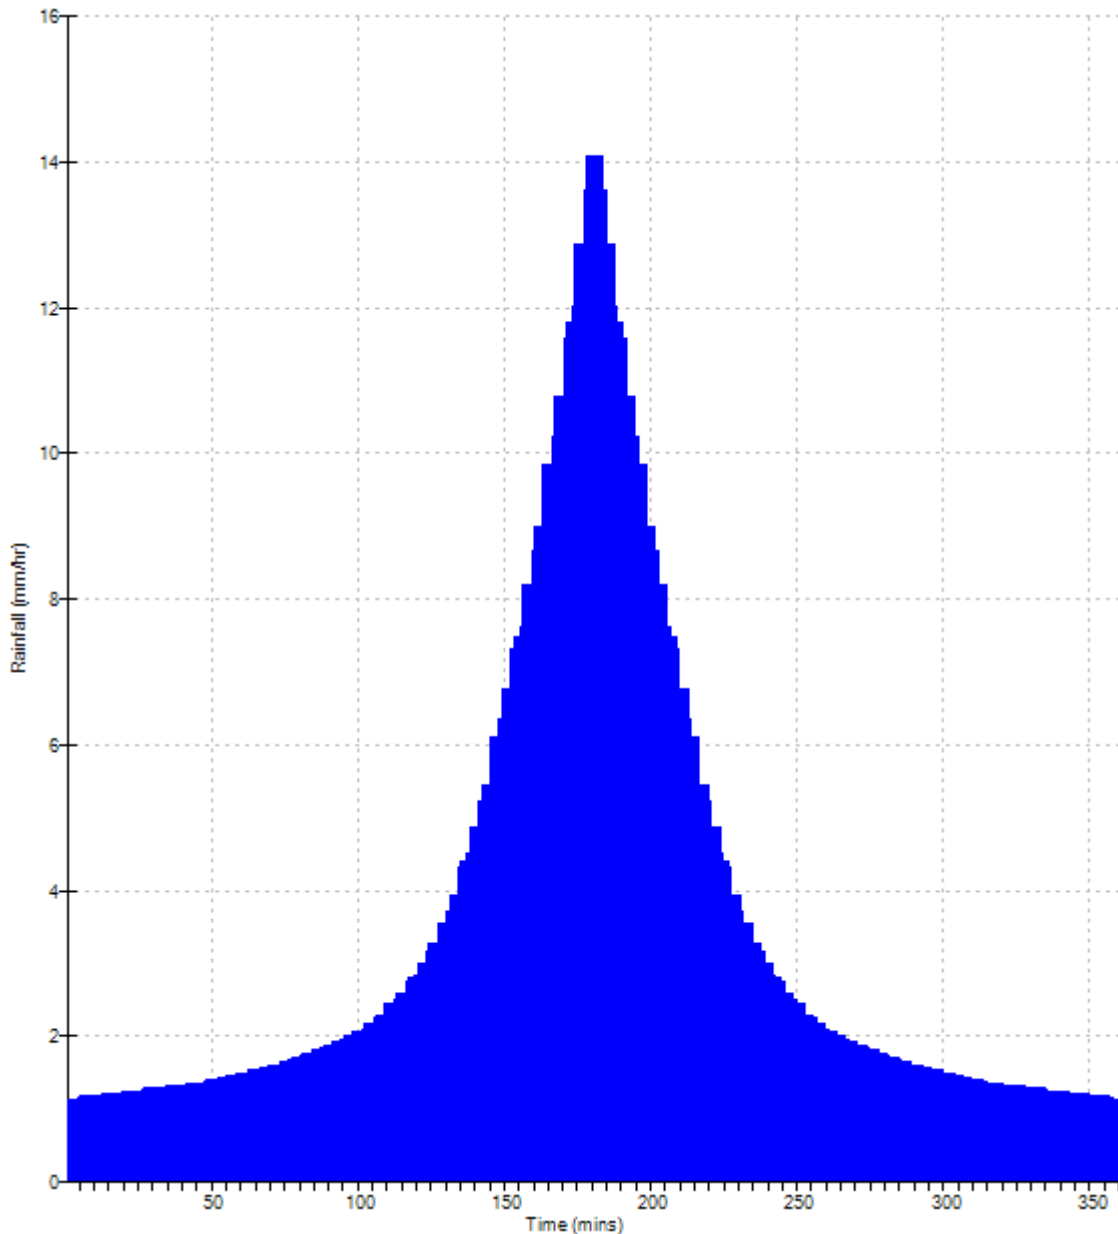

Old Marsh Farm Barns  
Welsh Road  
Sealand Flintshire CH5 2LY



Date 27/06/2017 14:33  
File

Designed by patricktaylor  
Checked by

Micro Drainage

Source Control 2014.1.1

ICP SUDS Mean Annual Flood

Input

Return Period (years) 1 Soil 0.150  
Area (ha) 1.970 Urban 0.000  
SAAR (mm) 655 Region Number Region 6


**Results 1/s**

QBAR Rural 0.7  
QBAR Urban 0.7

Q1 year 0.6

Q1 year 0.6  
Q30 years 1.7  
Q100 years 2.4



Betts Associates Ltd		Page 1
Old Marsh Farm Barns Welsh Road Sealand Flintshire CH5 2LY		
Date 29/06/2017 13:41 File	Designed by patricktaylor Checked by	
Micro Drainage	Source Control 2014.1.1	


Greenfield Runoff Volume

FSR Data

Return Period (years)	100
Storm Duration (mins)	360
Region	England and Wales
M5-60 (mm)	20.000
Ratio R	0.412
Areal Reduction Factor	1.00
Area (ha)	1.970
SAAR (mm)	655
CWI	96.900
Urban	0.000
SPR	10.000

Results

Percentage Runoff (%)	6.86
Greenfield Runoff Volume (m <sup>3</sup> )	83.557

Betts Associates Ltd		Page 1
Old Marsh Farm Barns Welsh Road Sealand Flintshire CH5 2LY		
Date 29/06/2017 13:43 File	Designed by patricktaylor Checked by	
Micro Drainage	Source Control 2014.1.1	

Greenfield Runoff Volume

FSR Data

Return Period (years)	1
Storm Duration (mins)	360
Region	England and Wales
M5-60 (mm)	20.000
Ratio R	0.412
Areal Reduction Factor	1.00
Area (ha)	1.970
SAAR (mm)	655
CWI	96.900
Urban	0.000
SPR	10.000

Results

Percentage Runoff (%)	2.98
Greenfield Runoff Volume (m <sup>3</sup> )	12.634

## **APPENDIX J: OVERLAND FLOOD FLOW PLANS**

---

This page has been left intentionally blank

DO NOT SCALE

LEGEND

→ OVERLAND FLOOD FLOWS



REV	DATE	BY	DESCRIPTION	CHK
A	06.07.17	CP	PRELIMINARY ISSUE FOR REVIEW	KW

DRAWING STATUS:

**BETTS HYDRO**  
CONSULTING ENGINEERS  
Unit 6, Old Marsh Farm Barns, Wash Road, Seaboard, Fifehire CH4 2LY  
01334 258173  
01334 258173

PROJECT:  
**BERRY HILL ROAD  
ADDERBURY**

TITLE:  
**PRE-DEVELOPMENT  
OVERLAND FLOOD FLOW PLAN**

DATE: JULY 2017	SCALE & SIZE: 1:750 @ A1	DRAWN: CP	CHECKED: KW
PROJECT NO: HYD250	DRAWING NO: 102	REV: A	

## **APPENDIX K: EXISTING AND PRELIMINARY DRAINAGE PLAN**

---

This page has been left intentionally blank



DO NOT SCALE

NOTES

PRE-DEVELOPMENT PERVIOUS AREAS - 4.004ha

PRE-DEVELOPMENT IMPERMEABLE AREAS - 0.110ha

TOTAL SITE AREA - 4.114ha



REV	DATE	BY	DESCRIPTION	KW	CHK
A	06.06.17	CP	PRELIMINARY ISSUE FOR REVIEW		

DRAWING STATUS:

**BETTS HYDRO**  
CONSULTING ENGINEERS  
Unit 6, Old Marsh Farm Barns, Wash Road, Seaboard, Eastleigh, CH4 2LY  
01329 252073  
02030030030@bt.com

PROJECT:	BERRY HILL ROAD ADDERBURY		
TITLE:	PRE-DEVELOPMENT IMPERMEABLE AREAS PLAN		
DATE:	JULY 2017	SCALE @ SIZE:	1:750 @ A1
PROJECT No:	HYD250	DRAWN:	CP
		CHECKED:	KW
		DRAWING No:	101
		REV:	A





OUR REF. HYD250

EXISTING DRAINAGE SITUATION PLAN

BERRY HILL ROAD, ADDERBURY

Revision: 0

Date: 29.06.17

**LEGEND**

Site Extents

**EXISTING DRAINAGE SEWER INFRASTRUCTURE**

Foul Water Sewer

Foul Water Rising Main

Pumping Station

**EXISTING DRAINAGE FEATURES**

Main River

**Notes:**

THIS DRAWING IS NOT A DRAINAGE 'DESIGN' IT IS A PRELIMINARY DRAINAGE STRATEGY SHOWING EXISTING SEWER LOCATIONS.

NO HYDRAULIC SIMULATION OR ASSESSMENT OF THESE PROPOSALS HAS BEEN UNDERTAKEN.

PROPOSED POINTS OF CONNECTION TO THE EXISTING WATERCOURSE AND SEWER REQUIRE INVERT LEVELS TO BE ACCURATELY ESTABLISHED. REFER TO PROPOSED DRAINAGE PLAN.

SURCHARGING OF THE PROPOSED OUTFALL WILL REQUIRE MODELLING TO SATISFY THE REQUIREMENTS OF UNITED UTILITIES ALONG WITH FULL HYDRAULIC ANALYSIS.





**LEGEND**

Site Extents

**EXISTING DRAINAGE SEWER INFRASTRUCTURE**

- Foul Water Sewer
- Foul Water Rising Main
- Pumping Station

**EXISTING DRAINAGE FEATURES**

- Main River

**PROPOSED DRAINAGE CONNECTIONS**

- Primary SW Option: INFILTRATION
- Alternative SW Option WATERCOURSE
- Foul Water Connection

**Notes:**

THIS DRAWING IS NOT A DRAINAGE 'DESIGN' IT IS A PRELIMINARY DRAINAGE STRATEGY SHOWING EXISTING SEWER LOCATIONS.

NO HYDRAULIC SIMULATION OR ASSESSMENT OF THESE PROPOSALS HAS BEEN UNDERTAKEN.

PROPOSED POINTS OF CONNECTION TO THE EXISTING WATERCOURSE AND SEWER REQUIRE INVERT LEVELS TO BE ACCURATELY ESTABLISHED. REFER TO PROPOSED DRAINAGE PLAN.

SURCHARGING OF THE PROPOSED OUTFALL WILL REQUIRE MODELLING TO SATISFY THE REQUIREMENTS OF UNITED UTILITIES ALONG WITH FULL HYDRAULIC ANALYSIS.







## **APPENDIX L: STORMWATER STORAGE ESTIMATES**

---


This page has been left intentionally blank


1 YEAR RETURN PERIOD STORM EVENT

 Variables Results Design Overview 2D Overview 3D Vt	<b>Variables</b>		
	FSR Rainfall	Cv (Summer)	0.750
	Return Period (years)	Cv (Winter)	0.840
	Region	Impemeable Area (ha)	0.886
	Map	Maximum Allowable Discharge (l/s)	5.0
	M5-60 (mm)	Infiltration Coefficient (m/hr)	0.00000
	Ratio R	Safety Factor	2.0
	Climate Change (%)	0	


	<b>Results</b>
	<p><b>Global Variables require approximate storage of between 82 m<sup>3</sup> and 131 m<sup>3</sup>.</b></p> <p><b>These values are estimates only and should not be used for design purposes.</b></p>


30 YEAR RETURN PERIOD STORM EVENT

 Variables Results Design Overview 2D Overview 3D Vt	<b>Variables</b>		
	FSR Rainfall	Cv (Summer)	0.750
	Return Period (years)	Cv (Winter)	0.840
	Region	Impemeable Area (ha)	0.886
	Map	Maximum Allowable Discharge (l/s)	5.0
	M5-60 (mm)	Infiltration Coefficient (m/hr)	0.00000
	Ratio R	Safety Factor	2.0
	Climate Change (%)	0	


	<b>Results</b>
	<p><b>Global Variables require approximate storage of between 253 m<sup>3</sup> and 353 m<sup>3</sup>.</b></p> <p><b>These values are estimates only and should not be used for design purposes.</b></p>


100 YEAR RETURN PERIOD STORM EVENT + 20% CLIMATE CHANGE

 Variables Results Design Overview 2D Overview 3D Vt	<b>Variables</b>				
	FSR Rainfall	Cv (Summer)	0.750		
	Return Period (years)	100	Cv (Winter)	0.840	
	Region	England and Wales	Impemeable Area (ha)	0.886	
	Map	M5-60 (mm)	20.000	Maximum Allowable Discharge (l/s)	5.0
		Ratio R	0.411	Infiltration Coefficient (m/hr)	0.00000
				Safety Factor	2.0
			Climate Change (%)	20	

	<b>Results</b>
	<p><b>Global Variables require approximate storage of between 445 m<sup>3</sup> and 599 m<sup>3</sup>.</b></p> <p><b>These values are estimates only and should not be used for design purposes.</b></p>

100 YEAR RETURN PERIOD STORM EVENT + 40% CLIMATE CHANGE

 Variables Results Design Overview 2D Overview 3D Vt	<b>Variables</b>				
	FSR Rainfall	Cv (Summer)	0.750		
	Return Period (years)	100	Cv (Winter)	0.840	
	Region	England and Wales	Impemeable Area (ha)	0.886	
	Map	M5-60 (mm)	20.000	Maximum Allowable Discharge (l/s)	5.0
		Ratio R	0.411	Infiltration Coefficient (m/hr)	0.00000
				Safety Factor	2.0
			Climate Change (%)	40	

	<b>Results</b>
	<p><b>Global Variables require approximate storage of between 541 m<sup>3</sup> and 724 m<sup>3</sup>.</b></p> <p><b>These values are estimates only and should not be used for design purposes.</b></p>




This page has been left intentionally blank

## **APPENDIX M: TYPICAL SUDS DETAILS**


---

This page has been left intentionally blank

DO NOT SCALE

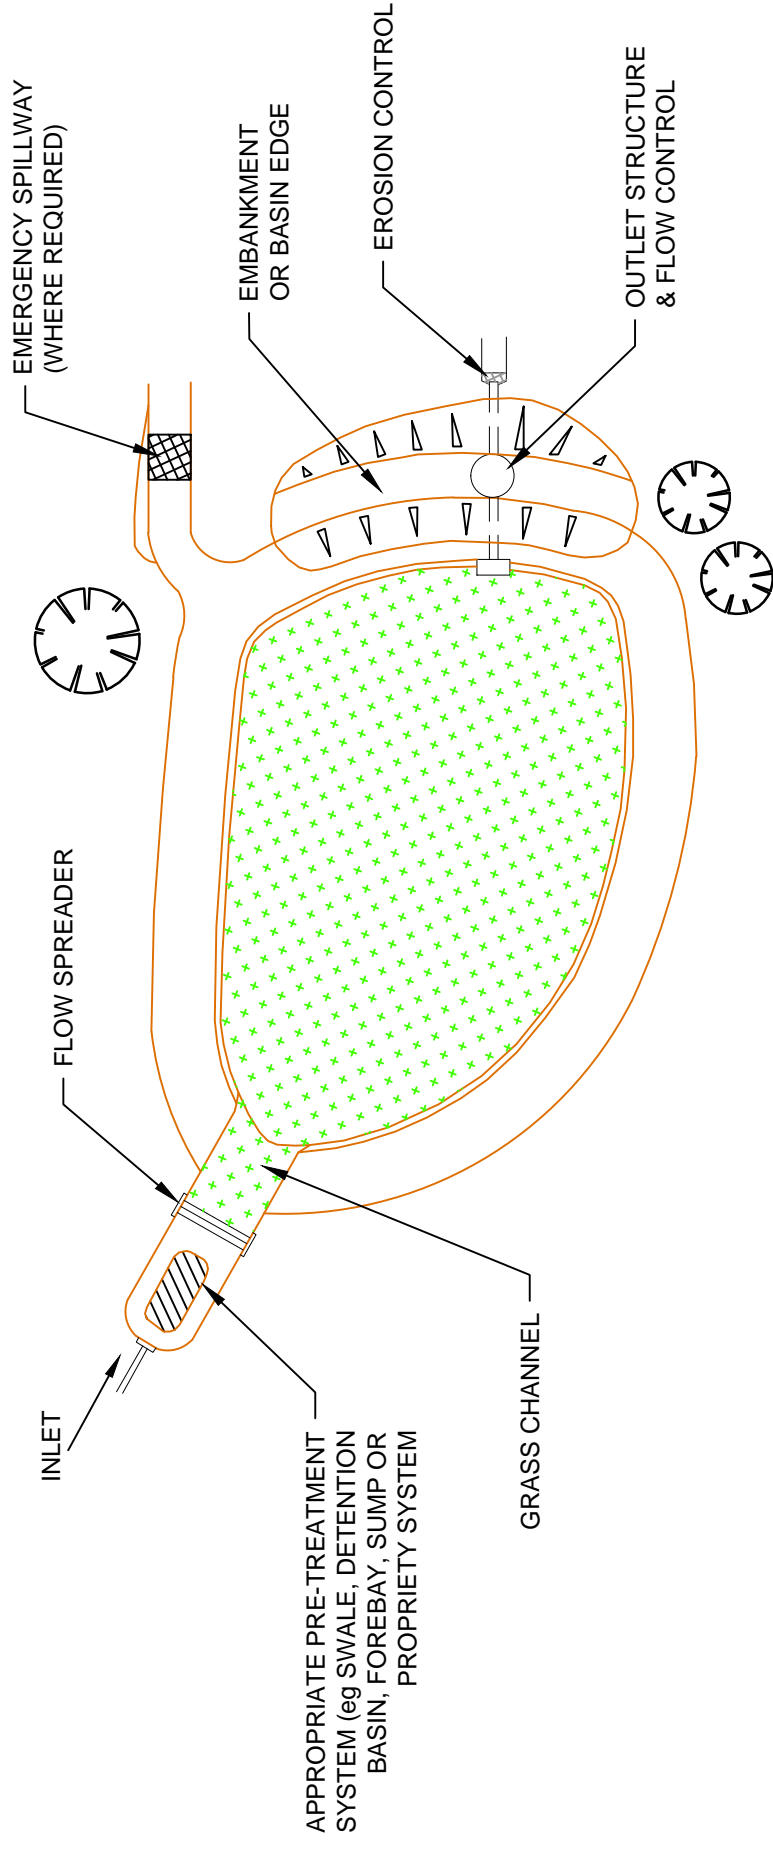

PLAN VIEW

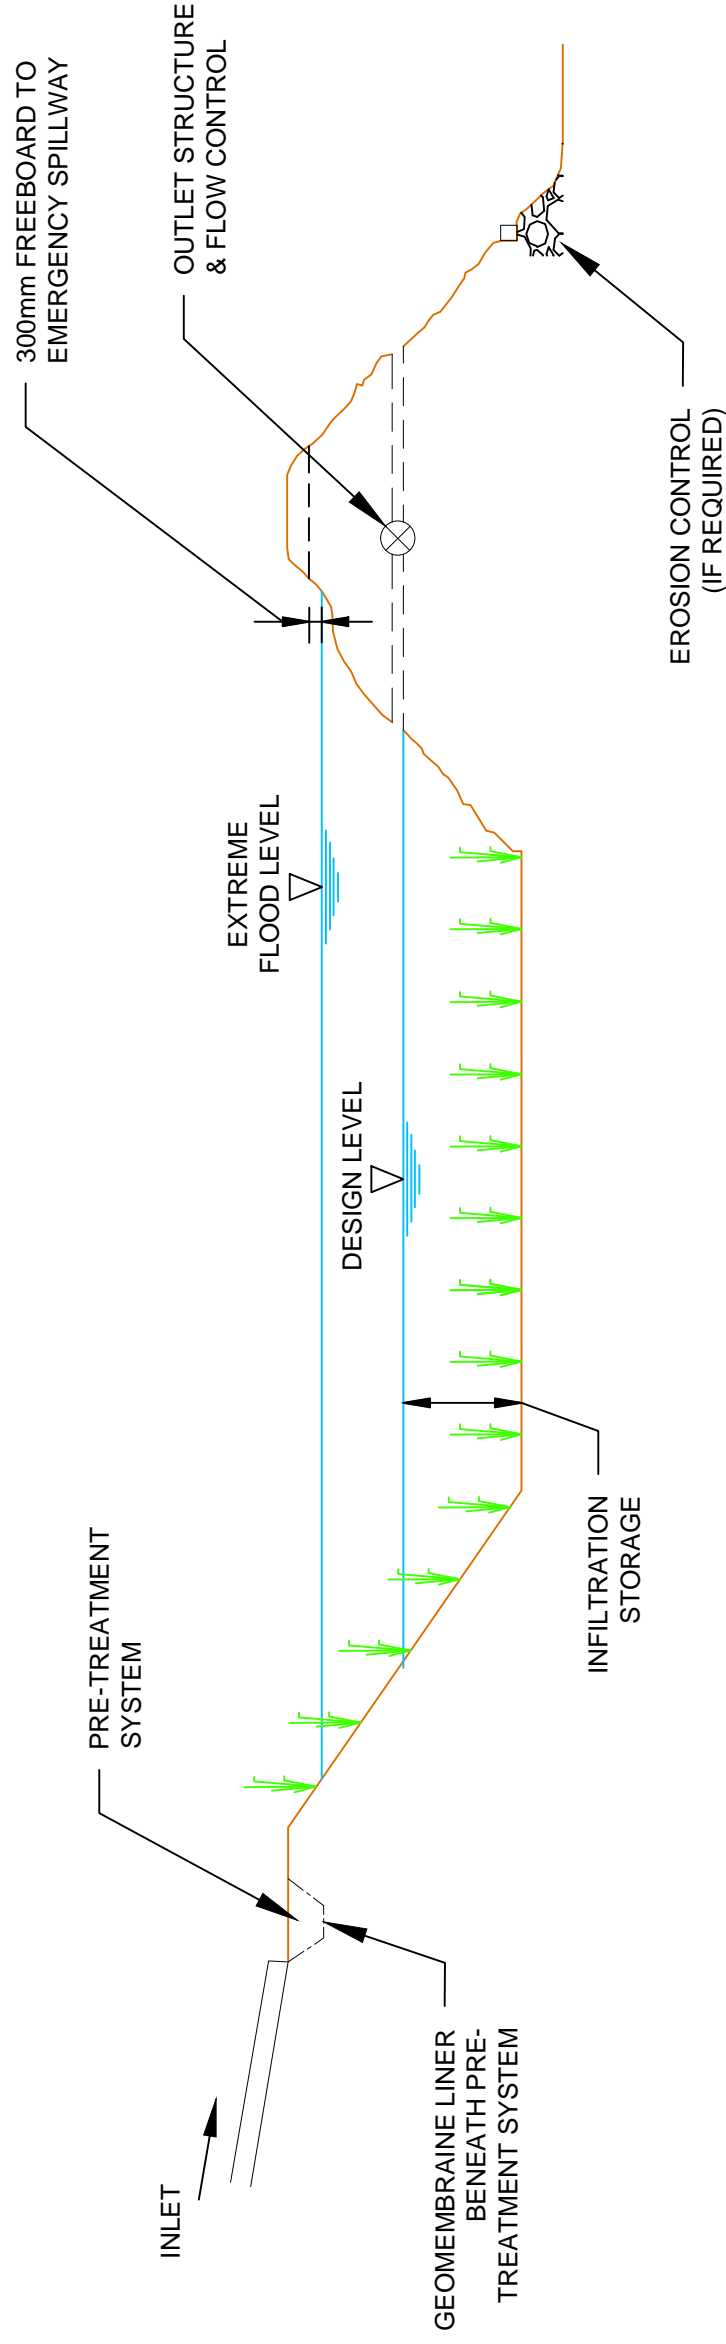

ELEVATION

REV	DATE	BY	DESCRIPTION	CHK

DRAWING STATUS:

PRELIMINARY

**BETTS ASSOCIATES**  
 CIVIL AND STRUCTURAL ENGINEERS  
 Unit 6, Old Marsh Farm Barns, Welsh Road, Sealand, Flintshire CH5 2LY  
 Tel: 01244 288178 Fax: 01244 288516 enquiries@betts-associates.co.uk

PROJECT:


TYPICAL SUDS DETAIL

TITLE:

INFILTRATION BASINS

DATE: SEP 2014	SCALE @ SIZE: @ A3	DRAWN: CP	CHECKED: RDN
PROJECT No: BETTS	DRAWING No: 109	REV: A	

DO NOT SCALE

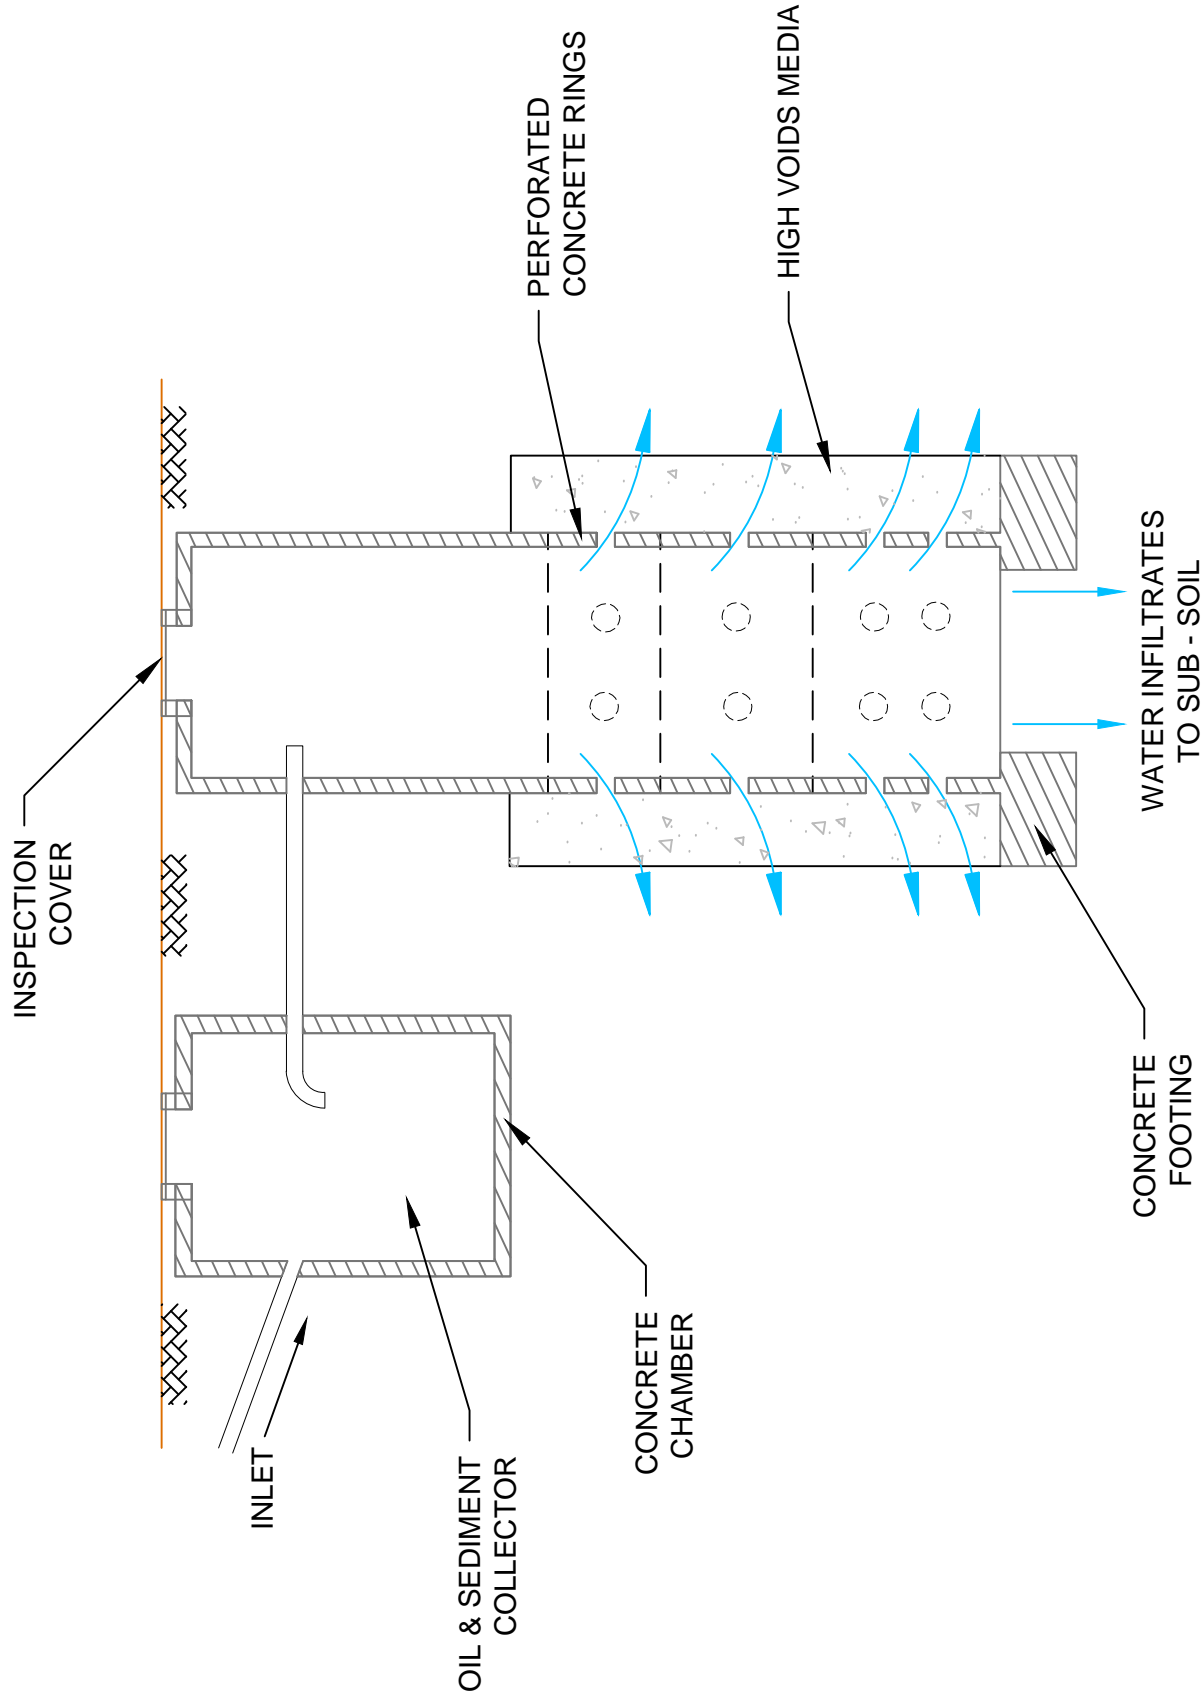

SOAKAWAY DETAILS  
(INCLUDING PRE-TREATMENT DEVICE)

REV	DATE	BY	DESCRIPTION	CHK

DRAWING STATUS: PRELIMINARY

**BETTS ASSOCIATES**  
CIVIL AND STRUCTURAL ENGINEERS  
Unit 6, Old Marsh Farm Barns, Welsh Road, Sealand, Flintshire CH5 2LY  
Tel: 01244 288178 Fax: 01244 288516 enquiries@betts-associates.co.uk

PROJECT:

TYPICAL SUDS DETAIL


TITLE:

SOAKAWAYS


DATE: SEP 2014	SCALE @ SIZE: @ A3	DRAWN: CP	CHECKED: RDN
PROJECT No: BETTS	DRAWING No: 108	REV: A	



DO NOT SCALE

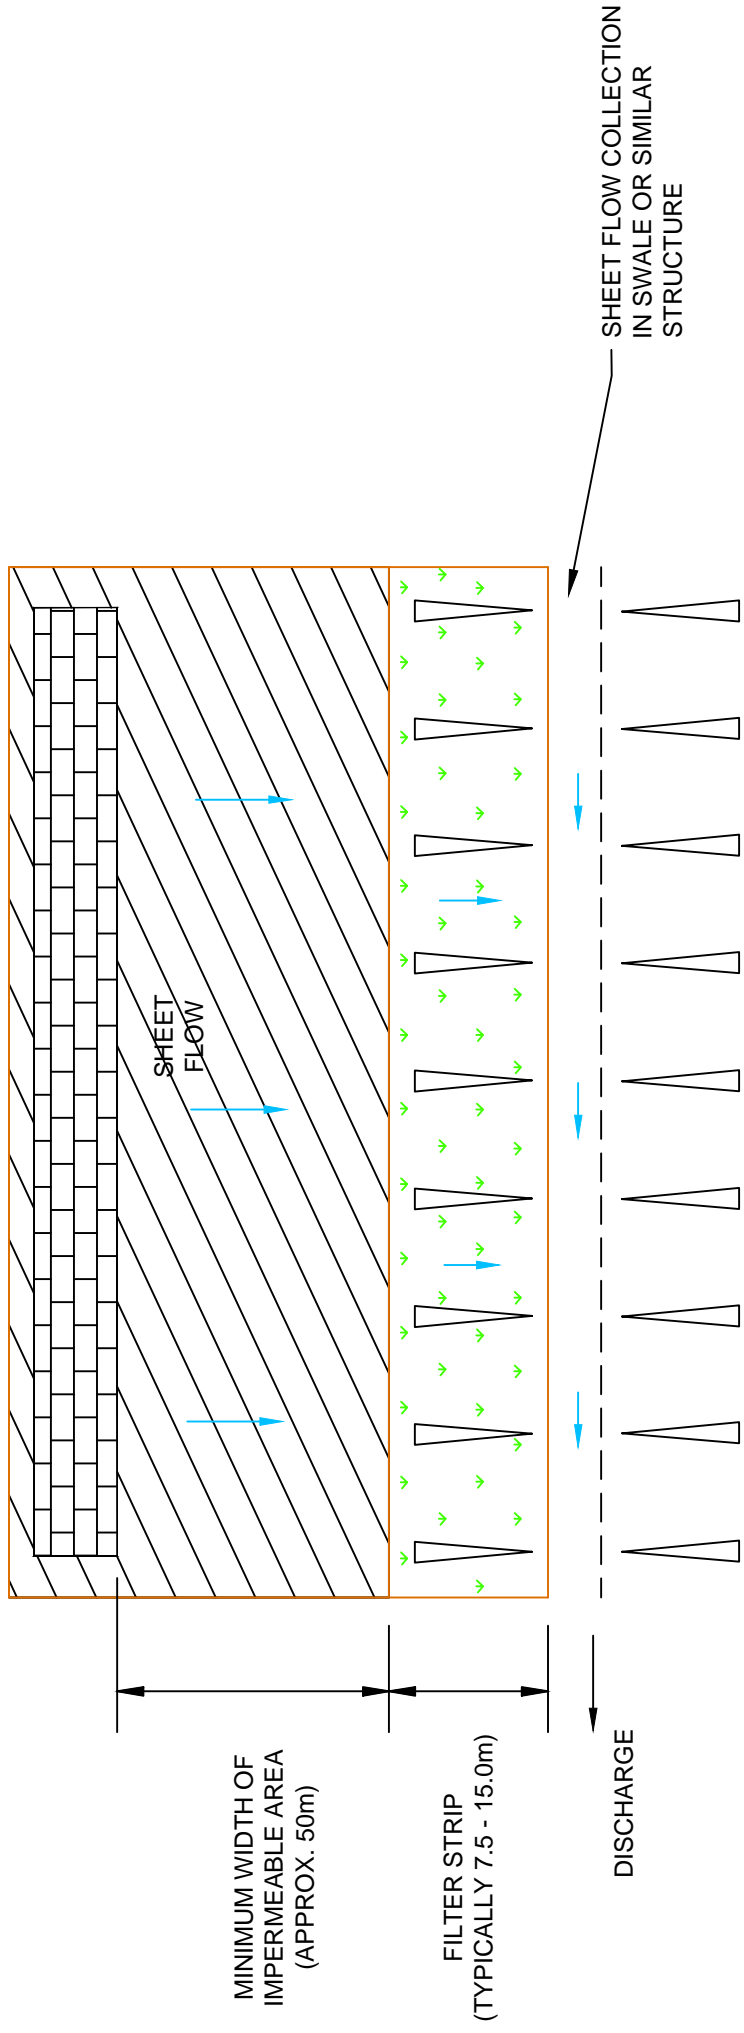

PLAN

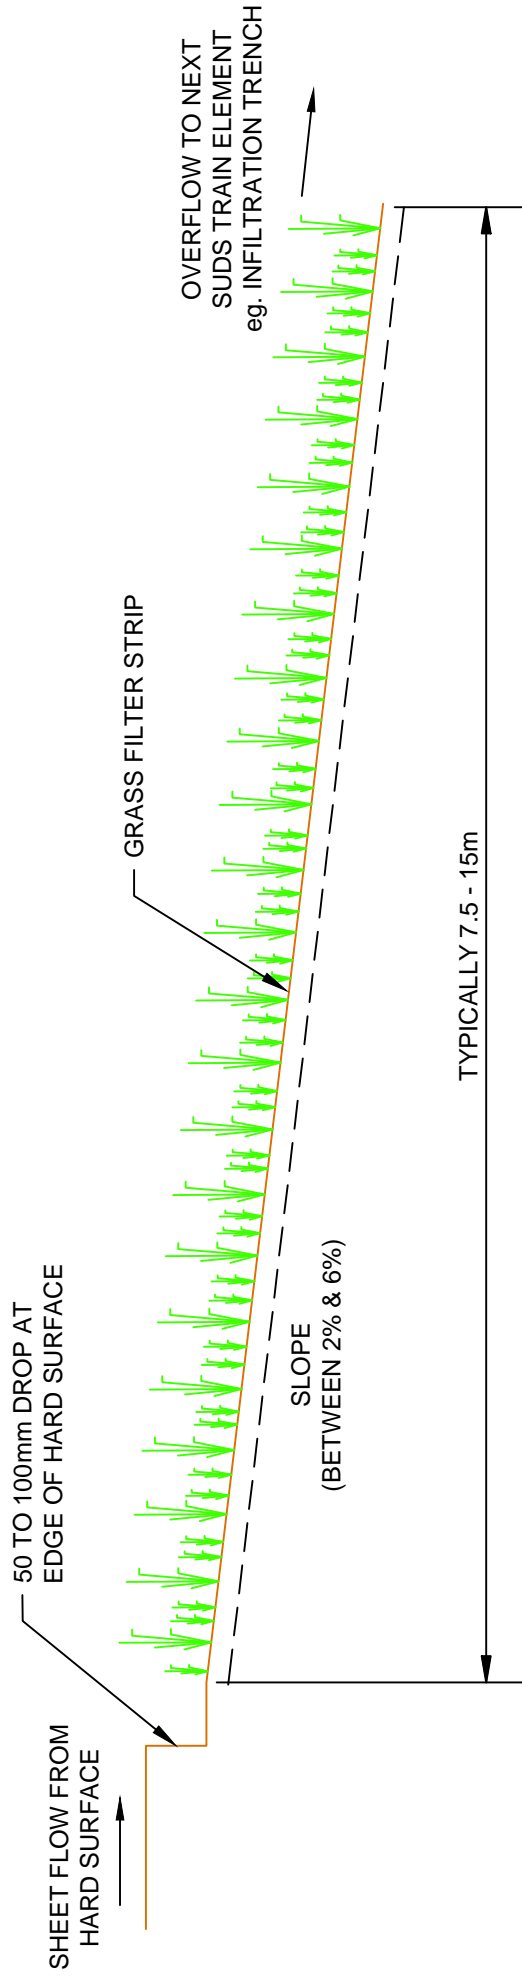

ELEVATION


REV	DATE	BY	DESCRIPTION	CHK
DRAWING STATUS: PRELIMINARY				

**BETTS ASSOCIATES**  
**CIVIL AND STRUCTURAL ENGINEERS**  
 Unit 6, Old Marsh Farm Barns, Welsh Road, Sealand, Flintshire CH5 2LY  
 Tel: 01244 288178 Fax: 01244 288516 enquiries@betts-associates.co.uk

PROJECT:				
TITLE:	TYPICAL SUDS DETAIL			
FILTER STRIPS				

DATE:	SCALE @ SIZE:	DRAWN:	CHECKED:
SEP 2014	@ A3	CP	RDN
PROJECT No:	DRAWING No:	REV:	
BETTS	107	A	


DO NOT SCALE

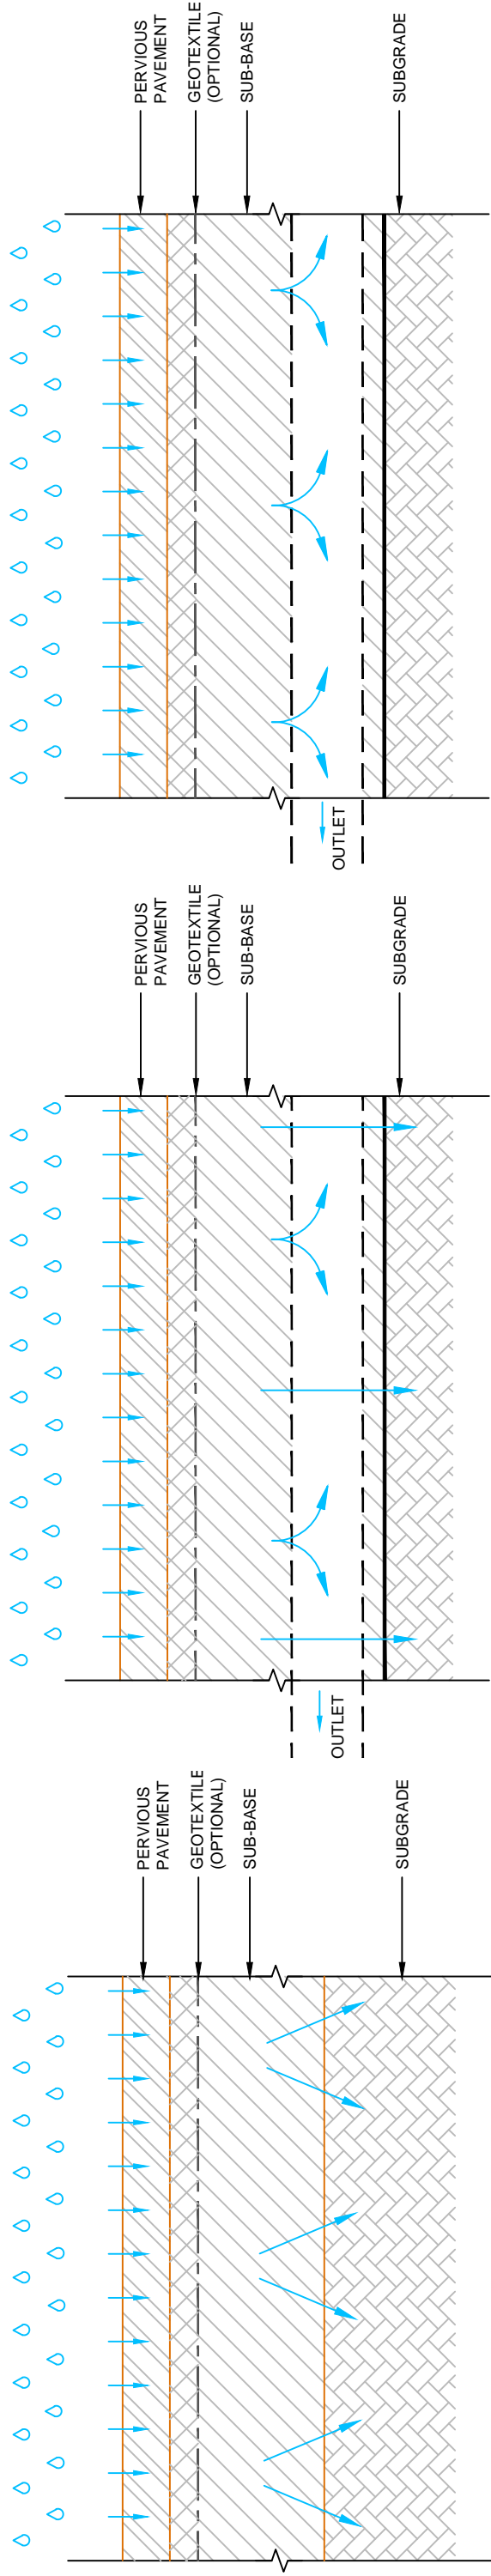

TYPE A: TOTAL INFILTRATION

TYPE B: PARTIAL INFILTRATION

TYPE C: NO INFILTRATION

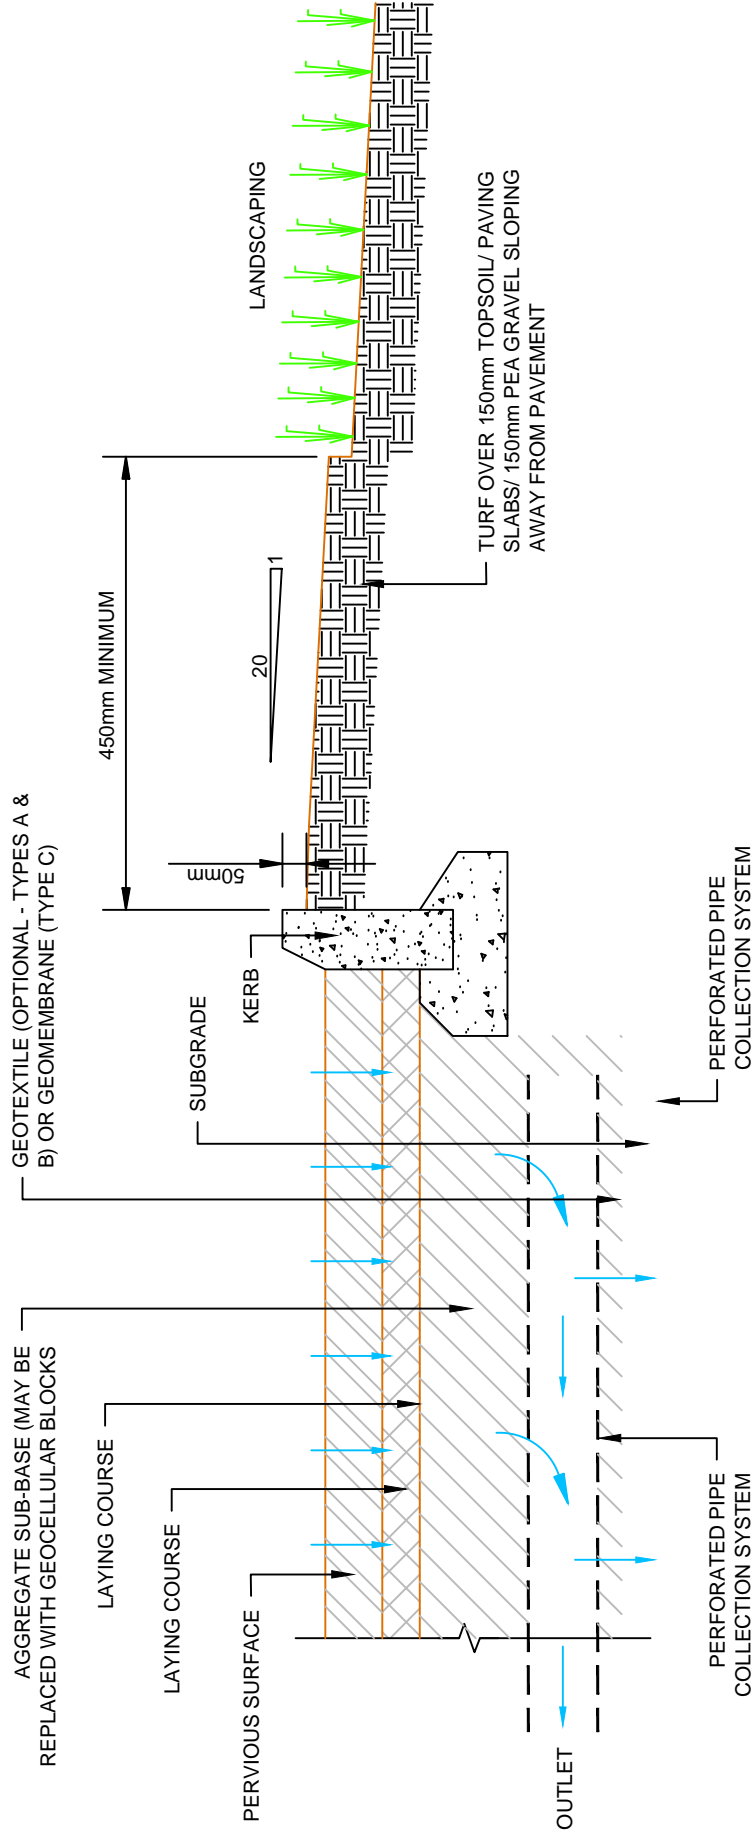

LANDSCAPING DETAIL

REV	DATE	BY	DESCRIPTION	CHK

DRAWING STATUS: **PRELIMINARY**

**BETTS ASSOCIATES**  
 CIVIL AND STRUCTURAL ENGINEERS  
 Unit 6, Old Marsh Farm Barns, Welsh Road, Sealand, Flintshire CH5 2LY  
 Tel: 01244 288178 Fax: 01244 288516 enquiries@betts-associates.co.uk

PROJECT:


TYPICAL SUDS DETAIL

TITLE:

PERVIOUS PAVEMENTS

DATE: SEP 2014	SCALE @ SIZE: @ A3	DRAWN: CP	CHECKED: RDN
PROJECT No: BETTS	DRAWING No: 105	REV: A	

DO NOT SCALE

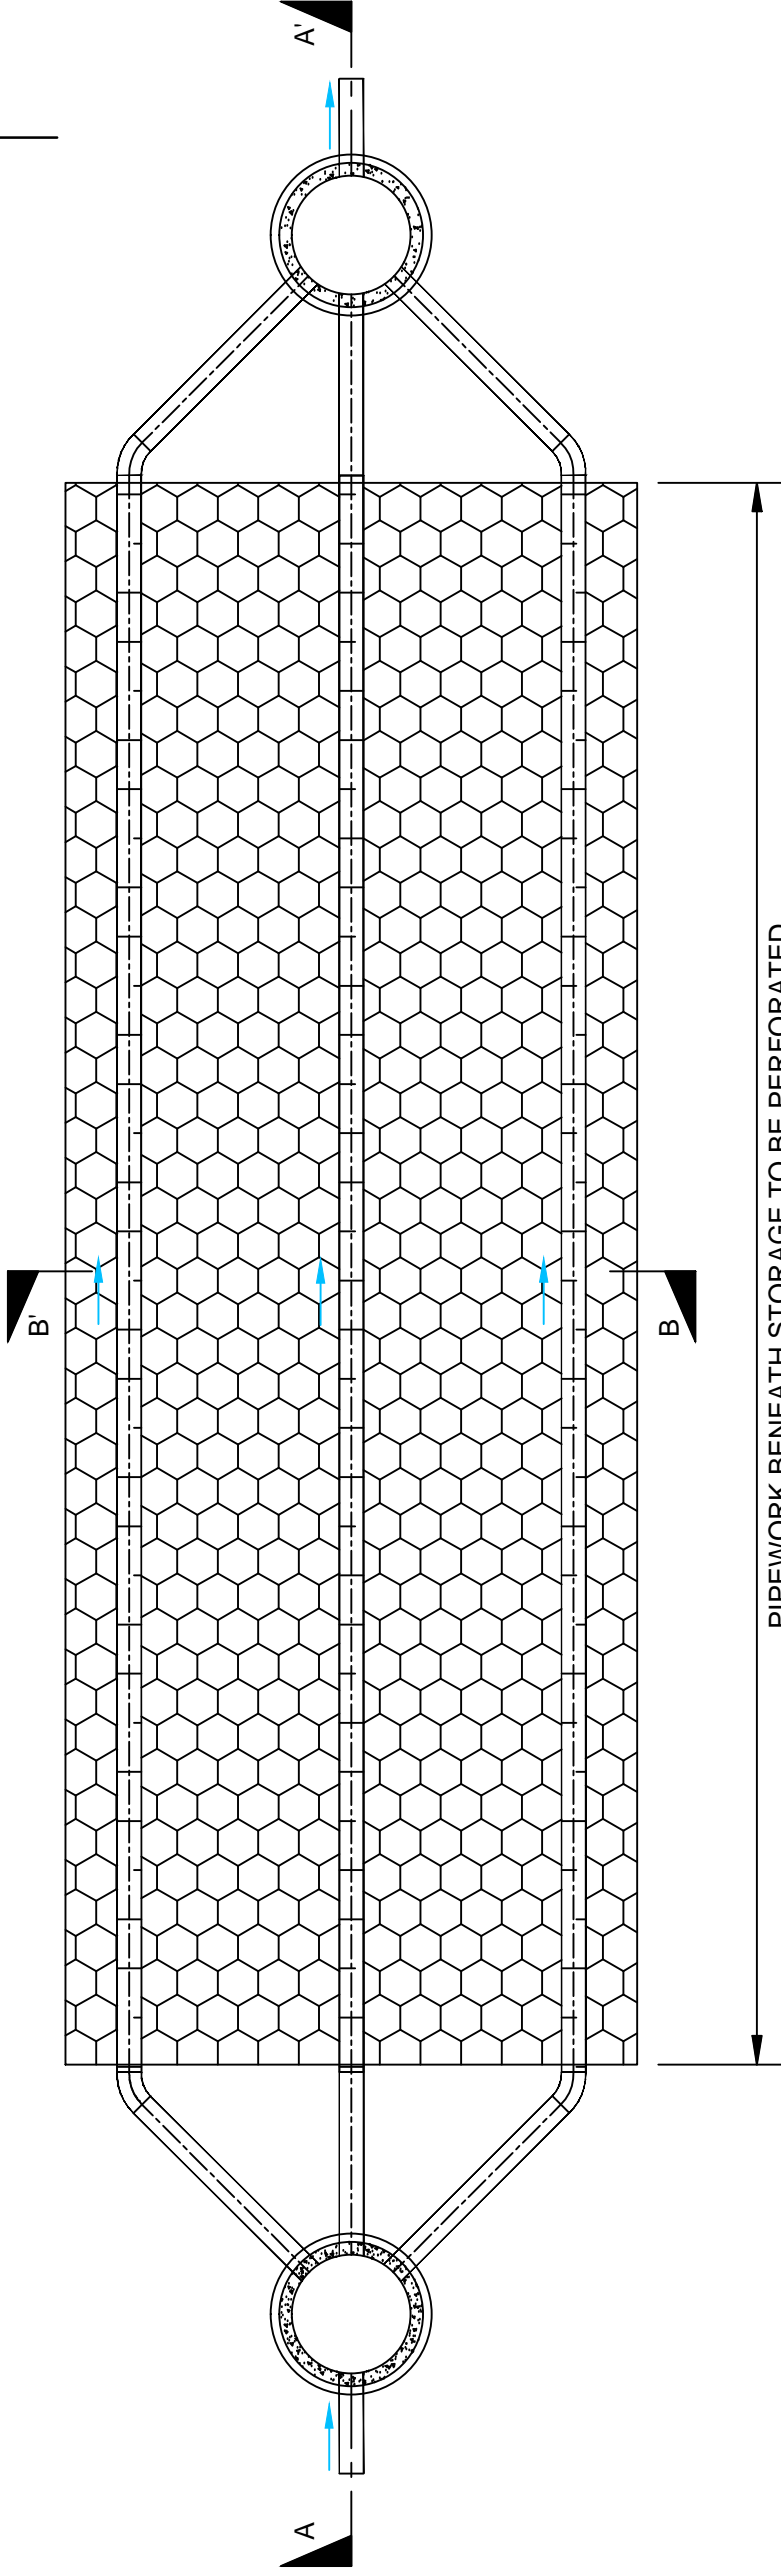


PLAN

REV	DATE	BY	DESCRIPTION	CHK



DRAWING STATUS: **PRELIMINARY**

**BETTS ASSOCIATES**  
**CIVIL AND STRUCTURAL ENGINEERS**  
 Unit 6, Old Marsh Farm Barns, Welsh Road, Sealand, Finlshire CH5 2LY  
 Tel: 01244 288178 Fax: 01244 288516 enquiries@betts-associates.co.uk

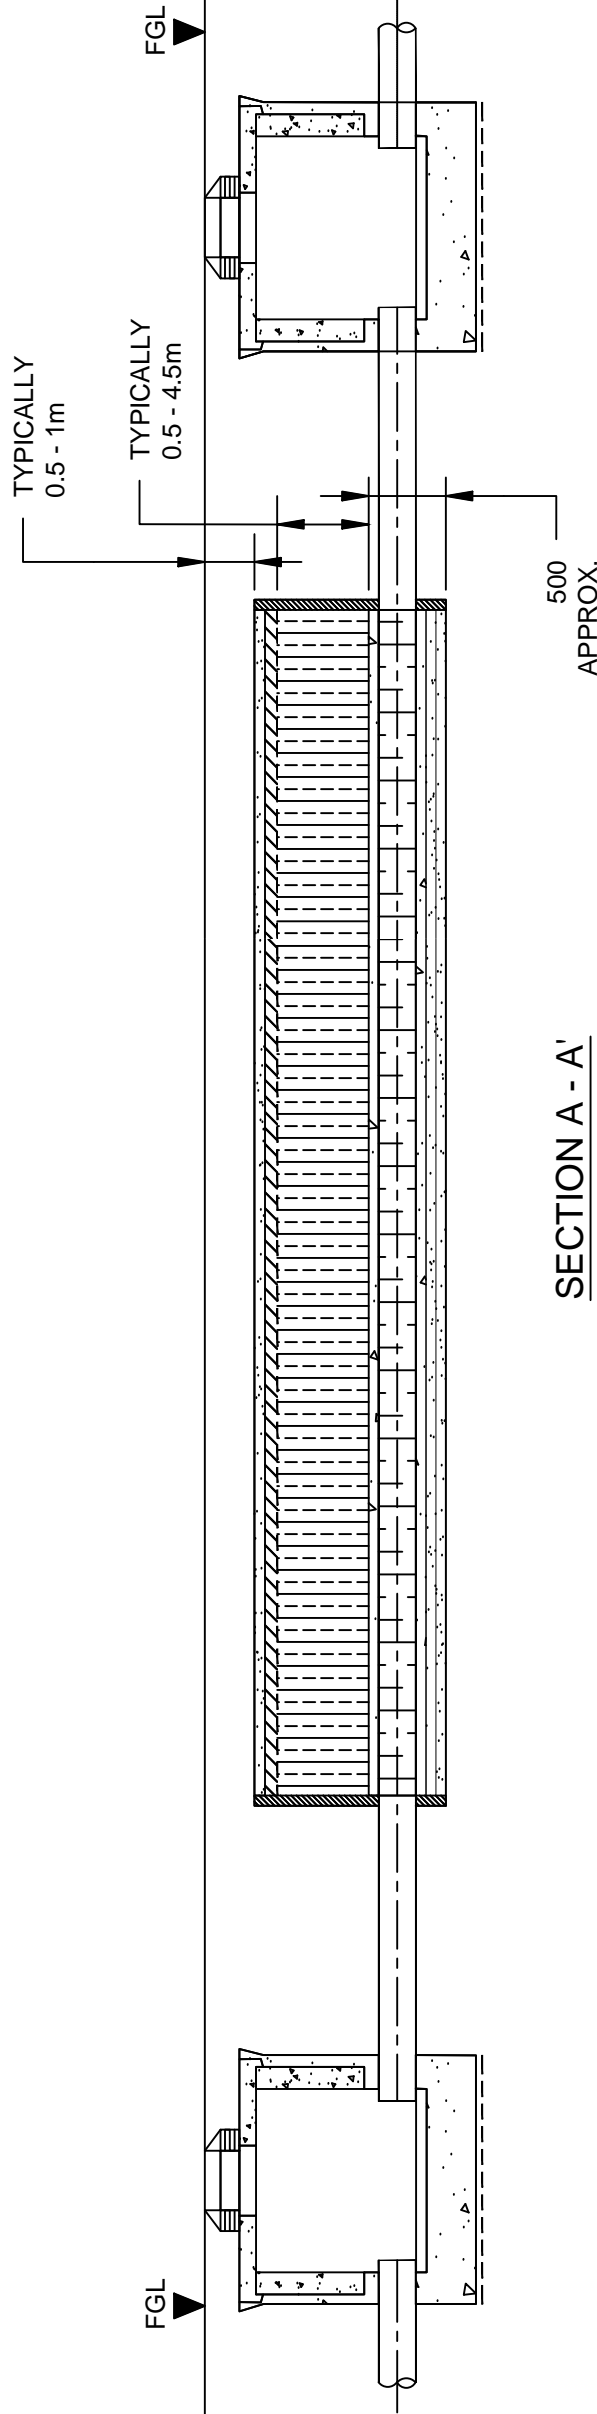

SECTION A - A'

ALL DIMENSIONS AND DEPTHS DEPENDENT ON REQUIRED VOLUME AND LOCAL GROUND CONDITIONS

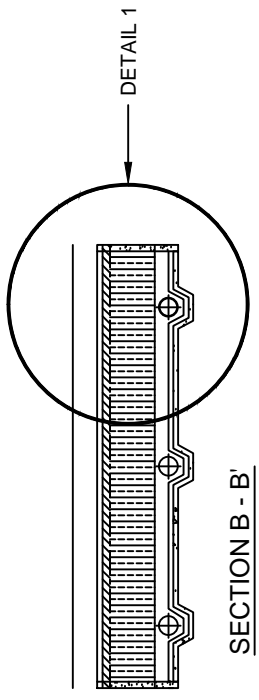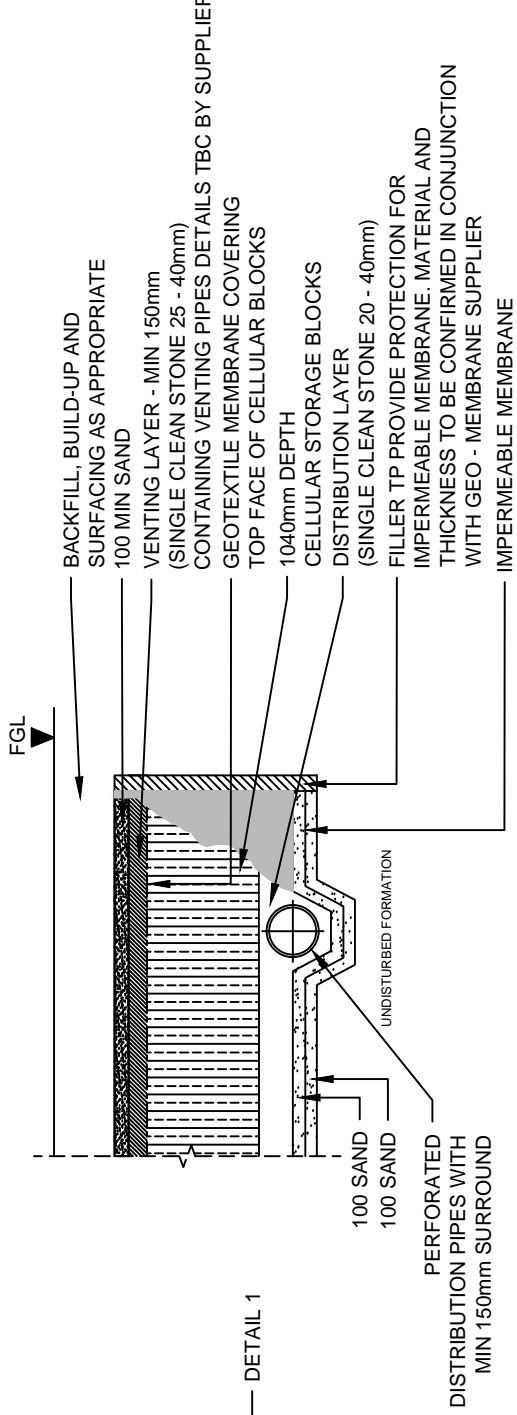


SECTION B - B'


DETAIL 1

PROJECT:	TYPICAL SUDS DETAIL			
TITLE:	CELLULAR STORAGE			
DATE:	SCALE @ SIZE:	DRAWN:	CHECKED:	REV:
SEP 2014	@ A3	CP	RDN	A
PROJECT No:	DRAWING No:		REV:	
BETTS	113		A	

DO NOT SCALE

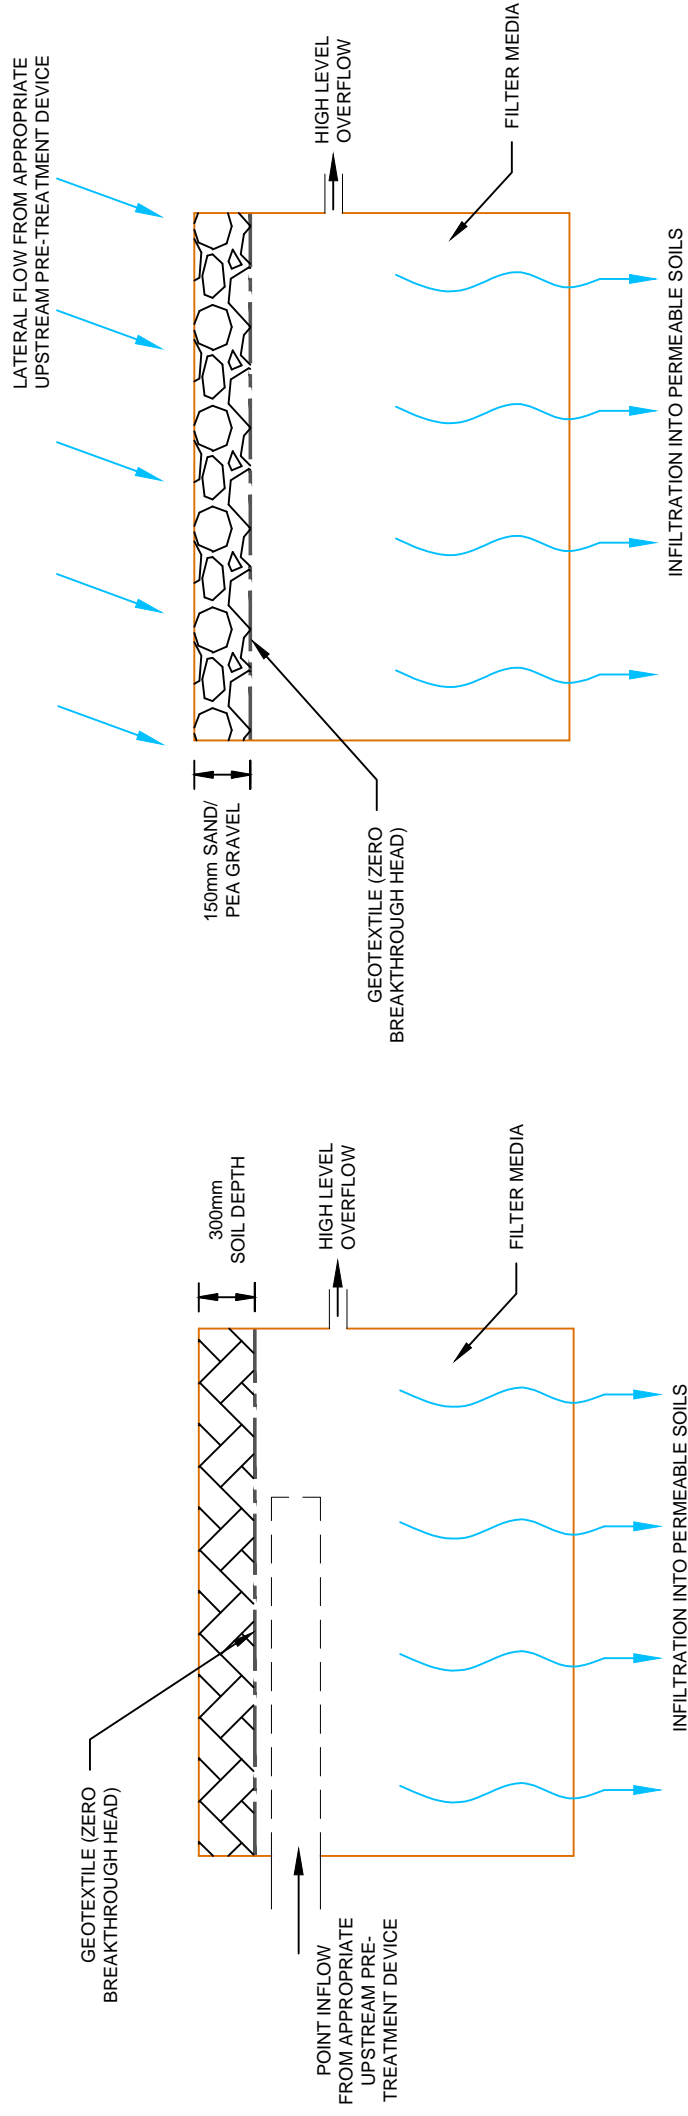

**INFILTRATION TRENCH SCHEMATICS**

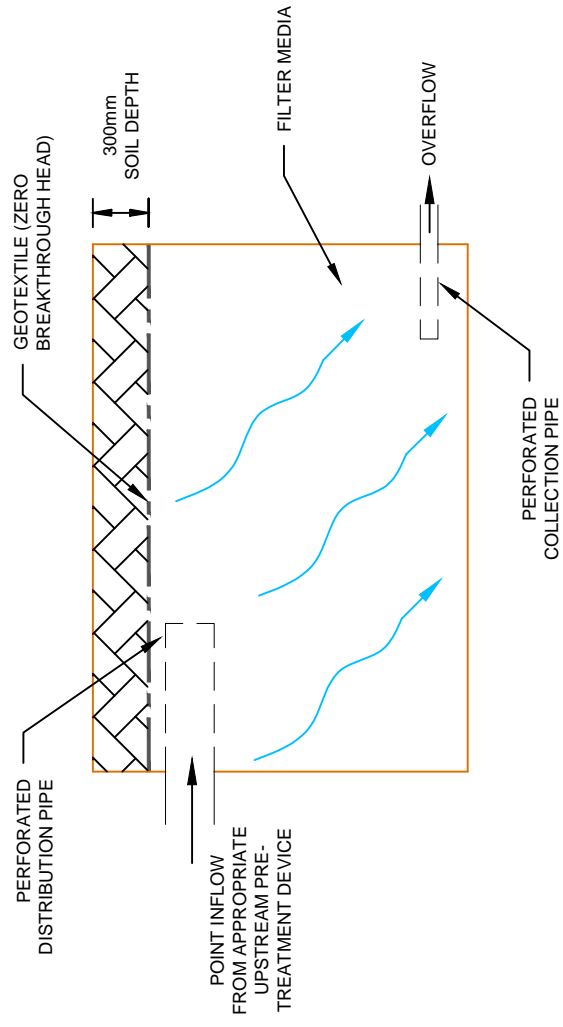

**FILTER TRENCH SCHEMATICS**

DRAWING STATUS: PRELIMINARY

REV	DATE	BY	DESCRIPTION	CHK

**BETTS ASSOCIATES**  
 CIVIL AND STRUCTURAL ENGINEERS  
 Unit 6, Old Marsh Farm Barns, Welsh Road, Sealand, Flintshire CH5 2LY  
 Tel: 01244 288178 Fax: 01244 288516 enquiries@betts-associates.co.uk

PROJECT:

TYPICAL SUDS DETAIL


TITLE:

TRENCHES


DATE: SEP 2014	SCALE @ SIZE: @ A3	DRAWN: CP	CHECKED: RDN
PROJECT No: BETTS	DRAWING No: 105	REV: A	



DO NOT SCALE

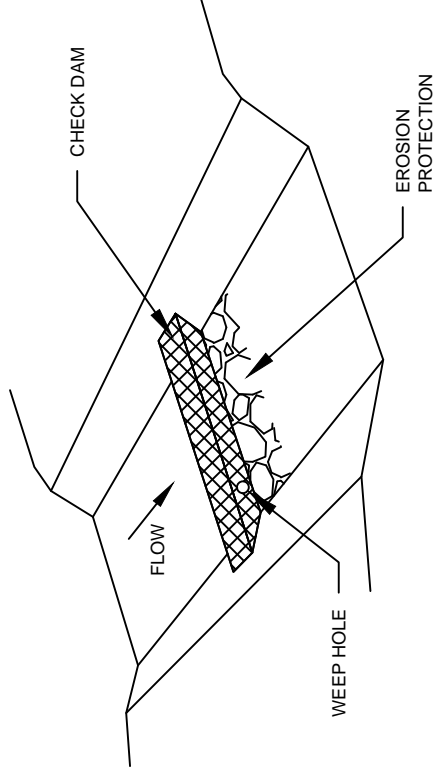


SCHEMATIC

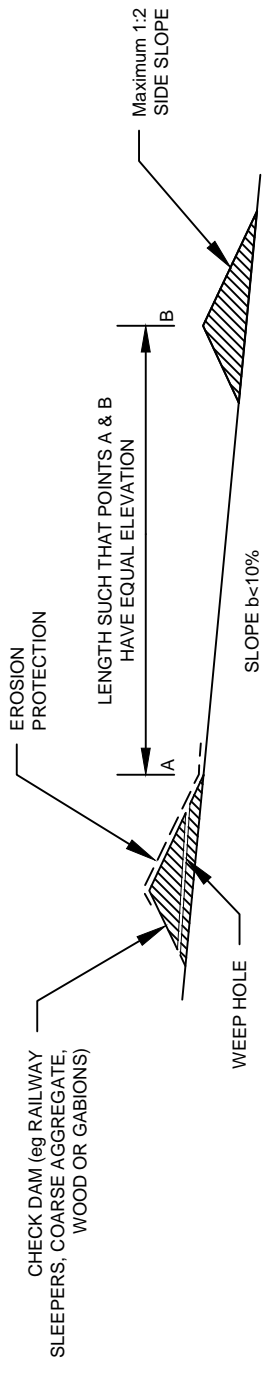

ELEVATION

CHECK DAM

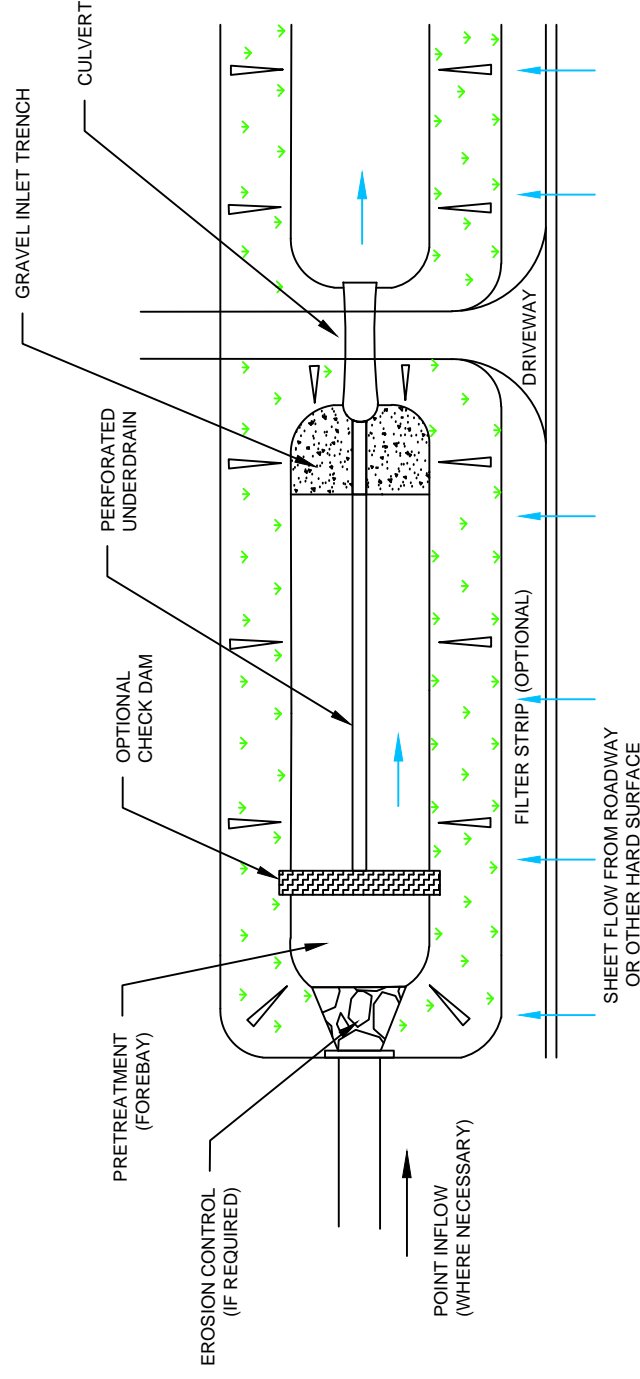

ENHANCED DRY SWALE

REV	DATE	BY	DESCRIPTION	CHK

DRAWING STATUS: **PRELIMINARY**

**BETTS ASSOCIATES**  
**CIVIL AND STRUCTURAL ENGINEERS**  
 Unit 6, Old Marsh Farm Barns, Welsh Road, Sealand, Flintshire CH5 2LY  
 Tel: 01244 288178 Fax: 01244 288516 enquiries@betts-associates.co.uk

PROJECT:

TYPICAL SUDS DETAIL


TITLE:

**SWALES**  
(2 of 2)


DATE: SEP 2014	SCALE @ SIZE: @ A3	DRAWN: CP	CHECKED: RDN
----------------	--------------------	-----------	--------------

PROJECT No: <b>BETTS</b>	DRAWING No: 104	REV: A
--------------------------	-----------------	--------

DO NOT SCALE

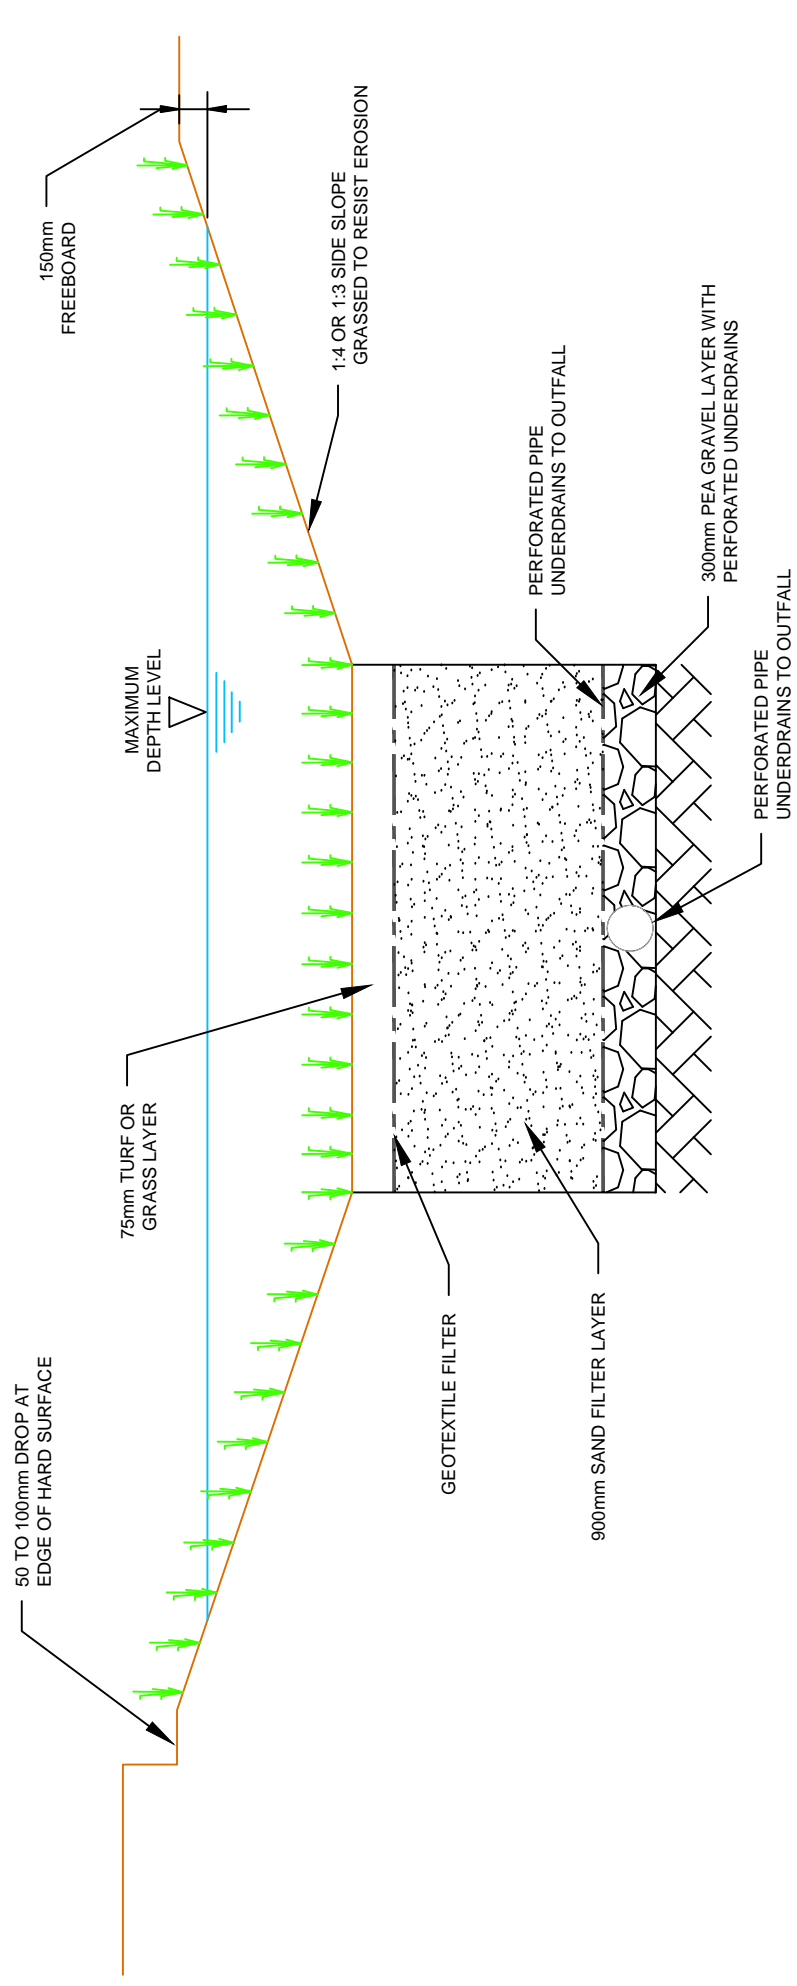

DRY SWALE

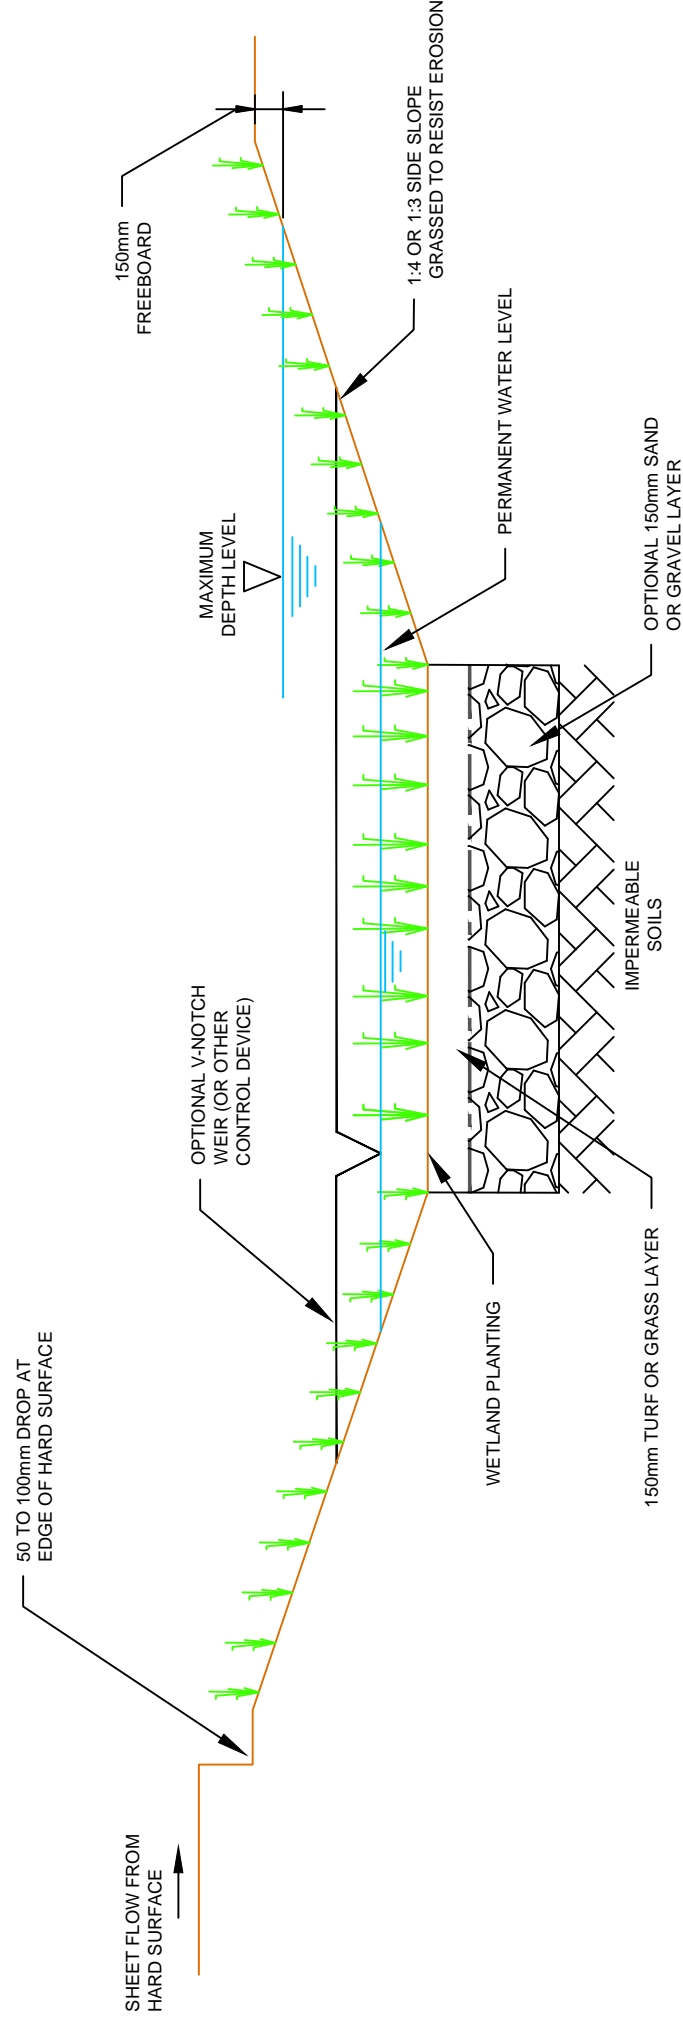

WET SWALE

REV	DATE	BY	DESCRIPTION	CHK
DRAWING STATUS: PRELIMINARY				

**BETTS ASSOCIATES**  
 CIVIL AND STRUCTURAL ENGINEERS  
 Unit 6, Old Marsh Farm Barns, Welsh Road, Sealand, Flintshire CH5 2LY  
 Tel: 01244 288178 Fax: 01244 288516 enquiries@betts-associates.co.uk

PROJECT:  
 TITLE:

TYPICAL SUDS DETAIL

DATE: SEP 2014	SCALE @ SIZE: A3	DRAWN: CP	CHECKED: RDN
PROJECT No: BETTS	DRAWING No: 103	REV: A	

## **APPENDIX N: NOTES OF LIMITATIONS**

---

The data essentially comprised a study of available documented information from various sources together with discussions with relevant authorities and other interested parties. There may also be circumstances at the site that are not documented. The information reviewed is not exhaustive and has been accepted in good faith as providing representative and true data pertaining to site conditions. If additional information becomes available which might impact our conclusions, we request the opportunity to review the information, reassess the potential concerns and modify our opinion if warranted.

It should be noted that any risks identified in this report are perceived risks based on the available information.

This report was prepared by Betts Hydro Ltd for the sole and exclusive use of the titled client in response to particular instructions. Any other parties using the information contained in this report do so at their own risk and any duty of care to those parties is excluded.

This document has been prepared for the titled project only and should any third party wish to use or rely upon the contents of the report, written approval from Betts Hydro Ltd must be sought.

Betts Hydro Ltd accepts no responsibility or liability for the consequences of this document being used for the purpose other than that for which it was commissioned and for this document to any other party other than the person by whom it was commissioned.