


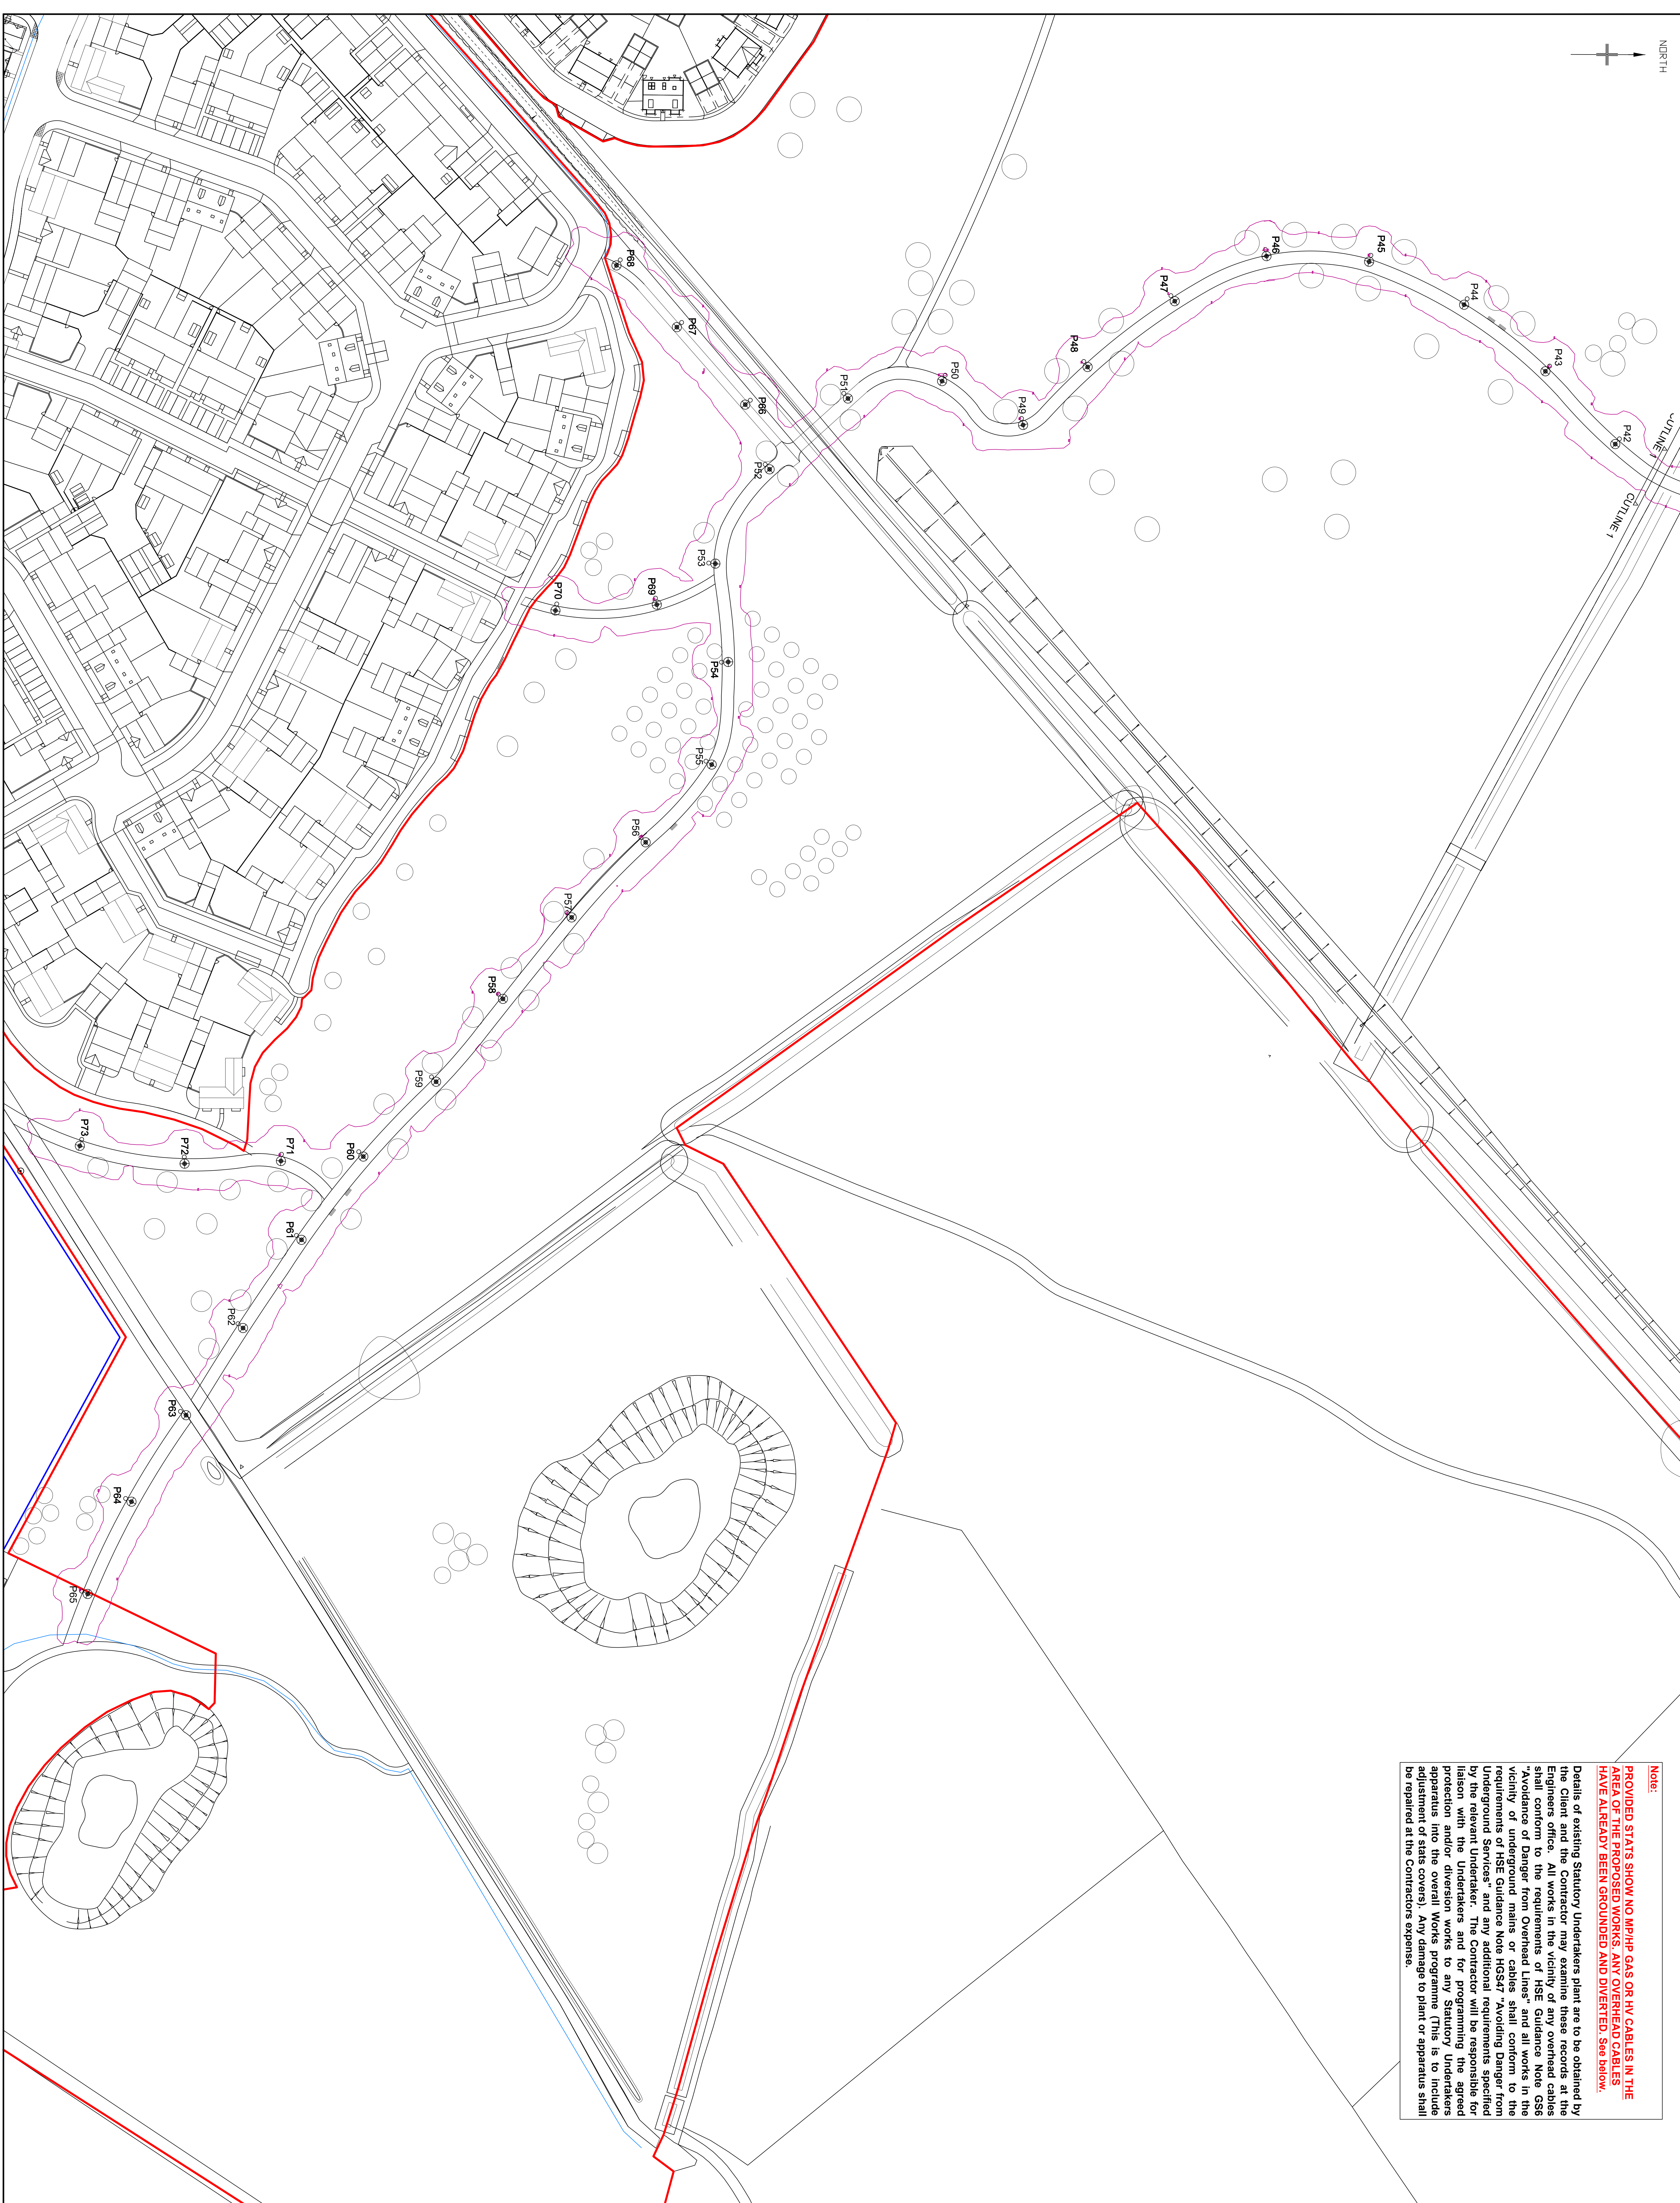
### Street Lighting Key:

Quantity	Symbol	Description
32		<b>Lighting Column - Proposed Base &amp; Lower Fin DW/Widener</b> <i>max galvanized steel column, cast aluminum embossments in ROL 3003 9906.</i> <b>Supply:</b> 32 stainless steel base & lower fin DW/widener, 36" long LED universal luminaire, Isolator, Charles Fiedrich LDFPFB. <b>Supply - Single Phase DNO service</b>


**Note:**

**PROVIDED STATS SHOW NO MPPH GAS OR HV CABLES IN THE AREA OF THE PROPOSED WORKS, ANY OVERHEAD CABLES HAVE ALREADY BEEN GROUNDING AND DIVERTED. See below.**

Details of existing Statutory Undertakers plan are to be obtained from the Client and the Contractor may examine these records at the Engineers office. All works in the vicinity of any overhead cable shall conform to the requirements of HSE Guidance Note 6 "Avoidance of Danger from Overhead Lines and all works in the vicinity of underground mains or cables shall conform to the requirements of HSE Guidance Note HGS47 Avoiding Danger From Underground Services" and any additional requirements specific to the relevant Undertaker. The Contractor will be responsible for the protection and diversion works to any Statutory Undertakers apparatus and the overall Works programme (This is to include replacement of stat covers). Any damage to plant or apparatus is to be repaired at the Contractors expense.



<p><b>NO MOVES SHALL BE CONSIDERED UNTIL THE LOCAL AUTHORITY OF THE DECLARER HAS BEEN ADVISED BY THE SECRETARY OF THE LOCAL AUTHORITY OF THE RESPONDENT. APPROVAL BY THE SECRETARY OF THE LOCAL AUTHORITY OF THE DECLARER IS NOT NECESSARY IF THE MOVES ARE MADE BY THE DECLARER PROVIDED A STATEMENT OF THE GROUNDS FOR THE MOVES IS SUBMITTED TO THE SECRETARY OF TECHNICAL COMMISSIONS/PROVAL.</b></p>			
<p><b>MOVES TO BE MADE IN ACCORD TO ENIGMA ARE:</b></p>			
<p><b>ANY PROPOSED CHAIN:</b></p>			
<p><b>SCHMIDT REVEALED IN ACCORDANCE WITH SECTION 1203-3.80 IN ENIGMA 1203-72501.</b></p>			
<p><b>Longshore Park, Country Club, Monterey - 538</b></p>			
<p><b>Pls. Lighting Code</b></p>			
<p><b>Room # 3001, 3rd Flr. Luncheon Room</b></p>			
<p><b>NOTES:</b></p>			
<p>All usual lighting improvements will be carried out to the satisfaction of the Secretary of the current Order/Illumination Council specifications and to the current satisfaction of the Secretary of the Order/Illumination Council.</p>			
<p>It is the policy of the Order/Illumination Council to improve the lighting quality of existing interiors and exteriors.</p>			
<p>It is the policy of the Order/Illumination Council to plan before commencement of the work.</p>			
<p>In accordance with chapter 6 of the traffic sign manual, all signs shall be placed at far back from the intersection.</p>			
<p>All items which will be placed on any mounted letters shall comply with the following:</p>			
<p>Other items shall be as follows:</p>			
NO	Admission	Date	Initials
NO	Initial Date	22-03-18	AL
NO	Colours indicated to long side	04-01-19	AL

		<b>LIGHTING CONSULTANCY</b>	
		Exterior Lighting Design Specialists	
PO BOX 10000 LONDON W1A 0AA Tel: 020 7491 4000 Email: <a href="mailto:enquiries@mima.co.uk">enquiries@mima.co.uk</a> Web: <a href="http://www.mima-consultancy.co.uk">www.mima-consultancy.co.uk</a>		Project title <b>LONGSFORD PARK          BANBURY</b>	
Drawing title <b>STREET LIGHTING DESIGN          SHEET 2 OF 2</b>		Prepared by AL	
Scale 1:500 @ A0		Checked by MD	
Drawing number MMA/4358/001		Date 22.03.18	
Revision R1			