
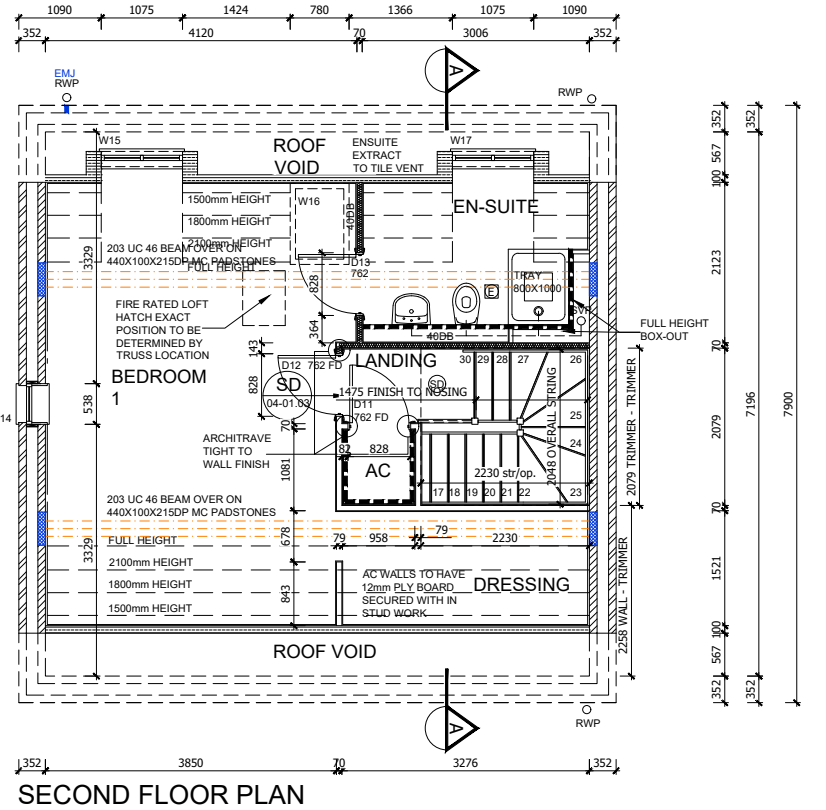
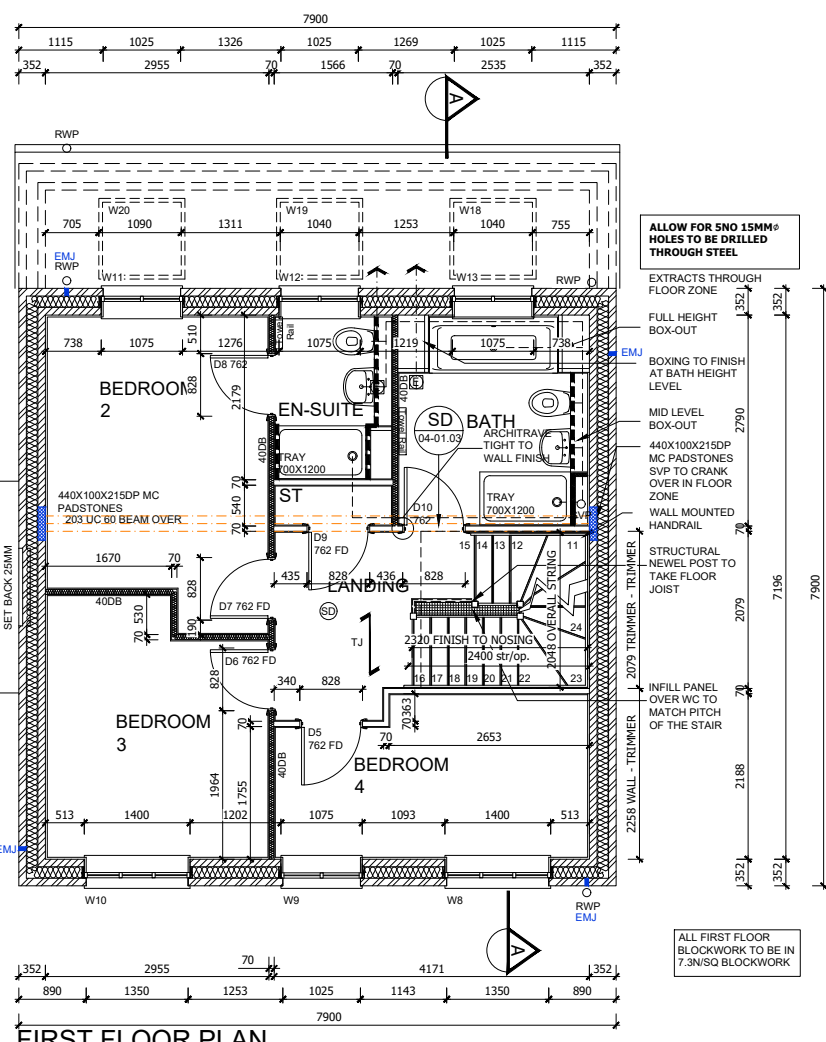


**GENERAL NOTES**

- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL GENERAL ARRANGEMENT AND PROJECT DETAILS DRAWINGS.
- UNLESS NOTED OTHERWISE, ALL DIMENSIONS ARE TO STRUCTURAL FACES AND/OR PARTITION STUDS.
- ABBREVIATIONS USED:-  
EMJ EXTERNAL MOVEMENT JOINT  
HL AT HIGH LEVEL  
AAV AIR ADMITTANCE VALVE  
SVP SOIL AND VENT PIPE  
DP DRAINAGE POINT  
RWP RAIN WATER PIPE  
CJ CONSTRUCTION JOINT
- LEGEND  
FACING BRICKWORK / RENDER FINISH ON 7.2N BLOCKWORK  
ENGINEERING BRICKWORK IN LINE WITH STRUCTURAL ENGINEERS SPECIFICATION  
7.3N/SQ. MM AIRCRETE BLOCK TO GROUND FLOOR ONLY  
3.6N/SQ. MM AIRCRETE BLOCK (550 - 550 KG/M<sup>3</sup>) TO CLIENTS SPECIFICATION. BLOCK STRENGTH TO BE IN ACCORDANCE WITH THE STRUCTURAL ENGINEERS DETAILS. PARTY WALL IN ACCORDANCE WITH ROBUST DETAIL E-WM-30.  
NON-LOADBEARING PARTITION AS FOLLOWS:  
70MM GYPFRAME 'C' STUDS WITH 12.5 MM PLASTER BOARD. MOISTURE RESISTANT BOARD TO BE USED IN WET AREAS.  
PLY INFILL BETWEEN STUDS TO BE USED TO SUPPORT RADIATORS / KITCHEN WALL UNITS ALL IN ACCORDANCE WITH THE CLIENTS SPECIFICATION AND DETAIL.  
25MM ISOVER APR 1200 IN THE STUD CAVITY OR EQUIVALENT APPROVED MATERIAL (TO CLIENT SPECIFICATION) TO ALL BATHROOMS AND BETWEEN BEDROOMS / LIVING SPACES AS INDICATED  
12 MM PLY FOR SANITARYWARE BASINS AND W/C'S INCLUDING BOXING, STUD WALLS AND BUTTRESS WALLS AS INDICATED  
BUTTRESS WALLS 75MM X 100MM TIMBER STUD + 12MM PLY LINING TO STRUCTURAL ENGINEER'S DETAILS  
DENOTES SPAN OF FLOOR OVER (TYPE STATED)  
B&B BEAM & BLOCK  
TJ JOIST SPAN  
TRUSS
- SB DENOTES STRUCTURAL BEAM OVER. FOR ALL STRUCTURAL STEELWORK, PADSTONES, AND MOVEMENT JOINT DETAILS REFER TO THE STRUCTURAL ENGINEER'S DRAWINGS.
- ALL DRAINAGE RUNS TO BE ABOVE FLOOR UNLESS STATED OTHERWISE.
- ALL KITCHEN LAYOUTS TO SPECIALIST'S DESIGN AND DETAILS
- CONTINUOUS MECHANICAL EXTRACTS  
ALL EXTRACT DUCTS TO BE WITHIN THE FLOOR / ROOF SPACE UNLESS NOTED OTHERWISE. REFER TO SPECIALIST'S DRAWINGS FOR DETAILS
- INDICATES EXTRACT LOCATION
- SD DENOTES SMOKE ALARM - TO BE SELF CONTAINED, MAINS FED & INTERCONNECTED, TO COMPLY WITH B.S. 5446 PART 1.  
HD HEAT DETECTOR A100 EI 144 WITH BATTERY BACK UP
- FOR MOVEMENT JOINT, BED JOINT REINFORCEMENT AND ALL STRUCTURAL INFORMATION REFER TO STRUCTURAL ENGINEERS DRAWINGS AND DETAILS
- ALL SVP'S TO BE INSULATED WITH MIN 25MM INSULATION QUILT AND TO BE BOXED IN WITH 25X50 SW TIMBER BATTEN FRAMEWORK AND 2NO LAYERS OF 12.5MM PLASTERBOARD.

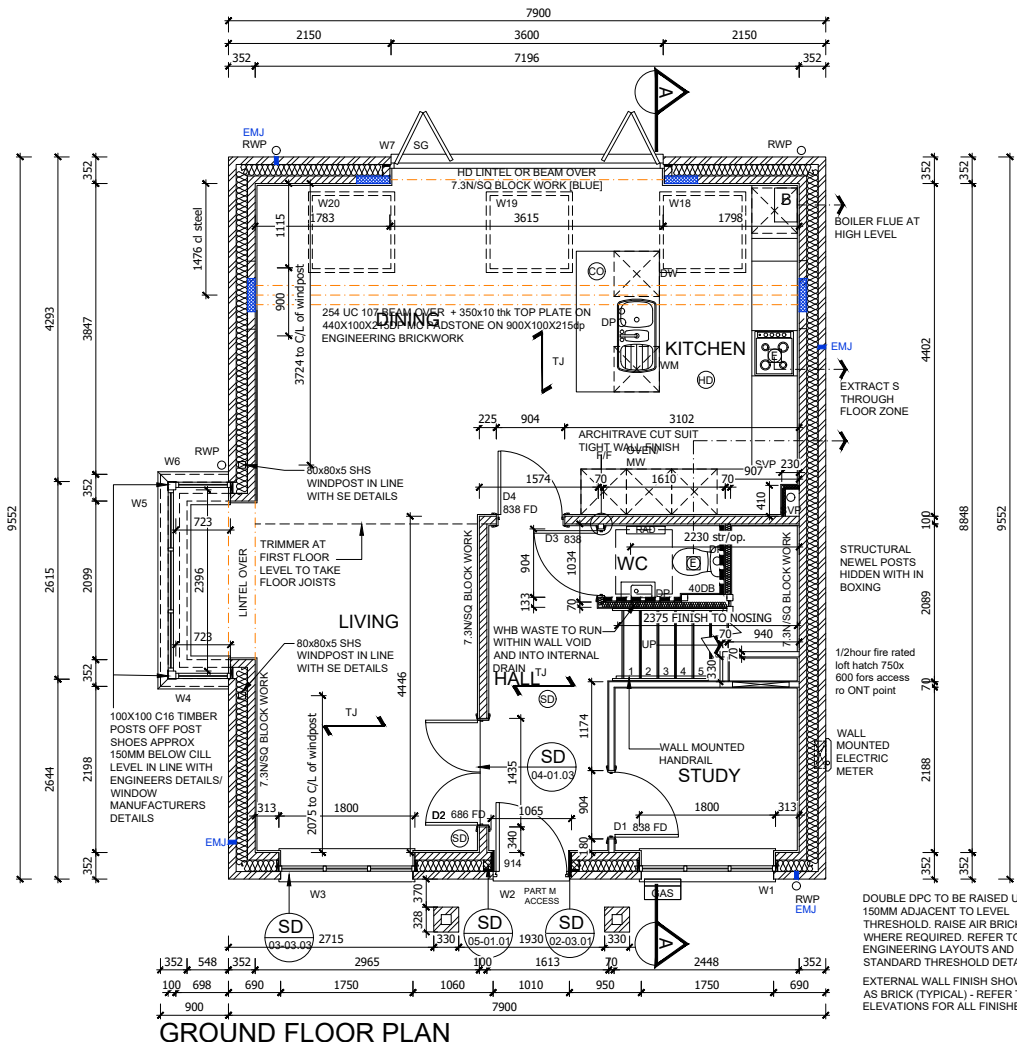

REF	LINTEL REF.	STRUCTURAL OPENING WIDTH X HEIGHT	ROOM NAME	SAFETY GLAZING	REMARKS
W1	L1	1800 X 1725	STUDY	PAS 24	MIN 2500MM <sup>2</sup> TRICKLE VENTILATION
W2	L2	1065 X 2550	HALL	PAS 24	PART M ACCESS, 914X2100 DOOR WITH 450 FAN LIGHT OVER
W3	L3	1800 X 1725	LIVING	PAS 24	MIN 2500MM <sup>2</sup> TRICKLE VENTILATION
W4	L4	723 X 1725	LIVING	PAS 24	MIN 2500MM <sup>2</sup> TRICKLE VENTILATION
W5	L5	2396 X 1725	LIVING	PAS 24	MIN 2500MM <sup>2</sup> TRICKLE VENTILATION
W6	L6	723 X 1725	LIVING	PAS 24	MIN 2500MM <sup>2</sup> TRICKLE VENTILATION
W7	L7	3600 X 2100	DINING	PAS 24	BI-FOLDS
W8	L8	1400 X 1350	BEDROOM 4	NO	MIN 2500MM <sup>2</sup> TRICKLE VENTILATION PIA GLAZING
W9	L9	1075 X 1350	BEDROOM 4	NO	MIN 2500MM <sup>2</sup> TRICKLE VENTILATION PIA GLAZING
W10	L10	1400 X 1350	BEDROOM 3	NO	MIN 2500MM <sup>2</sup> TRICKLE VENTILATION PIA GLAZING
W11	L11	1075 X 1200	BEDROOM 2	NO	MIN 2500MM <sup>2</sup> TRICKLE VENTILATION PIA GLAZING
W12 OB	L12	1075 X 1200	EN-SUITE	NO	MIN 2500MM <sup>2</sup> TRICKLE VENTILATION PIA, OBSCURED GLAZING
W13	L13	1075 X 1200	BATHROOM	NO	MIN 2500MM <sup>2</sup> TRICKLE VENTILATION PIA GLAZING, OBSCURED GLAZING
W14	L14	538 X 1050	BEDROOM 1	NO	MIN 2500MM <sup>2</sup> TRICKLE VENTILATION PIA GLAZING
W15	L15	1075 X 1050	BEDROOM 1	NO	MIN 2500MM <sup>2</sup> TRICKLE VENTILATION PIA GLAZING, OBSCURED GLAZING, DORMER
W16	L16	780 X 978	BEDROOM 1	NO	VELUX WINDOW ROOF LIGHT MK04
W17 OB	L17	1075 X 1050	EN-SUITE	NO	MIN 2500MM <sup>2</sup> TRICKLE VENTILATION PIA GLAZING, OBSCURED GLAZING, DORMER
W18		1140 X 1180	DINING	NO	TOP HUNG ROOF LIGHT
W19		1140 X 1180	DINING	NO	TOP HUNG ROOF LIGHT
W20		1140 X 1180	DINING	NO	TOP HUNG ROOF LIGHT

- NOTES**
- VENTILATION REQUIREMENTS ACHIEVED USING SYSTEM 3 VIA CONTINUOUS MECHANICAL VENTILATION IN ACCORDANCE WITH AD PART F
  - ALL WINDOWS TO HAVE EASY CLEAN HINGES
  - REFERENCES FOR OPENINGS:-  
W= WINDOW OR EXTERNAL DOOR, SG = SAFETY GLAZING, OB = OBSCURED GLAZING  
#= INDICATES EMERGENCY ESCAPE WINDOW TO COMPLY WITH AD PART B1
  - WINDOWS & DOOR CILL REQUIREMENTS AS FOLLOWS:  
BRICK WORK - TO HAVE EXTENDED CILL TO WINDOWS (STANDARD CILL TO DOORS)  
CAST STONE CILLS - TO HAVE STUB CILL  
TILED CILLS - TO HAVE STANDARD CILL
  - SAFETY GLAZING TO BE INSTALLED IN ALL EXTERNAL DOORS AND THE BOTTOM PANE ONLY OF WINDOWS AS NECESSARY. GLAZING TO COMPLY WITH AD PART N. (THE BOTTOM PANE ONLY OF 1ST FLOOR WINDOWS IS TO ACT AS GUARDING AGAINST FALLING AS NECESSARY, THESE WINDOWS MUST HAVE AN INTERNAL PANE OF LAMINATED GLASS, AND BOTH PANE AND FRAME DESIGNED TO RESIST THE HORIZONTAL FORCE GIVEN IN BS6399:PART1:1996
  - FOR DETAIL OF LINTELS REFER TO MANUFACTURERS SCHEDULES. ALL LINTELS IN EXTERNAL WALLS TO BE FITTED WITH INTEL SOFFIT CLADDING AND WITH FLEXIBLE DPM IN ACCORDANCE WITH MANUFACTURERS INSTRUCTIONS
  - ALL WINDOW AND DOOR SIZES TO BE CHECKED ON SITE PRIOR TO MANUFACTURE

**GENERAL NOTES (EXTERNAL DOOR & WINDOW SCHEDULE)**

ALL EXTERNAL DOOR & WINDOW SCHEDULES ARE TO BE READ IN CONJUNCTION WITH CONSTRUCTION SPECIFICATION, FOR CONFIRMATION OF DOOR & WINDOW SWINGHANDING, REFER TO RELEVANT GENERAL ARRANGEMENT FLOOR PLANS AND ELEVATIONS.  
THE EXTERNAL DOOR & WINDOW OPENINGS INDICATED IN THIS SCHEDULE ARE STRUCTURAL & SUFFICIENT TOLERANCE MUST BE ALLOWED FOR THE THICKNESS OF THE CAVITY CLOSER & BUILDING THE WINDOW WITHIN THE STRUCTURE OR POST FIXING WINDOW. ALL CAVITY BARRIERS/CLOSERS TO BE A MINIMUM 30 MINUTES FIRE RATED IN ACCORDANCE WITH APPROVED PART B GUIDELINES FOR FULL DETAILS OF LINTELS OVER OPENINGS, REFER TO MANUFACTURERS DETAILS AND STRUCTURAL ENGINEERS DESIGN DETAILS & SPECIFICATION.  
PROVIDE STANDARD DOUBLE GLAZED (BS EN 1279-1:2004) DRAUGHT SEALED PVCu WINDOWS MANUFACTURED TO BS 7412. OBSCURE GLAZING TO WCs, ENSUITES & BATHROOMS.  
ALL ESCAPE WINDOWS TO HAVE PIA APPROVED GLAZING.  
ALL GROUND FLOOR & EASILY ACCESSIBLE WINDOWS TO BE DESIGNED TO PAS24:2016.  
ALL WINDOWS TO BE FITTED WITH RESTRICTORS FOR SECURITY AND TO PROVIDE VENTILATION TO AVOID SUMMER OVER HEATING.  
ALL WINDOWS ABOVE GROUND FLOOR TO BE FITTED WITH RESTRICTORS WITH A RELEASE CATCH.  
GLAZING BELOW 800mm (MEASURED FROM FLOOR LEVEL) IN SCREENS AND WINDOWS AND BELOW 1500mm (MEASURED FROM FLOOR LEVEL IN DOORS) INCLUDING ANY SIDELIGHTS WITHIN 300mm OF THE DOOR SHALL BE TOUGHENED SAFETY GLASS TO BE 6282: PART 4.

REF	LINTEL	DOOR LEAF SIZE	STRUCTURAL OPENING WIDTH X HEIGHT	ROOM NAME	REMARKS
D1 (FD)		838 X 1981	904 X 2050	STUDY	
D2 (FD)	L15	2NO 686 X 1981	1435 X 2050	LIVING	DOUBLE DOORS, 100MM BLOCKWORK WALL
D3		838 X 1981	904 X 2050	WC	
D4 (FD)		838 X 1981	904 X 2050	KITCHEN	
D5 (FD)		762 X 1981	828 X 2050	BEDROOM 4	
D6 (FD)		762 X 1981	828 X 2050	BEDROOM 3	
D7 (FD)		762 X 1981	828 X 2050	BEDROOM 2	
D8		762 X 1981	828 X 2050	EN-SUITE	
D9 (FD)		762 X 1981	828 X 2050	STORE	
D10		762 X 1981	828 X 2050	BATHROOM	
D11 (FD)		762 X 1981	828 X 2050	STORE	
D12 (FD)		762 X 1981	828 X 2050	BEDROOM 1	
D13		762 X 1981	828 X 2050	EN-SUITE	

**NOTES**

- REFERENCES FOR OPENINGS:-  
D= INTERNAL DOOR, FD= FIRE DOOR FOR 20 MIN.
- ALLOW 10MM AIR GAP UNDER DOORS TO ALL ROOMS EXCEPT STORE AREAS
- FOR DETAILS OF LINTELS REFER TO MANUFACTURER'S SCHEDULES
- STRUCTURAL OPENING SIZES BASED ON LEAF SIZE + 35X2 DOOR FRAME. STRUCTURAL OPENINGS WILL VARY FOR ANY OTHER DOOR FRAME SIZE.
- DOOR HEIGHTS ASSUME CARPET FINISH. ALTERNATIVE FINISHES MAY AFFECT DOOR SETTING OUT.


REF /	NET AREA		GROSS AREA	
	m <sup>2</sup>	ft <sup>2</sup>	m <sup>2</sup>	ft <sup>2</sup>
GROUND FLOOR	64.63	695.67	65.47	704.71
FIRST FLOOR	51.06	549.60	51.78	557.35
SECOND FLOOR	42.15	453.69	42.83	461.01
TOTAL	157.84	1698.96	160.08	1723.07

**NOTES**

NET AREA = AREA MEASURED WITHIN THE BOUNDARY OF THE PLASTER FINISH TO EXTERNAL WALL AND SLOPING CEILINGS AT 1500MM ABOVE FFL.  
GROSS AREA = AREA MEASURED WITHIN THE BOUNDARY OF THE INNER STRUCTURAL FACE OF THE EXTERNAL WALL AND SLOPING CEILINGS AT 1200MM ABOVE FFL.

PHASE 9A PLOTS - (AS) 535  
- (OPP) 532  
PHASE 9D PLOTS - (AS) 670, 704  
PHASE 9E PLOTS - (AS) 787  
- (OPP) 760,780,786

Revision	Date	Description	By
C1	19.02.21	Construction Issue	MJR
C2	06.05.21	Minor updates to client comments	MJR
C3	21.05.21	40db walls noted, minor updates	MJR
C4	15.06.21	Window Refs added	MJR



Site Address: UPPER HEYFORD, PHASE 9 BICESTER

Drawing Title: HOUSE TYPE SP1 V2 GROUND, FIRST & SECOND FLOOR PLANS

Scale: 1:50 @ A1 Date drawn: FEB 21 Drawn by: MJR

Project Number: 727 Drawing Number: HTSP1V2-09-02 Revision: C4

Status: **CONSTRUCTION ISSUE**