


**DETAIL OF FOOTWAY REMOTE FROM CARRIAGEWAY**

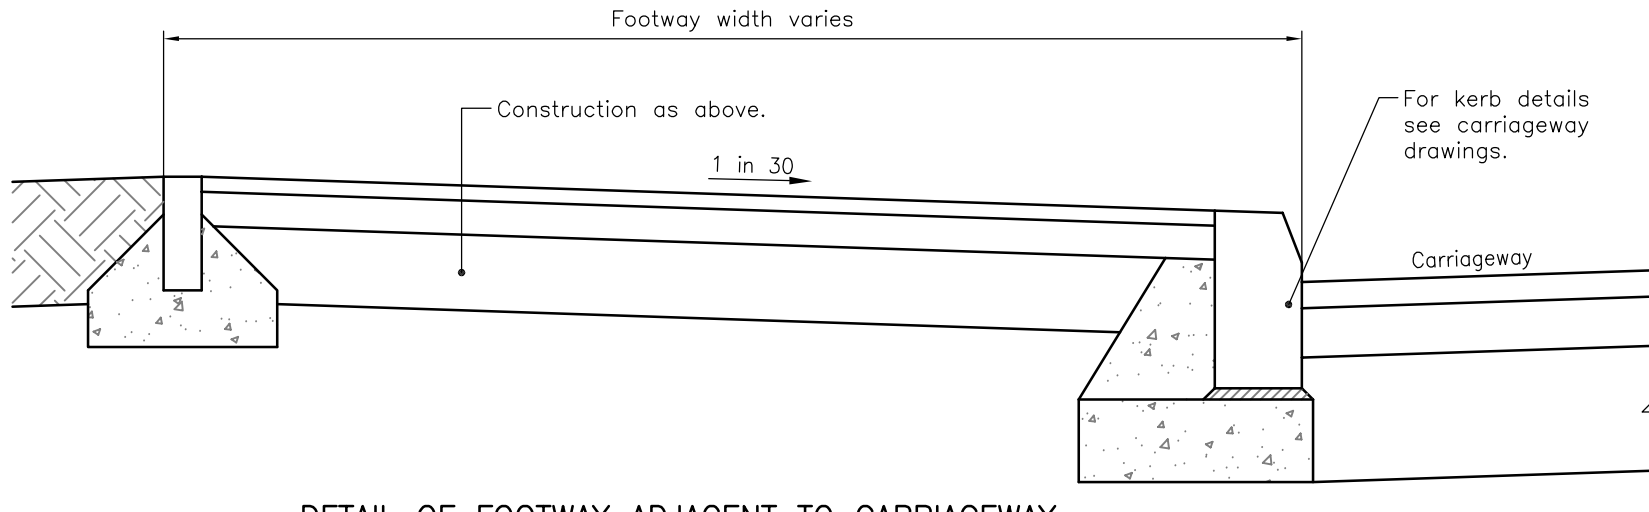

**DETAIL OF FOOTWAY ADJACENT TO CARRIAGEWAY**

**NOTES**

1. All dimensions are in millimetres unless shown otherwise.
2. For location of footways, widths, edge details and setting out information see scheme drawings schedules.
3. Sub-base material shall comply with clause 803 or 804 and have a minimum CBR value of 20%.
4. Surface dressing shall comply with clause 919 of the specification and consist of bitumen emulsion binder Type K1-70 (1.5 litres/m<sup>2</sup>) and 10mm uncoated chippings (7 Kg/m<sup>2</sup>).
5. Kerbs and edgings shall be laid in accordance with clause 1101.
6. Prior to laying the sub-base material the formation shall be treated with a granular residual herbicide containing Dichlobenil. Application shall comply with manufacturers recommendations.
7. Where specified in Appendix 11/1 a weed suppressing geotextile shall be laid under the sub-base and edging concrete.



**Footways: Footway Type 3**

**Kerbs, Footways & Paved Areas**

© Unauthorised reproduction infringes copyright

SCALE

Not to Scale

INITIALS	DATE	
DRAWN	RVA	12.2005
TRACED	ALB	12.2005
CHECKED	AMM	4.2007

INDEX	AMENDMENT	DATE
-	SECOND ISSUE	10.05.08

DRAWING No. **HSD/1100/015** CATEGORY **1**