


NOTES

1. All dimensions are in millimetres unless shown otherwise.
2. Dimension x is the external diameter of the duct.
3. N is the number of ducts specified.
4. Concrete finish to be class U1 to clause 1708.
5. Where flexibly jointed pipes are used with concrete bedding or surround a flexible joint shall be made in the concrete in accordance with clause 504.5 using preformed filler to clause 1015 25mm thick.
6. Backfilling shall not be carried out until after the concrete has cured.
7. This drawing should be read in conjunction with Appendix 5/2.



**DESIGN GROUP E6
MULTIPLE DUCTS**

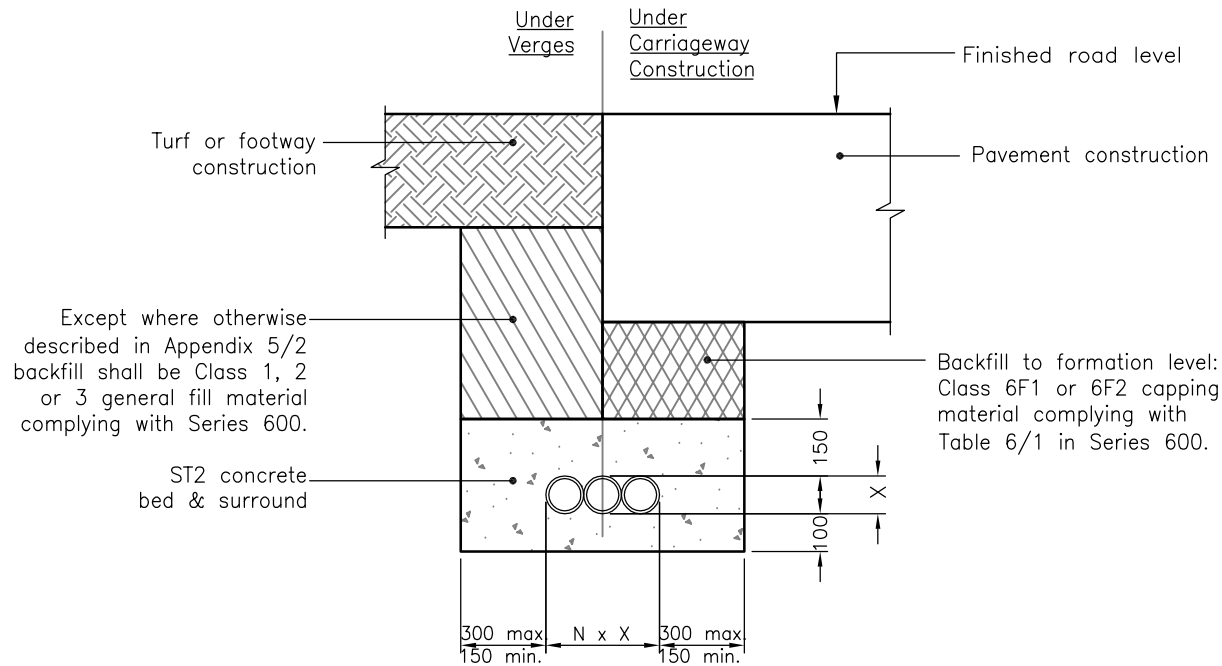

Ducts: Design Group E6 – Multiple Ducts

Drainage & Service Ducts

© Unauthorised reproduction infringes copyright

SCALE
Not to Scale

INITIALS	DATE
DRAWN RVA	11.2005
TRACED ALB	11.2005
CHECKED AMM	4.2007

INDEX	AMENDMENT	DATE
–	SECOND ISSUE	10.05.08

DRAWING No. **HSD/500/080** CATEGORY **1**