
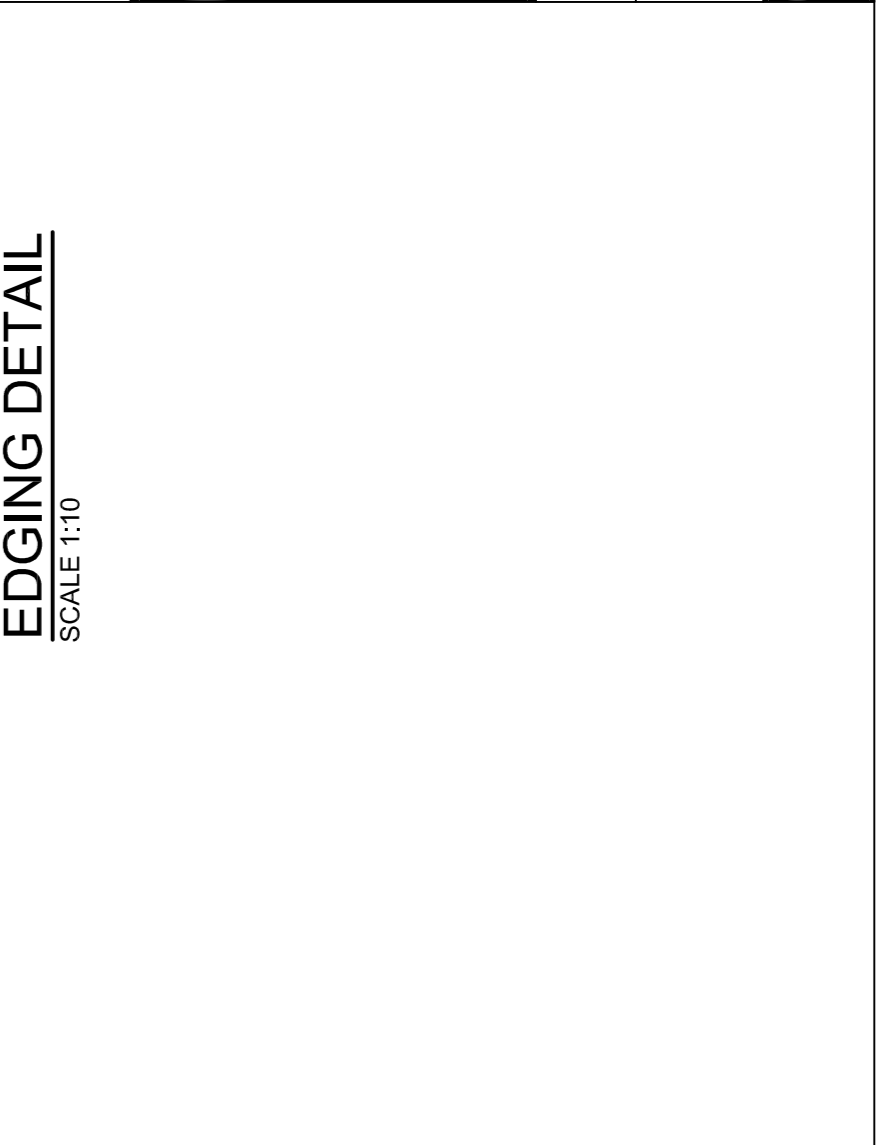
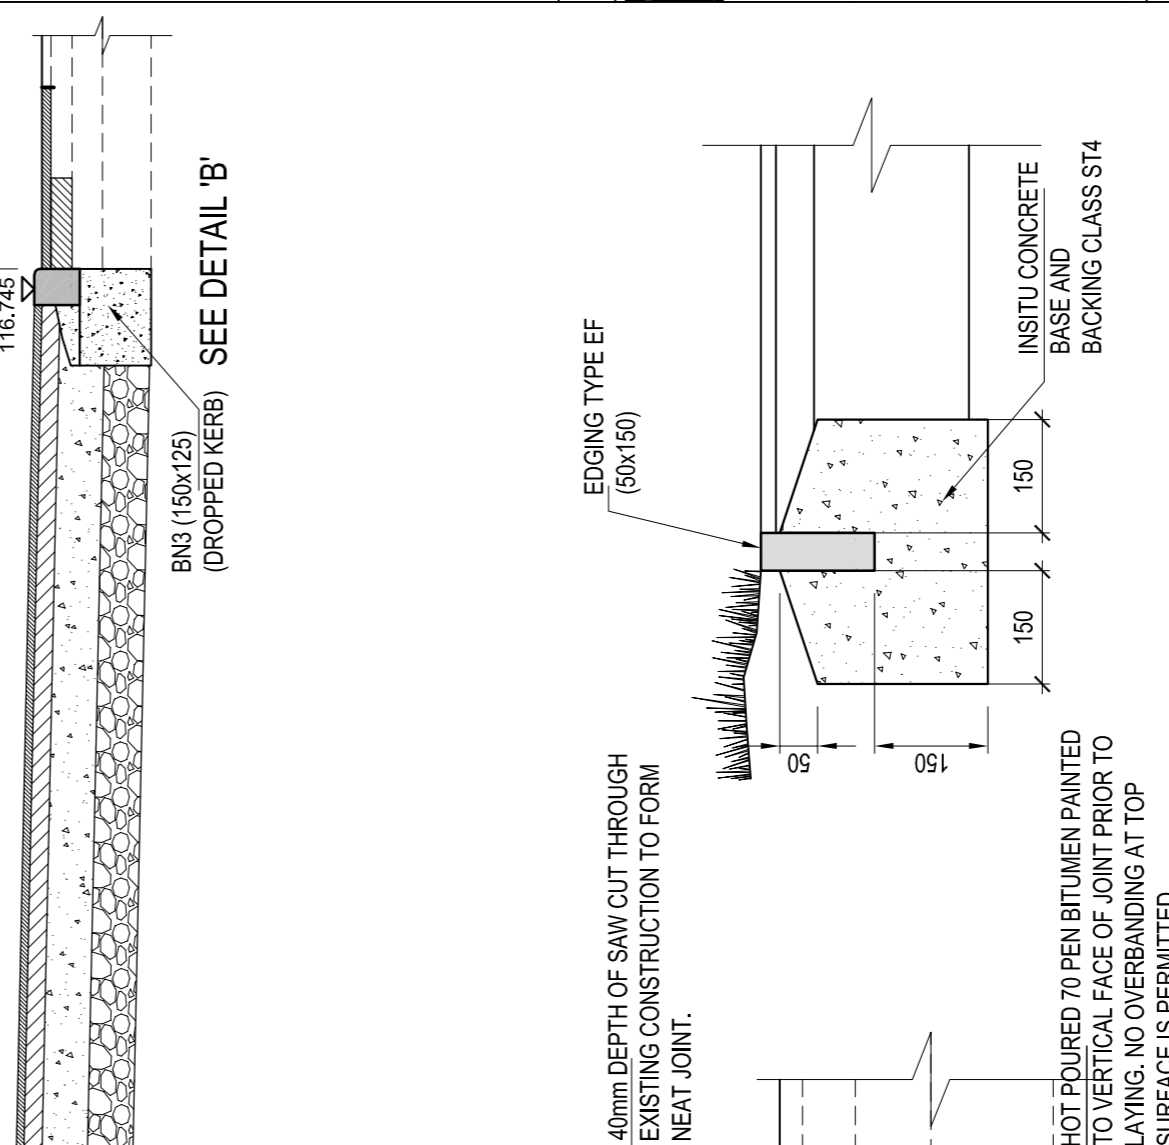
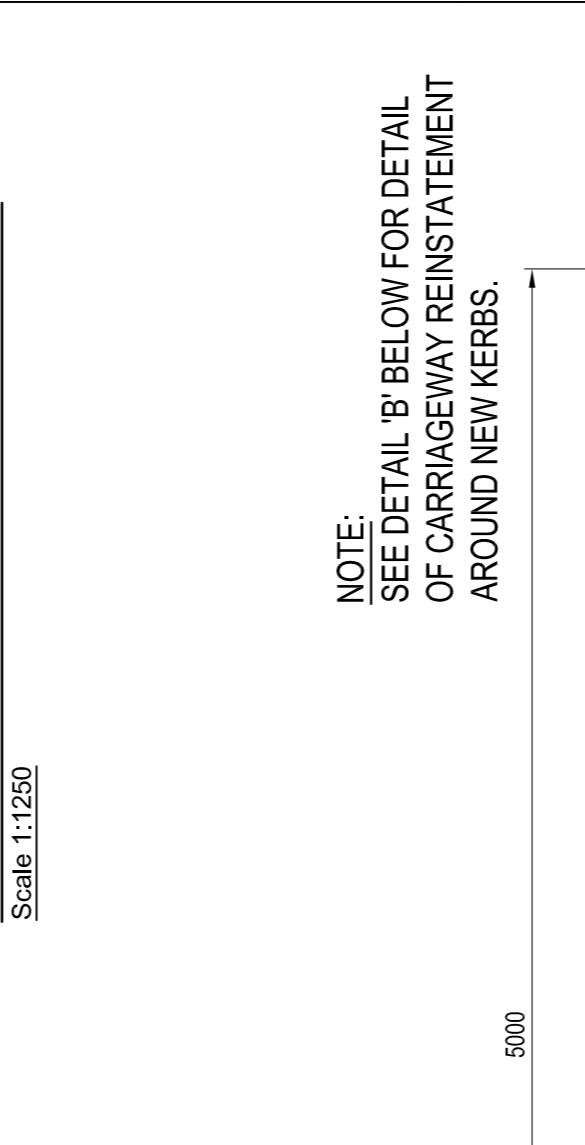
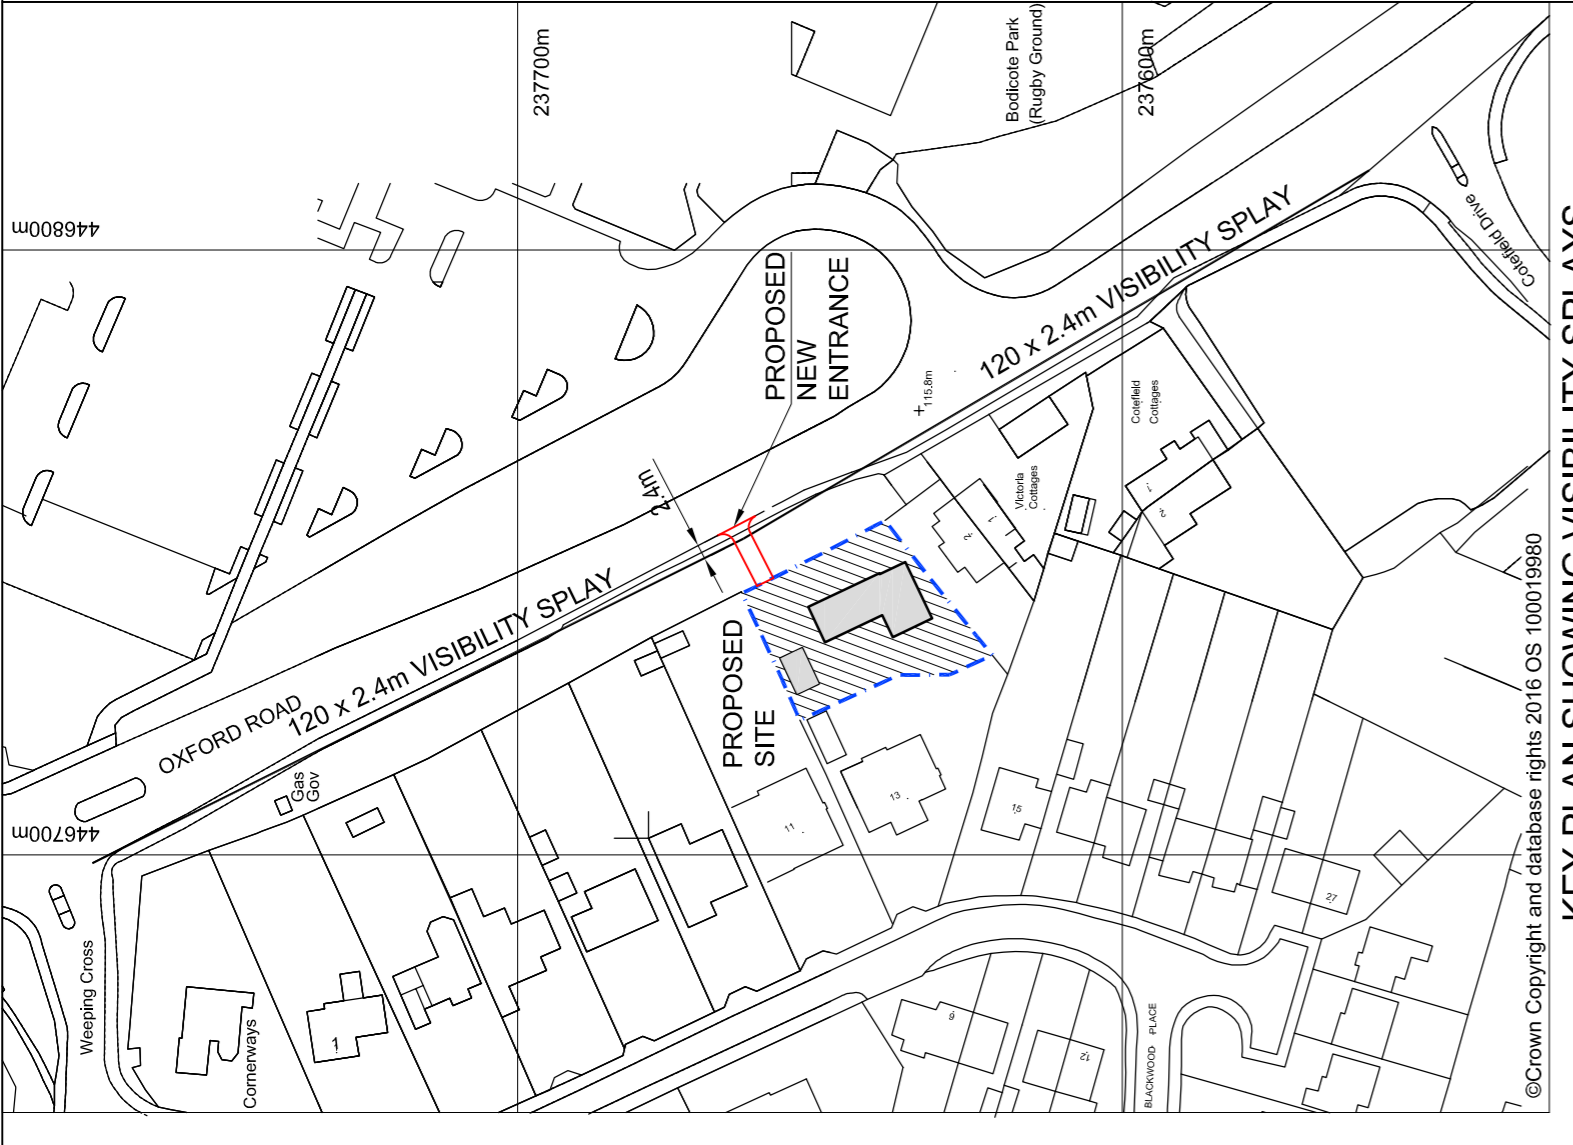
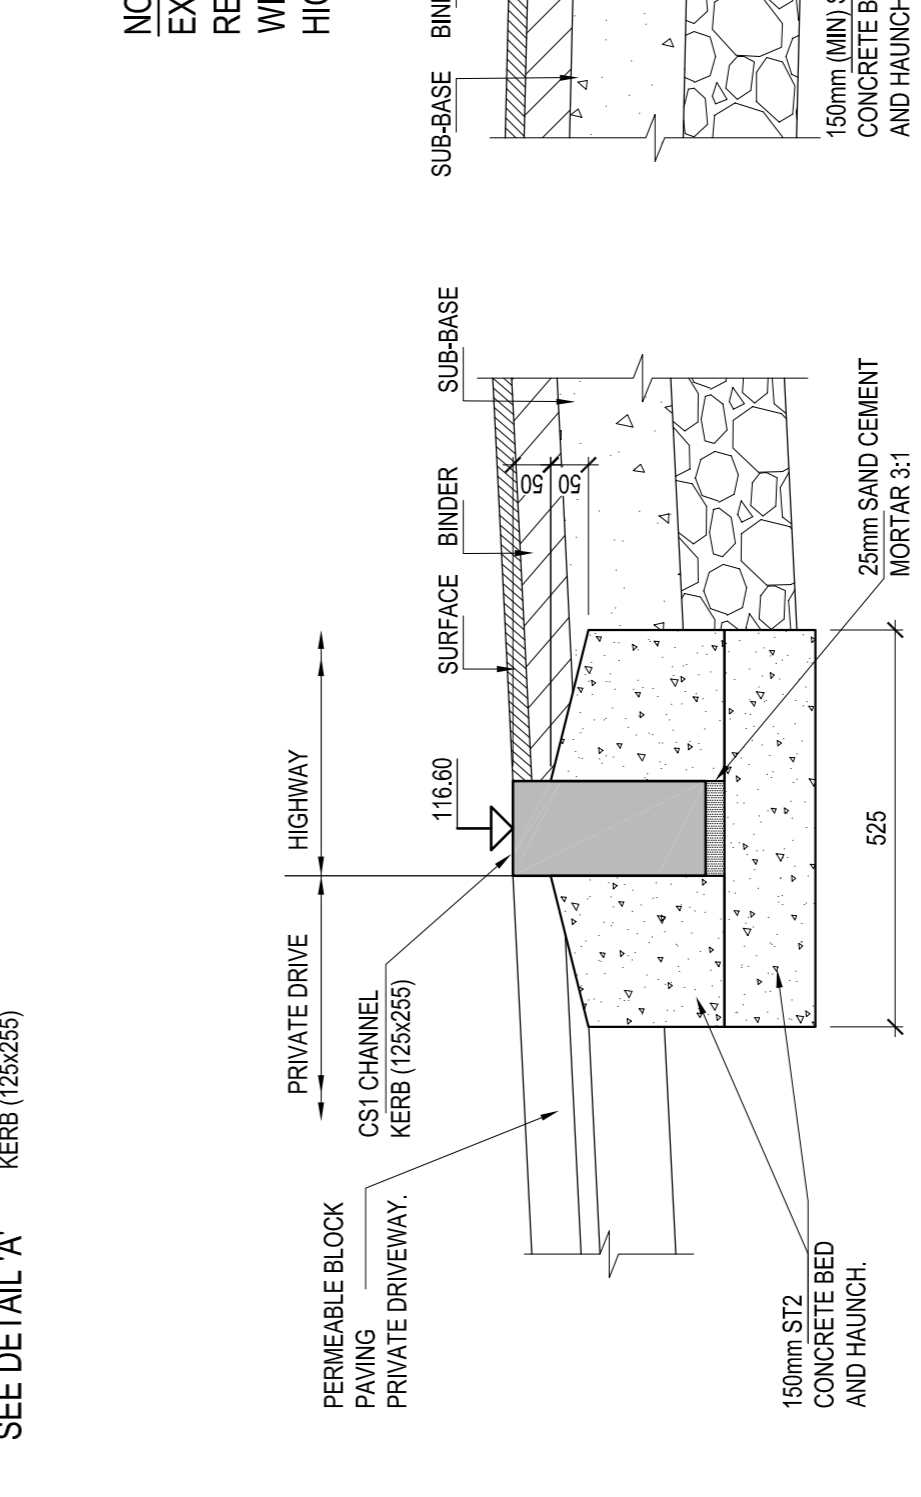


Oxfordshire County Council Interim Standard CBR Table

Notes:
 1. First Susceptible Subgrade - Where the sub-grade is first susceptible a non-first susceptible capping or sub-base must be used to achieve a minimum total construction of 450mm.
 2. CBR Testing - CBRs should be taken at 30m centres and lowest CBR used for determining the capping and sub-base thickness requirements.
 3. CBR Testing for Plastic Soils - Plastic soils (i.e. Clay) must be tested fully saturated to obtain an accurate CBR. Laboratory testing is required for carrying out saturated CBR testing.

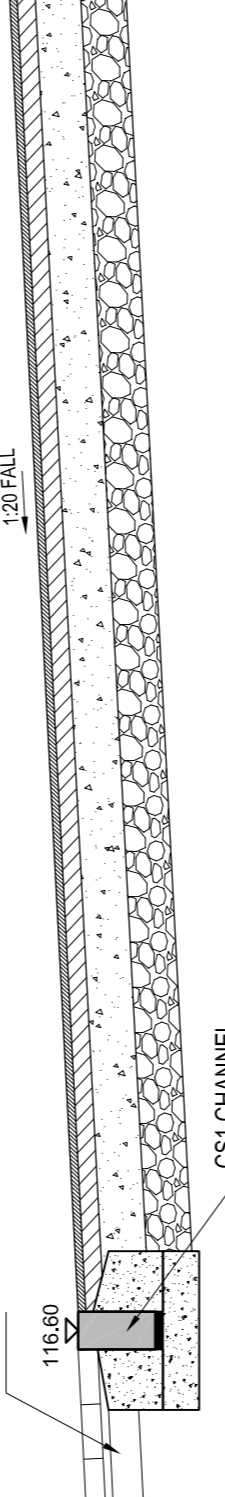

Notes:

- All dimensions are shown in millimetres unless noted otherwise.
- This drawing is to be read in conjunction with all architectural drawings and any other design information.
- All setting out is to be based on the architectural drawings. If there is any discrepancy between this drawing and the architectural drawings, it is to be reported Wellan Ltd.

© Crown Copyright and database rights 2016 OS 100019980

WELLAN Ltd
 Wellan House,
 Aylesmore, Shipston-on-Strour,
 Warwickshire,
 CV36 3EJ
 Tel: 01608 685753
 Email: mail@wellan.co.uk
 Website: www.wellan.co.uk

MR R. JONES

PROJECT
 LAND REAR OF 13 BLACKWOOD PLACE
 BODICOTE, OXFORDSHIRE OX15 4AH

TITLE
 NEW ACCESS
 LAYOUT
 & DETAILS

SCALE 1:50
 DATE 07.09.22
 MKW/SM
 MKW

JOB No.
 21-146

FORMING No.
 60

REV
 DATE
 BY
 DESCRIPTION
 CHK
 APD

FORMING No.
 60

REV
 P2