





Front Elevation








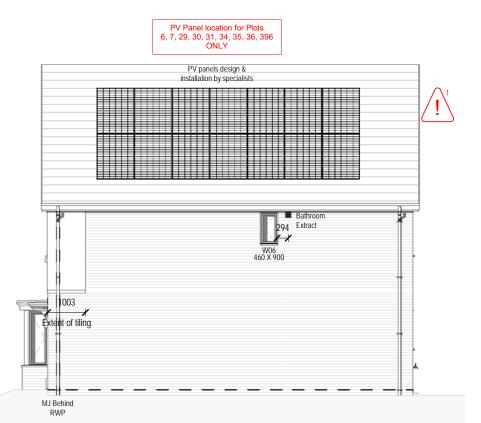

Right Elevation

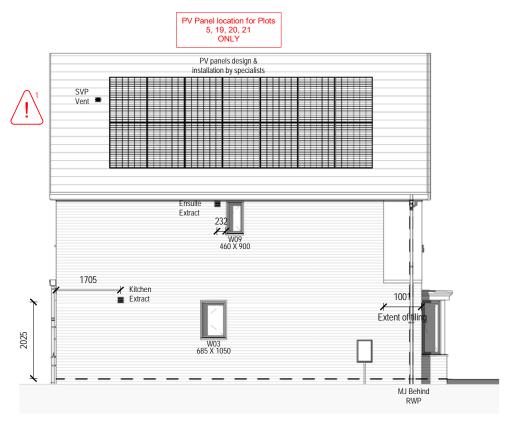

Left Elevation



This Working Drawing is to be Read in Conjunction with the Crest Standard Construction Notes and the Standard Workmanship & Materials Specification

CN Standard Details

Structural Engineers Design





Background Ventilation

Design permeability >5 m^3 / (h.m²) at 50Pa in accordace to Table 5.2a-B Total Background ventilation required = 75,000mm²

General Notes:

Refer to Terrace Sets and External Materials Schedule for External Finishes

For Coursing Rod & Setting out of standard openings refer to CNSD-2018-001

Setting out dimensions to service terminals are to centre of extracts

DPC



Secondary DPC where FGL is less than 150mm lower than FFL

Movement Joint

Ancon AMR/S/D3.0/W60 or similar approved ladder bed joint reinforcement to be provided above and below all window openings; should extend for a minimum of 600mm beyond the reveal of the opening.



RISK Gable Spandrel Panels -Fall from height -Crushing

Spandrel panels should be lifted and handled in accordance with the manufacturers guidance. Spandrel panels require lateral restraint at rafter level and along the base of the panel. In addition, tall panels may require further restraint. Both temporary and final installation / fixings to be in accordance with the manufacturers guidance.

Movement joints, bed joint reinforcment & PV panels added in.	16/05/22	HL	RC	T2
Tender issue	26/11/21	HL	RC	T1
REVISIONS	DATE	DRN	CKD	REV

Drawing Status:

TENDER

Сг		Crest Nicholson Ltd. Crest House Pyrcroft Road Chertsey Surrey KT16 9GN Tel: 01931 580 555 Fax: 08703 363 990 www.crestnicholson.com					
Project Name	Bicester Re	eplan					
Title	Elevations	- Type 1 & 2	Unit Size	1176 Sqft			
House Type	Romsey M	4-2 (4B6P 1176)					
Scale	As indicated @ A3			12/11/2021			
			Drawn	SAS	Checked	RC	
Drawing No.	5479	0-HGP-M42RO	M-/	A-1020)	Revision	T2