



Front Elevation Stone



Rear Elevation Stone

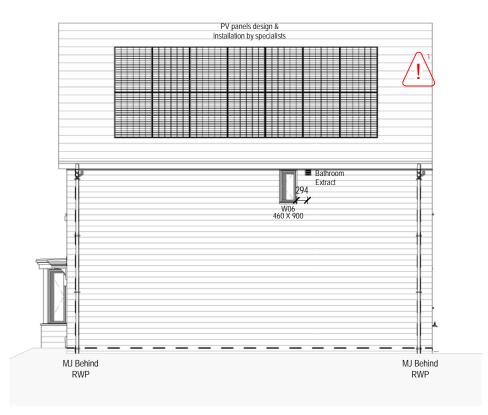

Right Elevation Stone

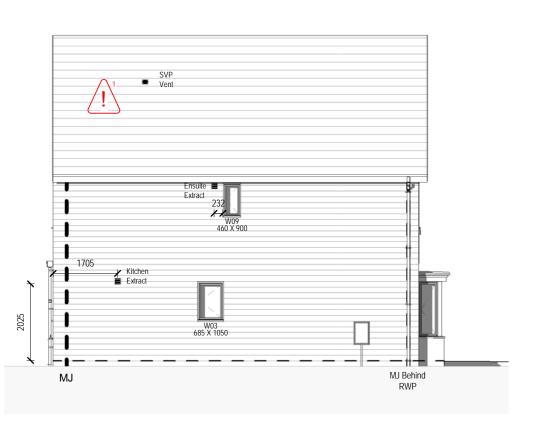

Left Elevation Stone

TYPE 3 PLOT NUMBERS: AS: 4 OPP: This Working Drawing is to be Read in Conjunction with the Crest Standard Construction Notes and the Standard Workmanship & Materials Specification







CN Construction Notes

CN Standard Details

Structural Engineers Des

Background Ventilation

Design permeability >5 m² / (h.m²) at 50Pa in accordace to Table 5.2a-B Total Background ventilation required = 75,000mm²

Seneral Notes:

Refer to Terrace Sets and External Materials Schedule for External Finishes

For Coursing Rod & Setting out of standard openings refer to CNSD-2018-001

Setting out dimensions to service terminals are to centre of extracts

— — DF

Secondary DPC where FGL is less than 150mm lower than FFL

Movement Joint



RISK Gable Spandrel Pa -Fall from height

Spandrel panels should be lifted and handled in accordance with the manufacturers guidance. Spandrel panels require lateral restraint at rafter level and along the base of the panel. In addition, tall panels may require further restraint. Both temporary and final installation / fixings to be in accordance with the manufacturers guidance.

 Movement joints, bed joint reinforcment & PV panels added in.
 16/05/22
 HL
 RC
 T2

 Tender issue
 26/11/21
 HL
 RC
 T1

 REVISIONS
 DATE
 DRN
 CKD
 REV

- -

TENDER



Crest Nicholson Ltd.
Crest House
Pyrcroft Road
Chertsey
Surrey
KT16 9GN

Tel: 01931 580 555 **Fax:** 08703 363 990 www.crestnicholson.com

54790-HGP-M42ROM-A-1021

Revision T2