



## Front Elevation

1:100

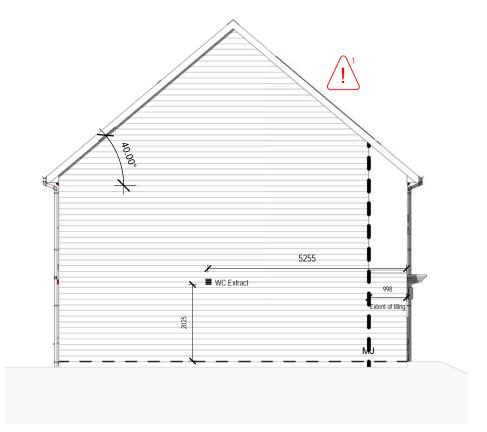

Right Elevation

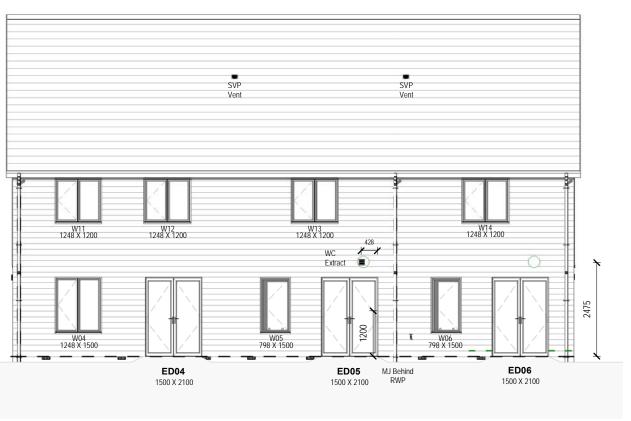

Left Elevation

Rear Elevation

This Working Drawing is to be Read in Conjunction with the Crest Standard Construction Notes and the Standard Workmanship & Materials Specification







**CN Construction Notes** 

CN Standard Details

Structural Engineers Des

## **Background Ventilation**

Design permeability >5 m $^2$  / (h.m $^2$ ) at 50Pa in accordace to Table 5.2a-B Total Background ventilation required = 75,000mm $^2$ 

## General Notes

Refer to Terrace Sets and External Materials Schedule for External Finishes

For Coursing Rod & Setting out of standard openings refer to CNSD-2018-001

Setting out dimensions to service terminals are to centre of extracts

— — D





Movement Joint



Ancon AMR/S/D3.0/W60 or similar approved ladder bed joint reinforcement to be provided above and below all window openings; should extend for a minimum of 600mm beyond the reveal of the opening.



RISK Gable Spandrel Panels -Fall from height -Crushing

Spandrel panels should be lifted and handled in accordance with the manufacturers guidance. Spandrel panels require lateral restraint at rafter level and along the base of the panel. In addition, tall panels may require further restraint. Both temporary and final installation / fixings to be in accordance with the manufacturers guidance.

 Movement joints, bed joint reinforcment & PV panels added in.
 13/05/22
 HL
 RC
 T3

 En-suite removed from firts floor.
 11/01/22
 HL
 RC
 T2

 Tender issue
 26/11/21
 HL
 RC
 T1

 REVISIONS
 DATE
 DRN
 CKD
 REV

Drawing Sta

## TENDER



Crest Nicholson Ltd. Crest House Pyrcroft Road

Chertsey Surrey KT16 9GN

**Tel:** 01931 580 555 **Fax:** 08703 363 990 www.crestnicholson.com

Drawing No.	E4700/UCD/D10 1E	/ A /-I	000	Revision	TΩ
		Drawn	SAS	Checked RC	
Scale	As indicated @ A3	Date	12/11/21		
House Type	Plots 13-15				
Title	Elevation	Unit Size	- Sqft		
Project Name	Bicester Replan				

54790/HGP/P13-15/A/1020

T3