




Front Elevation

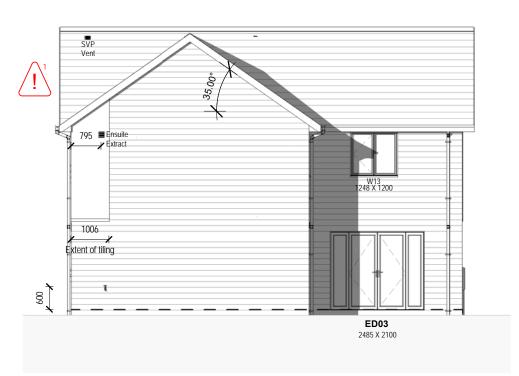

Rear Elevation

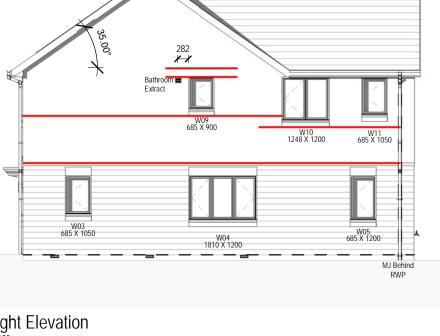

Right Elevation

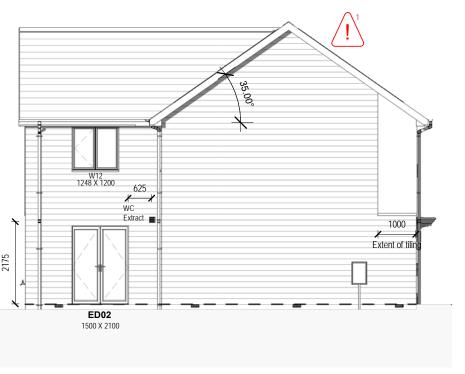

Left Elevation 1:100

TYPE 1 **PLOT NUMBERS:** AS: 37 OPP: 38

This Working Drawing is to be Read in Conjunction with the Crest Standard Construction Notes and the Standard Workmanship & Materials Specification







CN Construction Notes

CN Standard Details

Background Ventilation

Design permeability >5 m² / (h.m²) at 50Pa in accordace to Table 5.2a-B Total Background ventilation required = 75,000mm²

Refer to Terrace Sets and External Materials Schedule for External Finishes

For Coursing Rod & Setting out of standard openings refer to CNSD-2018-001

Setting out dimensions to service terminals are to centre of extracts

Secondary DPC where FGL is less than 150mm lower than FFL

Movement Joint

Ancon AMR/S/D3.0/W60 or similar approved ladder bed joint reinforcement to be provided above and below all window openings; should extend for a minimum of 600mm beyond the reveal of the opening.



RISK Gable Spandrel Panels -Fall from height -Crushing

Spandrel panels should be lifted and handled in accordance Spanner panels should be littled and handled in accordance with the manufacturers guidance. Spandrel panels require lateral restraint at rafter level and along the base of the panel. In addition, tall panels may require further restraint. Both temporary and final installation / fixings to be in accordance with the manufacturers guidance.

Movement joints, bed joint reinforcment & PV panels added in. 13/05/22 HL Windows W01, W02, W04 & W05 cill height revised 15/12/21 HL NL T2 26/11/21 HL RC T1 DATE DRN CKD REV REVISIONS

TENDER



Crest Nicholson Ltd. Crest House Pyrcroft Road Chertsey Surrey KT16 9GN

Tel: 01931 580 555 Fax: 08703 363 990 www.crestnicholson.com

Project Name	Bicester Replan				
Title	Elevations - Type 1	Unit Size	1684 Sqft		
House Type	Roydon (5B9P 1684)	-			
Scale	As indicated @ A3	Date	12/11/2021		
		Drawn	SAS	Checked RC	
Drawing No.	54790-HGP-ROY-A-	102	20	Revision	T3