

②

A
K
S
W
A
R
D

New Technical Site

**Drainage Strategy and Water Quality Management
Report**

NTS-AKSW-XX-XX-RP-C-0003

Prepared for
Bicester Heritage

October 2018

Job №: X162034

Seacourt Tower West Way Oxford OX2 0JJ
Tel: 01865 240071 Fax: 01865 248006
consult@aksward.com www.aksward.com

LONDON • HITCHIN • OXFORD • POOLE • SOUTHAMPTON

Contents

Section 1.0	Introduction	Page 1
Section 2.0	Development Site Details	Page 1
Section 3.0	Site Drainage Strategy	Page 2
Section 4.0	Water Quality Management	Page 3

Appendices

Appendix A	Survey & Historic Information
Appendix B	Existing Drainage Calculations
Appendix C	Proposed Site Plans
Appendix D	Proposed Drainage Calculations
Appendix E	Surface Water Drainage Pro-Forma
Appendix F	SuDS Maintenance Schedule

Revision	Amendments	Prepared By	Checked	Date
P01	Preliminary Issue	NJ	GT	18.07.18
P02	Minor amendments	NJ	GT	19.07.18
P02	Infiltration tests updated	NJ	GT	21.10.18


1.0 Introduction

- 1.1 AKS Ward have been commissioned to undertake a Drainage Strategy and Water Quality Management to support the planning application for extension to existing Technical Site to provide new employment units comprising flexible B1(c) light industrial, B2 (general industrial), B8 (storage or distribution) uses with ancillary offices, storage, display and sales, together with associated access, parking and landscaping
- 1.2 The site is in Flood Zone 1 (low risk of fluvial flooding) and is 1.61 Hectares in area with approximately 1.08 Ha served by drainage. The site is located in Bicester and is currently a greenfield site with approximately 700m² of hard standing area (6.5%).
- 1.3 The site is bounded by hangar units to the north, by the A4421 road to the west and south and by the Bicester Airfield to the east.
- 1.4 This Drainage Strategy must be read in conjunction with the Flood Risk Assessment prepared for the site by RAB Consultants.

2.0 Development Site Details

- 2.1 Development Description & Location
The site is located at NGR SP 59101 24291.

The plans of the development are contained within Appendix C.

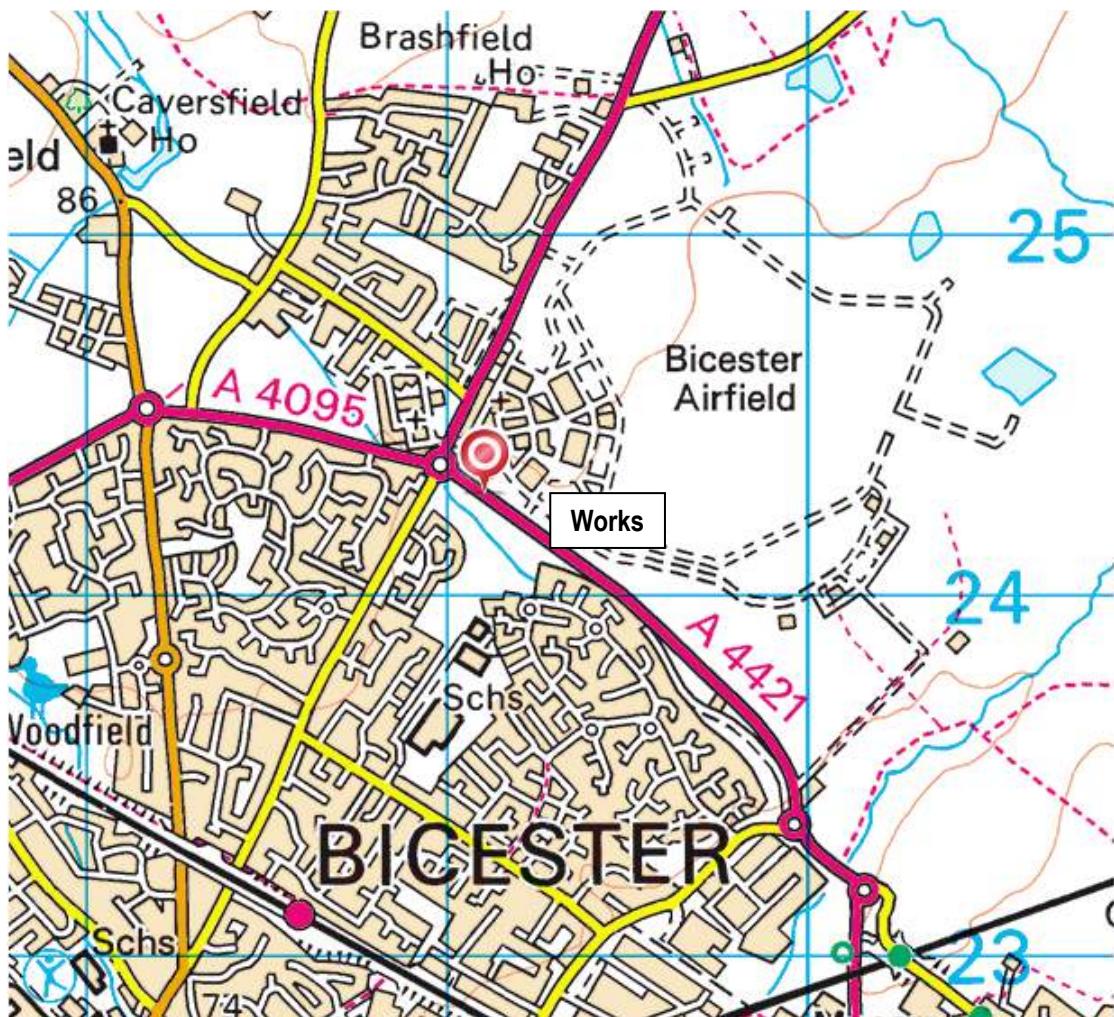

3.0 Site Drainage Strategy

3.1 Existing Surface Water

The site currently drains towards the southeast and infiltrates into the ground. During exceedance events when the ground is saturated, it is understood that the runoff volume would drain towards the watercourse located further southeast outside of Bicester Heritage

British Geological Survey indicates that the site is underlaid by Cornbrash Formation – Limestone.

Three infiltration tests have been carried out within the New Technical Site. Two of them were done in the Limestone layer (TP1 and TP2) and the third one (TP3) was carried out in the made ground layer therefore results obtained from TP3 are not valid and have not been taken into consideration. The infiltration rates from TP1 and TP2 vary between 9.75×10^{-5} m/s and 1.72×10^{-4} m/s.

Greenfield runoff rates and volumes have been calculated as follows:

Qbar:	0.5 l/s
Greenfield volume:	62.554 l/s

Existing drainage drawings are contained in Appendix A. Microdrainage calculations are contained in Appendix B

3.2 Proposed Surface Water

Surface system will be designed to agree with the National Standards for Sustainable Drainage.

Refer to drainage drawings and Microdrainage calculations in Appendix C and D. A Surface Water Pro-forma has been completed with a copy contained in Appendix E to ensure that the design is in accordance with the current SuDS requirements.

3.2.1 Runoff Destination

Due to ground conditions obtained, existing soil is considered permeable therefore infiltration as means of disposal is feasible.

Surface water drainage from the building and some hard paving areas will be attenuated and infiltrated using two new cellular soakaways with volumes of 54.72 m³ (Soakaway 1) and 133.00 m³ (Soakaway 2). Soakaway has been designed using the lowest infiltration rate obtained (9.75×10^{-5} m/s)

New parking areas and access road will be drained using permeable paving. In addition to this, two new swales will be used to discharge and infiltrate runoff from the southern access road.

3.2.2 Peak flow control

SuDS will be utilised on site in the form of permeable paving, swale and cellular soakaway. There will be no discharge flow rate from the site therefore peak runoff will not exceed the current flow rates for the 1 in 1 year rainfall event and the 1 in 100 year rainfall event with an allowance for climate change.

3.2.3 Volume control

There is no additional discharged volume as the proposed hard paving areas and building will be drained into the permeable paving, cellular soakaway and swale therefore it will not exceed the current volume form each storm.

3.2.4 Flood risk within the development

The system has been designed in accordance with CIRIA SuDS manual with no flooding in the 30 year event and no flood water leaving the site for the 100 year + 40% climate change critical storm event.

The Flood Risk Assessment identifies the site at medium to high risk of surface water flooding within the site caused by exceedance runoff from off site. The current flow path follows the existing ditch located along Bicester Heritage boundary with Skimmingdish Lane. Existing ditch is to be retained therefore the current flood path would remain unchanged and would run along the southern boundary. FFLs of proposed new buildings will be located higher than ditch level to reduce the risk of surface water flooding to the buildings. A plan showing the surface water flood path has been included in Appendix C.

3.2.5 Exceedance Events

In storm events exceeding the designed storm events above the 100 year + climate change the flow of water would run towards the southeast of the site and ultimately discharge into the existing watercourse. This path is as per the existing situation.

A plan showing the flood path during an unlikely exceedance event has been included in A

3.2.6 Structural integrity and construction

Surface system will be designed and constructed using approved materials in line with Building Regulation's and current British Standards appropriate for the location and proposed use.

3.2.7 Maintenance and operation

The drainage system will be CCTV surveyed on completion to ensure that the system is fully operational and maintenance schedules provided in the O&M manual for the owner to maintain the cellular tank, permeable paving and swale.

Maintenance schedules have been provided in Appendix F for the SuDS. The owner of the site will be responsible for maintaining the SuDS on site.

3.3 Existing and Proposed Foul Water.


Foul water will discharge via private pumping chamber into the existing public sewer located within the site. Connection will be on site and via direct connection to the existing public drainage system.

A Pre-development Enquiry will be submitted to Thames Water to agree the discharge flow rates from the new development.

Any new foul drainage will be connected to the public system and S106 connection applications made to Thames Water.

3.4 Stratton Audley Quarries Site of Special Scientific Interest

The proposed development is located approximately 1300m from Stratton Audley Quarries, and area declared 'Site of Special Scientific Interest'.

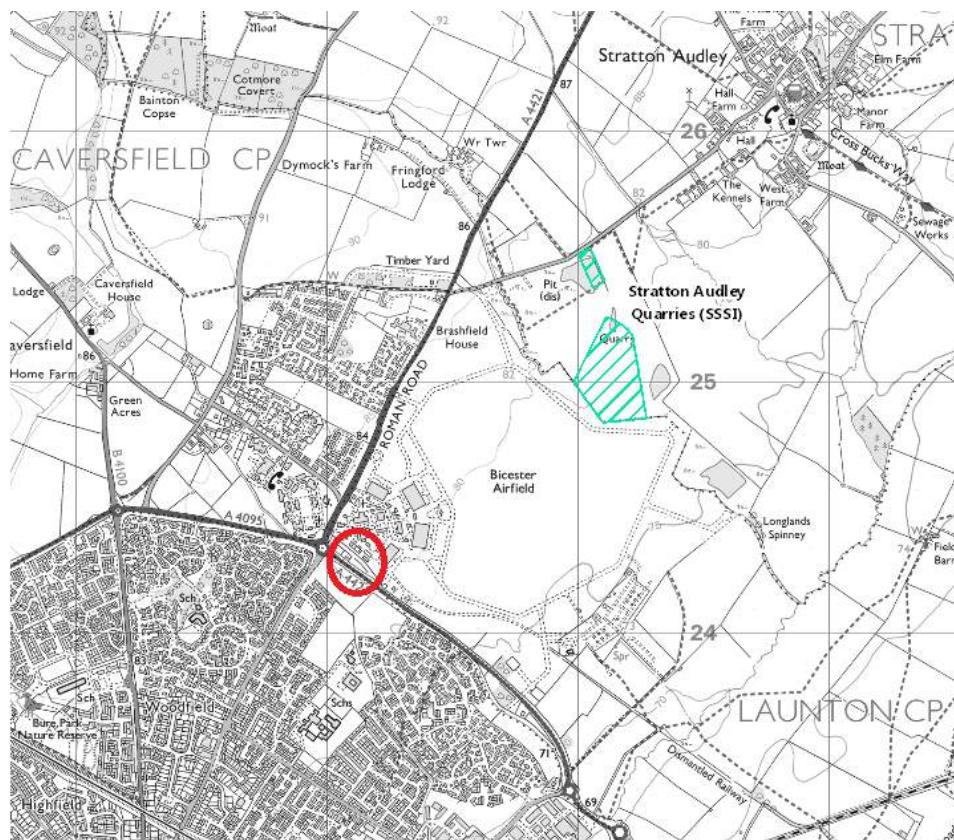

The proposed site falls from northwest to southeast therefore it does not contribute to the hydrology of the SSSI.

4.0 Water Quality Management

The surface system will be designed in order to not affect the water quality of the receiving watercourse.

CIRIA SuDS Manual 2015 Chapter 26 assigns pollution hazard indices for different land use types and SuDS mitigation index for every SuDS component depending on where the discharge is, surface or ground water.

TABLE 26.2 Pollution hazard indices for different land use classifications

Land use	Pollution hazard level	Total suspended solids (TSS)	Metals	Hydrocarbons
Residential roofs	Very low	0.2	0.2	0.05
Other roofs (typically commercial/industrial roofs)	Low	0.3	0.2 (up to 0.8 where there is potential for metals to leach from the roof)	0.05
Individual property driveways, residential car parks, low traffic roads (eg cul de sacs, homezones and general access roads) and non-residential car parking with infrequent change (eg schools, offices) ie < 300 traffic movements/day	Low	0.5	0.4	0.4
Commercial yard and delivery areas, non-residential car parking with frequent change (eg hospitals, retail), all roads except low traffic roads and trunk roads/motorways ¹	Medium	0.7	0.6	0.7
Sites with heavy pollution (eg haulage yards, lorry parks, highly frequented lorry approaches to industrial estates, waste sites), sites where chemicals and fuels (other than domestic fuel oil) are to be delivered, handled, stored, used or manufactured; industrial sites; trunk roads and motorways ¹	High	0.8 ²	0.8 ²	0.9 ²

TABLE 26.3 Indicative SuDS mitigation Indices for discharges to surface waters

Type of SuDS component	Mitigation indices ¹		
	TSS	Metals	Hydrocarbons
Filter strip	0.4	0.4	0.5
Filter drain	0.4 ³	0.4	0.4
Swale	0.5	0.6	0.6
Bioretention system	0.8	0.8	0.8
Permeable pavement	0.7	0.6	0.7
Detention basin	0.5	0.5	0.6
Pond ⁴	0.7 ⁴	0.7	0.5
Wetland	0.8 ⁴	0.8	0.8
Proprietary treatment systems ^{5,6}	These must demonstrate that they can address each of the contaminant types to acceptable levels for frequent events up to approximately the 1 in 1 year return period event, for inflow concentrations relevant to the contributing drainage area.		

TABLE 26.4 Indicative SuDS mitigation indices for discharges to groundwater			
Characteristics of the material overlying the proposed infiltration surface, through which the runoff percolates ¹	TSS	Metals	Hydrocarbons
A layer of dense vegetation underlain by a soil with good contaminant attenuation potential ² of at least 300 mm in depth ³	0.6 ⁴	0.5	0.6
A soil with good contaminant attenuation potential ² of at least 300 mm in depth ³	0.4 ⁴	0.3	0.3
Infiltration trench (where a suitable depth of filtration material is included that provides treatment, ie graded gravel with sufficient smaller particles but not single size coarse aggregate such as 20 mm gravel) underlain by a soil with good contaminant attenuation potential ² of at least 300 mm in depth ³	0.4 ⁴	0.4	0.4
Constructed permeable pavement (where a suitable filtration layer is included that provides treatment, and including a geotextile at the base separating the foundation from the subgrade) underlain by a soil with good contaminant attenuation potential ² of at least 300 mm in depth ³	0.7	0.6	0.7
Bioretention underlain by a soil with good contaminant attenuation potential ² of at least 300 mm in depth ³	0.8 ⁴	0.8	0.8
Proprietary treatment systems ⁵⁻⁸	These must demonstrate that they can address each of the contaminant types to acceptable levels for inflow concentrations relevant to the contributing drainage area.		

CIRIA SuDS Manual states that '*To deliver adequate treatment, the selected SuDS components should have a total pollution mitigation index that equals or exceeds the pollution hazard index'*

**Total SuDS mitigation index ≥ pollution hazard index
(for each contaminant type) (for each contaminant type)**

Pollution hazard indices for land use are as follows:

Roof:	TTS 0.2	Metals 0.2	Hydrocarbons 0.05
Access road & car park:	TTS 0.5	Metals 0.4	Hydrocarbons 0.4

SuDS mitigation indices are determined by the type of SuDS utilised on site. The proposal for this site permeable paving, swale and cellular soakaway:

Permeable pavement:	TTS 0.7	Metals 0.6	Hydrocarbons 0.7
Swale:	TTS 0.5	Metals 0.6	Hydrocarbons 0.6


Catchpit manholes will be installed prior to connecting into the new cellular soakaway therefore providing additional treatment for the surface water drained from the roof which will improve the water quality further.

Appendix A
Surveys & Historic Information



OS NORTH

Topographical Abbreviations	
A/R	Assumed Route
BR	Bolt
BOL	Bolted
BT	British Telecom
BW	Brown Wire Cover
BWK	Brikkewall
CATV	Cable TV
CB	Closed Boarded Fence
CCTV	Closed Circuit TV
CH	Cherry Picker
CHPL	Chestnut Polling Fence
CL	Cover Level
CM	Compass Marker
CP	Cotton Pit
CR	Crown Base Level
DIA	Diameter
DK	Drop Kerb
DP	Drop Point
E-B	Electricity Box
EG	Earthed Ground
EP	Electricity Pole
ER	Earthing Rod
FOL	Feature Existing Level
FH	Fire Hydrant
FG	Feed Ground
FW	Feed Water
GU	Gully
GV	Gully Valve
H	Height
IC	Inspection Cover
IL	Iron Level
IR	Iron Rolling Fence
KO	Kiosk
LB	Little Bin
LC	Lamp Column
MH	Manhole
MTR	Mercury Telecom Cover
OHC	Overhead Cable
OHE	Overhead Electricity
OBM	Overhead Bench Mark
PB	Post Box
POW	Post Box Wall
PR	Post & Roll Fence
PW	Post & Wire Fence
RW	Rodding Wire
RE	Rodding Eye
RS	Road Name
RN	Road Sign
RP	Rain Water Pipe
SC	Sapling
SPR	Spread
STA	Stop Station
SV	Stop Valve
SW	Soil Vent Pipe
TB	Telephone Box
TFR	Taken From Records
TJ	Telephone Junction Box
TL	Traffic Light
TP	Telephone Pole
UTL	Unable To Lift
UTT	Unable To Trace
WKH	Water Key Hole
WM	Water Meter
WP	Water Pipe

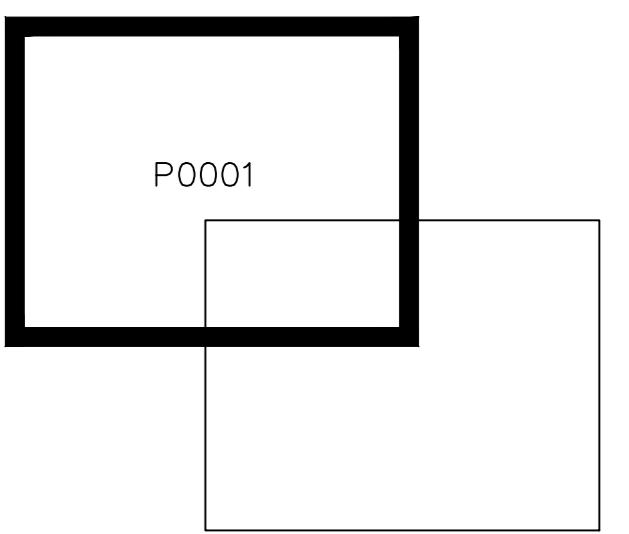

Notes	
The Grid is related to OS using RTK GPS	-
All Levels are related to OS Datum using RTK GPS	-
All dimensions are in metres unless otherwise specified	-
5	-
4	-
3	-
2	-
1	-
0	BF First Complete Issue Prelim Preliminary - Not Complete Rev QA Check
7	16/1/2016 Date Copyright Warner Surveys WARNER SURVEYS Land and Engineering Surveying Since 1979 Head Office Beaumont Hse 59 High St Theale RG7 5AL London Office 28a Queen's Way Bayswater London W2 3RX T +44 (0)118 930 3314 T +44 (0)20 8651 0000 www.warnersurveys.com Topographic and Measured Building Survey Construction and Site Engineering Survey Movement and Deformation Monitoring Oil, Gas and Industrial Surveying

SURVEYED KF **DRAWN** KF **SCALE** 1:200
Bicester Heritage Limited

Skimmingdish Lane, Bicester

TOPOGRAPHICAL SURVEY

JOB No	DRAWING NUMBER
S616/0328	S616/0328/P/0001


A0 Sheet - 1,189mm X 841mm



OS NORTH

Topographical Abbreviations

A/R	Assumed Route
BH	Bank
BOL	Boulder
BT	British Telecom
BW	Brown Wire Cover
BWK	Brikkewall Cover
CATV	Closed Circuit TV
CB	Close Boarded Fence
CCTV	Closed Circuit TV
CHP	Chesnut Polling Fence
CL	Cover Level
CM	Compass Marker
CP	Cotton Pit
CR	Cross Base Level
DIA	Diameter
DK	Drop Kerb
DP	Drop Point
E-B	Earth Bonding
EO	Earth Electrode
EP	Electricity Pole
ER	Earthing Rod
FO	Flood Overflow Level
FG	Fire Ground
FW	Feed Water
GU	Gully
HV	Hydrant Valve
H	Height
IC	Inspection Cover
IL	Interval Level
IR	Iron Rolling Fence
KO	Kiosk
LB	Little Bin
LC	Lamp Column
LP	Light Pole
MH	Manhole
MTR	Memory Telecom
MR	Mercury Telecom
OB	Overhead Pipe
OHC	Overhead Cable
OBM	Overhead Bench Mark
PB	Post Box
PW	Post & Roll Fence
PR	Post & Wire Fence
R	Rodding
RE	Rodding Eye
RS	Road Sign
RN	Road Name
RTF	Right Of Way
RW	Rain Water Pipe
SPR	Spill Point
SV	Stop Valve
SW	Soil Vent Pipe
TB	Telephone Box
TBM	Telephone Junction Box
TFR	Taken From Records
TJ	Traffic Junction
TL	Traffic Light
TP	Traffic Pole
UTL	Unable To Lift
UTT	Unable To Trace
WKM	Water Key Hole
WM	Water Meter
WT	Water Valve

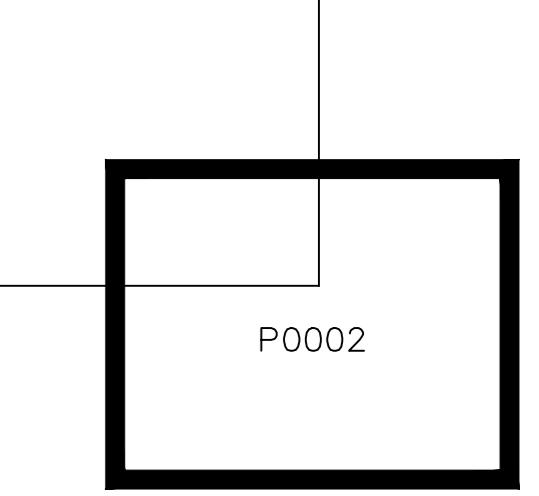

P0002

Notes	The Grid is related to OS using RTK GPS All Levels are related to OS Datum using RTK GPS All dimensions are in metres unless otherwise specified
5	-
4	-
3	-
2	-
1	-
0	BF First Complete Issue Prelim - Preliminary - Not Complete Rev QA Check Description Date
(C)	Copyright Warner Surveys



Land and Engineering Surveying Since 1979

Head Office Beaumont Hse 59 High St Theale Reading RG7 5AL

London Office +44 (0)118 930 3314

28a Queen's Rd Bayswater London W2 3RX

+44 (0)20 7630 6512

www.warnersurveys.com

Topographic and Measured Building Survey

Construction and Site Engineering Survey

Movement and Deformation Monitoring

Oil, Gas and Industrial Surveying

SURVEYED KF DRAWN KF Bicester Heritage Limited


SCALE 1:200

Skimmingdish Lane, Bicester

TOPOGRAPHICAL SURVEY

JOB No S616/0328 DRAWING NUMBER S616/0328/P/0002

A0 Sheet - 1,189mm X 841mm



Asset location search



Property Searches

AKS Ward
Seacourt Tower
West Way Seacourt Tower
OXFORD
OX2 0JJ

Search address supplied Royal Air Force
Buckingham Road
Bicester
OX26 5HA

Your reference X162034 - Bicester Heritage

Our reference ALS/ALS Standard/2018_3816510

Search date 19 June 2018

Keeping you up-to-date

Knowledge of features below the surface is essential in every development. The benefits of this not only include ensuring due diligence and avoiding risk, but also being able to ascertain the feasibility for any commercial or residential project.

An asset location search provides information on the location of known Thames Water clean and/or wastewater assets, including details of pipe sizes, direction of flow and depth. Please note that information on cover and invert levels will only be provided where the data is available.



Thames Water Utilities Ltd
Property Searches, PO Box 3189, Slough SL1 4WW
DX 151280 Slough 13



searches@thameswater.co.uk
www.thameswater-propertysearches.co.uk



0845 070 9148



Asset location search



Property Searches

Search address supplied: Royal Air Force, Buckingham Road, Bicester, OX26 5HA

Dear Sir / Madam

An Asset Location Search is recommended when undertaking a site development. It is essential to obtain information on the size and location of clean water and sewerage assets to safeguard against expensive damage and allow cost-effective service design.

The following records were searched in compiling this report: - the map of public sewers & the map of waterworks. Thames Water Utilities Ltd (TWUL) holds all of these.

This search provides maps showing the position, size of Thames Water assets close to the proposed development and also manhole cover and invert levels, where available.

Please note that none of the charges made for this report relate to the provision of Ordnance Survey mapping information. The replies contained in this letter are given following inspection of the public service records available to this company. No responsibility can be accepted for any error or omission in the replies.

You should be aware that the information contained on these plans is current only on the day that the plans are issued. The plans should only be used for the duration of the work that is being carried out at the present time. Under no circumstances should this data be copied or transmitted to parties other than those for whom the current work is being carried out.

Thames Water do update these service plans on a regular basis and failure to observe the above conditions could lead to damage arising to new or diverted services at a later date.

Contact Us

If you have any further queries regarding this enquiry please feel free to contact a member of the team on 0845 070 9148, or use the address below:

Thames Water Utilities Ltd
Property Searches
PO Box 3189
Slough
SL1 4WW

Email: searches@thameswater.co.uk

Web: www.thameswater-propertysearches.co.uk

Asset location search



Property Searches

Waste Water Services

Please provide a copy extract from the public sewer map.

The following quartiles have been printed as they fall within Thames' sewerage area:

SP5824SE
SP5824NE
SP5924SW
SP5924NW

Enclosed is a map showing the approximate lines of our sewers. Our plans do not show sewer connections from individual properties or any sewers not owned by Thames Water unless specifically annotated otherwise. Records such as "private" pipework are in some cases available from the Building Control Department of the relevant Local Authority.

Where the Local Authority does not hold such plans it might be advisable to consult the property deeds for the site or contact neighbouring landowners.

This report relates only to sewerage apparatus of Thames Water Utilities Ltd, it does not disclose details of cables and or communications equipment that may be running through or around such apparatus.

The sewer level information contained in this response represents all of the level data available in our existing records. Should you require any further Information, please refer to the relevant section within the 'Further Contacts' page found later in this document.

For your guidance:

- The Company is not generally responsible for rivers, watercourses, ponds, culverts or highway drains. If any of these are shown on the copy extract they are shown for information only.
- Any private sewers or lateral drains which are indicated on the extract of the public sewer map as being subject to an agreement under Section 104 of the Water Industry Act 1991 are not an 'as constructed' record. It is recommended these details be checked with the developer.

Clean Water Services

Please provide a copy extract from the public water main map.

The following quartiles have been printed as they fall within Thames' water area:

SP5824SE
SP5824NE

Asset location search



Property Searches

SP5924SW
SP5924NW

Enclosed is a map showing the approximate positions of our water mains and associated apparatus. Please note that records are not kept of the positions of individual domestic supplies.

For your information, there will be a pressure of at least 10m head at the outside stop valve. If you would like to know the static pressure, please contact our Customer Centre on 0800 316 9800. The Customer Centre can also arrange for a full flow and pressure test to be carried out for a fee.

For your guidance:

- Assets other than vested water mains may be shown on the plan, for information only.
- If an extract of the public water main record is enclosed, this will show known public water mains in the vicinity of the property. It should be possible to estimate the likely length and route of any private water supply pipe connecting the property to the public water network.

Payment for this Search

A charge will be added to your suppliers account.

Asset location search



Property Searches

Further contacts:

Waste Water queries

Should you require verification of the invert levels of public sewers, by site measurement, you will need to approach the relevant Thames Water Area Network Office for permission to lift the appropriate covers. This permission will usually involve you completing a TWOSA form. For further information please contact our Customer Centre on Tel: 0845 920 0800. Alternatively, a survey can be arranged, for a fee, through our Customer Centre on the above number.

If you have any questions regarding sewer connections, budget estimates, diversions, building over issues or any other questions regarding operational issues please direct them to our service desk. Which can be contacted by writing to:

Developer Services (Waste Water)
Thames Water
Clearwater Court
Vastern Road
Reading
RG1 8DB

Tel: 0800 009 3921
Email: developer.services@thameswater.co.uk

Clean Water queries

Should you require any advice concerning clean water operational issues or clean water connections, please contact:

Developer Services (Clean Water)
Thames Water
Clearwater Court
Vastern Road
Reading
RG1 8DB

Tel: 0800 009 3921
Email: developer.services@thameswater.co.uk

Asset Location Search Sewer Map - ALS/ALS Standard/2018_3816510

SP5824SE



The width of the displayed area is 500m and the centre of the map is located at OS coordinates 458750,224250

The position of the apparatus shown on this plan is given without obligation and warranty, and the accuracy cannot be guaranteed. Service pipes are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Thames Water for any error or omission. The actual position of mains and services must be verified and established on site before any works are undertaken.

Based on the Ordnance Survey Map with the Sanction of the controller of H.M. Stationery Office, License no. 100019345 Crown Copyright Reserved.

NB. Levels quoted in metres Ordnance Newlyn Datum. The value -9999.00 indicates that no survey information is available

Manhole Reference	Manhole Cover Level	Manhole Invert Level
531K	n/a	n/a
521C	n/a	n/a
621A	n/a	n/a
711A	n/a	n/a
721C	n/a	n/a
721D	n/a	n/a
6101	n/a	80.4
601B	n/a	n/a
7003	n/a	79.8
7001	n/a	79.38
701B	n/a	n/a
701C	n/a	n/a
7102	n/a	78.6
7002	n/a	77.75
7005	n/a	n/a
7006	n/a	n/a
7004	n/a	79.1
701A	n/a	n/a
7110	n/a	77.94
7104	n/a	78.83
7111	n/a	77.48
8103	n/a	78.66
8051	81.08	80.26
8001	81.12	77.24
8050	81.22	80.29
8052	80.23	78.35
8055	n/a	n/a
8053	80.1	78.55
8054	n/a	n/a
5205	83.41	80.91
5305	83.43	81.48
521B	n/a	n/a
531A	n/a	n/a
5207	83.36	81.12
5206	83.4	80.6
531I	n/a	n/a
521A	n/a	n/a
531E	n/a	n/a
5201	83.06	81.38
531J	n/a	n/a
531B	n/a	n/a
531H	n/a	n/a
531C	n/a	n/a
5101	83.15	80.18
5310	82.8	80.51
5110	83.01	80.34
5309	82.8	81.18
5209	83.05	79.75
5208	83.01	80.41
5102	83.05	80.39
5109	83.04	80.94
5311	82.77	81.07
6201	82.47	80.18
6202	82.49	79.54
6206	82.57	80.88
6207	82.59	80.63
5202	83.66	81
5203	83.65	81.7
5302	83.8	81.15
5301	83.81	81.71
5304	83.57	81.57
5303	83.8	81.15
5204	83.41	81.55
5010	82.5	80.05
5004	82.52	79.75
5005	82.75	79.69
5009	82.76	80.15
5003	82.95	79.75
5008	83	80.4
501A	n/a	n/a
501B	n/a	n/a
501C	n/a	n/a
5001	82.97	81.31
5002	82.97	81.81
601A	n/a	n/a
5105	83.14	81
5106	83.11	81.53
611B	n/a	n/a
611A	n/a	n/a
611C	n/a	n/a
5107	83.31	81.36
5104	83.37	80.76
5108	83.11	81.12
5103	83.13	80.5
5306	83.42	80.74
5307	83.17	81.26
5308	83.21	81.65
6302	82.8	80.77
6301	82.83	80.09
631A	n/a	n/a
9401	79.54	78.59


Manhole Reference	Manhole Cover Level	Manhole Invert Level
7204	n/a	79.25
7208	81.4	80.02
7207	n/a	n/a
6210	81.97	79.7
6203	81.93	80.21
6209	81.88	79.94
6204	81.9	80.42
7209	n/a	n/a
721B	n/a	n/a
721A	n/a	n/a
6208	82.24	80.17
6205	82.22	80.55
7310	n/a	n/a
6305	82.01	80.57
7309	81.47	79.41
7308	81.45	79.79
7311	81.44	79.15
7306	80.99	79.37
7301	81.03	78.32
6304	82.16	80.36
7305	81.33	79.65
7302	81.38	78.78
6303	82.15	79.68
7304	81.77	79.97
7303	81.77	79.19
6306	82.41	80.53
6307	82.46	79.8
8101	80.65	77.43
8104	n/a	78.05
8110	80.56	77.53
8108	n/a	77.03
8105	n/a	78.26
8107	n/a	77.85
8106	n/a	78.41
7201	n/a	78.13
8212	n/a	n/a
8210	n/a	78.67
8213	n/a	n/a
8211	80.56	78.76
8214	80.27	77.56
8204	n/a	79.18
8202	n/a	78.88
8206	n/a	77.63
8203	n/a	78.98
8205	n/a	77.7
8216	80.57	78.89
8215	80.55	77.85
8303	80.4	79.05
8301	80.36	78.04
7307	80.66	79.17
8302	80.67	78.14
8306	80.47	79.04
8304	80.43	79.2
8305	80.48	78.81
831A	n/a	n/a
831B	n/a	n/a
831C	n/a	n/a
8102	80.5	78.02
8207	n/a	76.54
8201	n/a	78.72
8109	n/a	n/a
9204	n/a	78.47
9203	n/a	78.92
9303	n/a	78.75
9302	n/a	79.19
9104	n/a	n/a
9205	n/a	n/a
9201	79.59	77.75
9101	n/a	n/a
9207	n/a	n/a
9102	n/a	n/a
9208	n/a	n/a
9202	79.54	77.72
9103	n/a	n/a
9301	79.62	77.9
9106	n/a	n/a
6103	n/a	79.98
611D	n/a	n/a
7109	n/a	78.07
7105	n/a	78.96
7101	n/a	78.38
7108	n/a	78.16
7106	n/a	79.05
7103	n/a	79.28
6104	n/a	78.72
6102	n/a	79.56
6107	n/a	79.73
6110	n/a	78.89
7121	n/a	79.23
7118	n/a	79.65
6108	n/a	80.01
6111	n/a	79.56
7120	n/a	79.43

Manhole Reference	Manhole Cover Level	Manhole Invert Level
7117	n/a	79.85
6109	n/a	79.93
6112	82.48	79.32
7112	n/a	78
7107	n/a	78.54
7119	n/a	80.15
7206	n/a	79.73
7202	n/a	78.68
7205	n/a	79.09
7203	n/a	78.83
9006	n/a	n/a
9001	79.47	77.16
9002	n/a	n/a
9007	n/a	n/a
9008	n/a	n/a
9004	n/a	n/a
9009	n/a	n/a
9005	n/a	n/a
9105	n/a	n/a

The position of the apparatus shown on this plan is given without obligation and warranty, and the accuracy cannot be guaranteed. Service pipes are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Thames Water for any error or omission. The actual position of mains and services must be verified and established on site before any works are undertaken.

Asset Location Search Sewer Map - ALS/ALS Standard/2018_3816510


SP5824NE

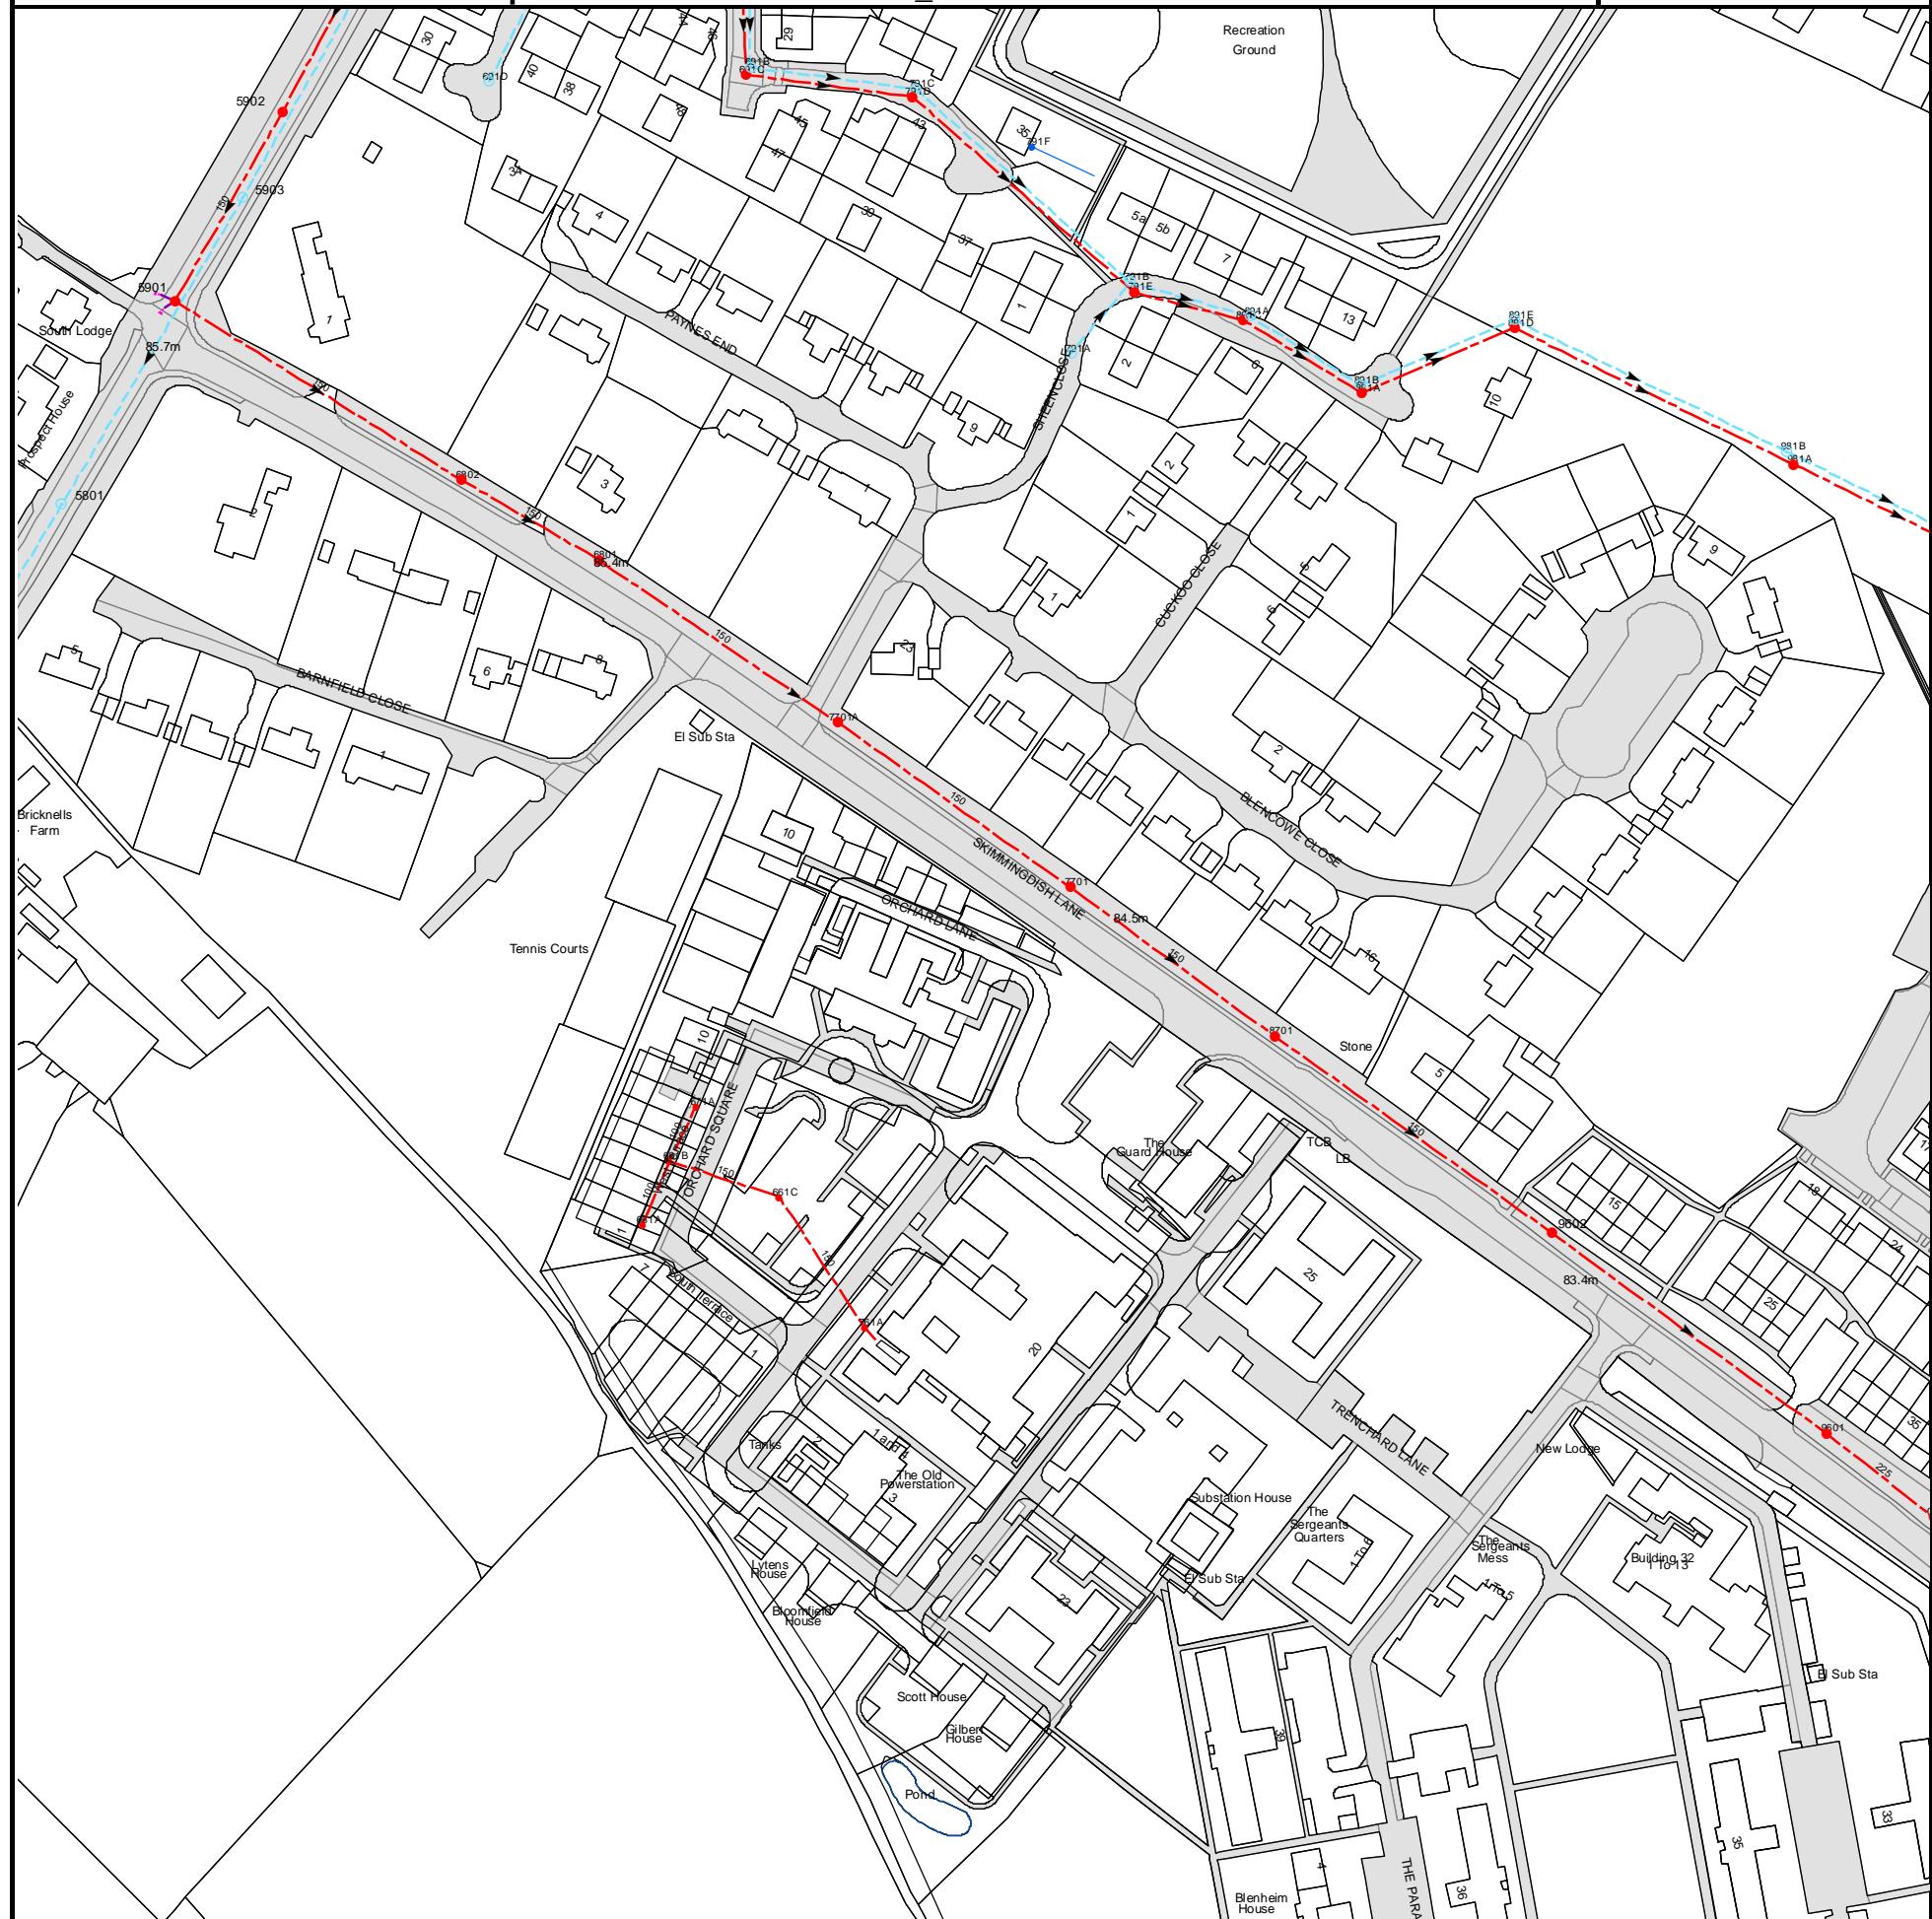

NB. Levels quoted in metres Ordnance Newlyn Datum. The value -9999.00 indicates that no survey information is available

Manhole Reference	Manhole Cover Level	Manhole Invert Level
661A	n/a	n/a
661B	n/a	n/a
671A	n/a	n/a
661C	n/a	n/a
761A	n/a	n/a
791F	n/a	n/a
5801	n/a	n/a
6802	85.62	83.47
5901	85.75	83.93
5903	n/a	n/a
5902	86.19	84.32
691D	n/a	n/a
691C	n/a	n/a
691B	n/a	n/a
791C	n/a	n/a
6801	85.368	83.078
7701A	85.025	82.595
791D	n/a	n/a
7701	84.35	82.18
791A	n/a	n/a
791B	n/a	n/a
791E	n/a	n/a
891C	n/a	n/a
891A	n/a	n/a
8701	84.05	81.75
891B	n/a	n/a
881A	n/a	n/a
891D	n/a	n/a
891E	n/a	n/a
9602	n/a	n/a
981B	n/a	n/a
981A	n/a	n/a
9601	82.4	80.59
0601	82.161	80.421

The position of the apparatus shown on this plan is given without obligation and warranty, and the accuracy cannot be guaranteed. Service pipes are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Thames Water for any error or omission. The actual position of mains and services must be verified and established on site before any works are undertaken.

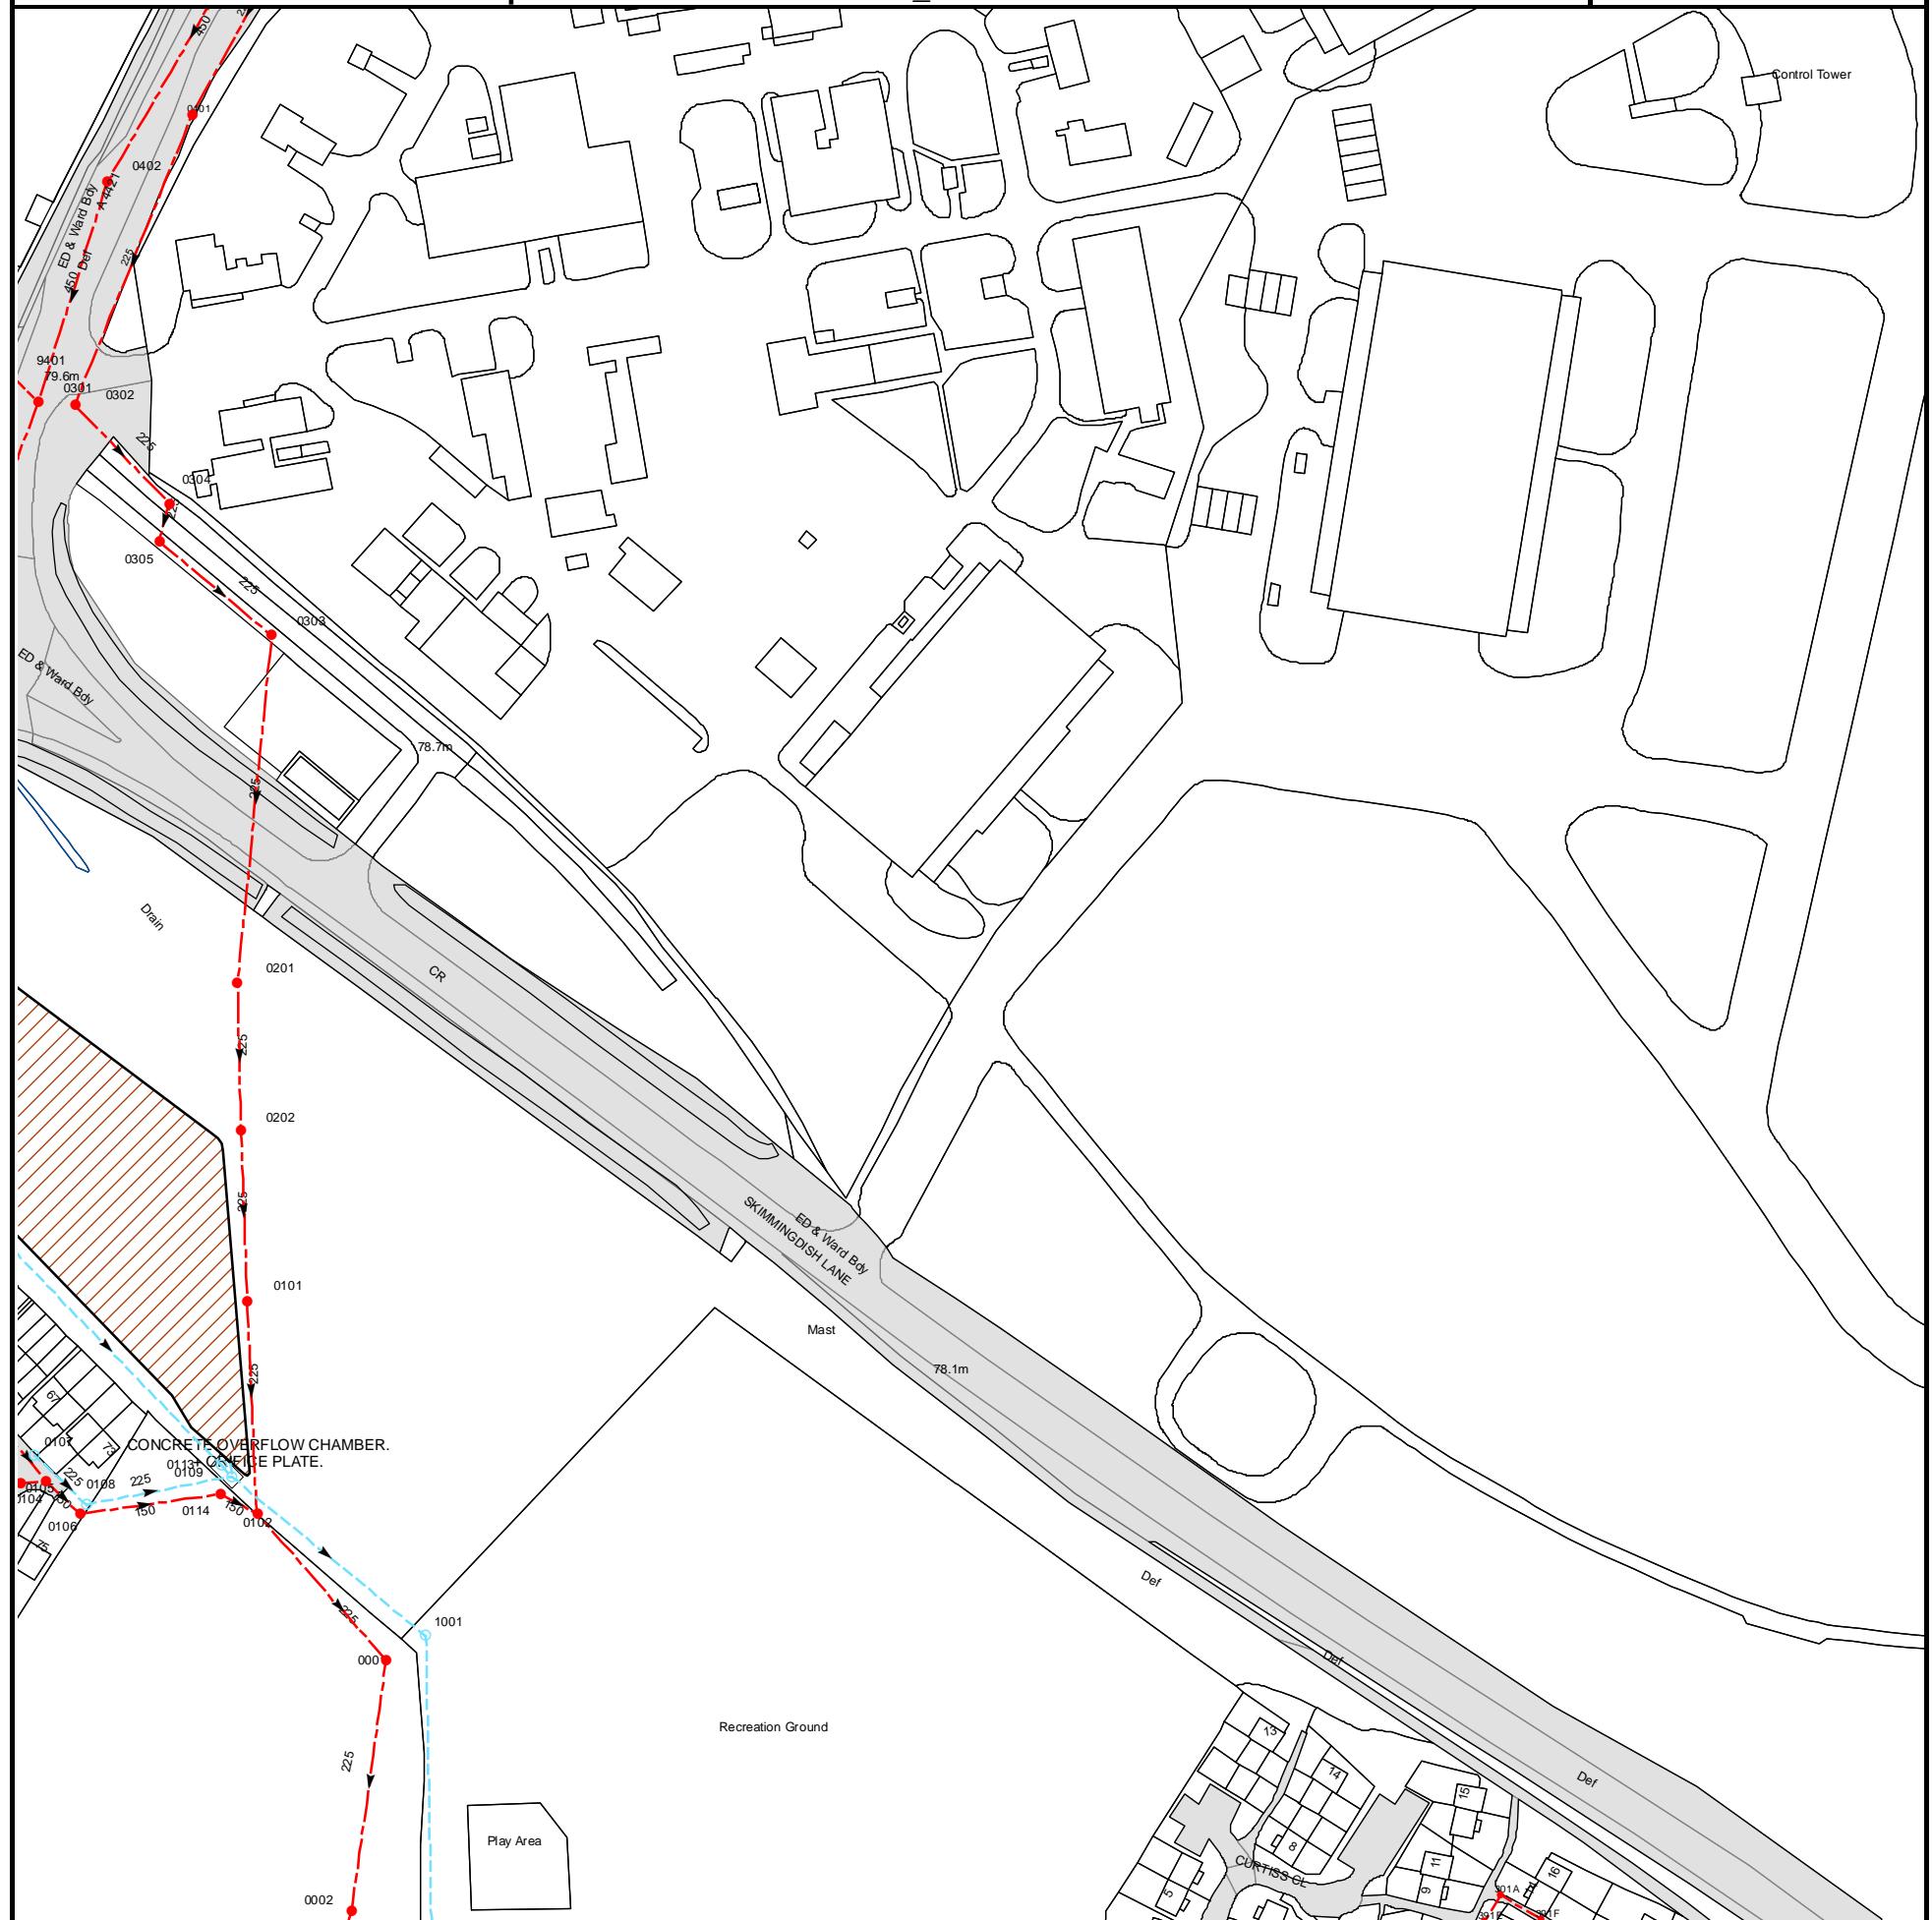

NB. Levels quoted in metres Ordnance Newlyn Datum. The value -9999.00 indicates that no survey information is available

Manhole Reference	Manhole Cover Level	Manhole Invert Level
0301	79.67	78.03
0302	79.52	78.48
0402	80.37	78.27
0401	80.61	79.04
0107	n/a	n/a
0305	n/a	n/a
0304	79.42	78.28
0113	n/a	n/a
0201	n/a	n/a
0202	n/a	n/a
0101	n/a	n/a
0303	n/a	n/a
0002	n/a	n/a
0001	77.72	76.44
1001	n/a	n/a
0106	n/a	n/a
0102	77.87	76.65
0108	n/a	n/a
0114	n/a	n/a
0104	n/a	n/a
0105	n/a	n/a
0109	n/a	n/a
301A	n/a	n/a

The position of the apparatus shown on this plan is given without obligation and warranty, and the accuracy cannot be guaranteed. Service pipes are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Thames Water for any error or omission. The actual position of mains and services must be verified and established on site before any works are undertaken.

Asset Location Search Sewer Map - ALS/ALS Standard/2018_3816510

SP5924NW



The width of the displayed area is 500m and the centre of the map is located at OS coordinates 459250,224750

The position of the apparatus shown on this plan is given without obligation and warranty, and the accuracy cannot be guaranteed. Service pipes are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Thames Water for any error or omission. The actual position of mains and services must be verified and established on site before any works are undertaken.

Based on the Ordnance Survey Map with the Sanction of the controller of H.M. Stationery Office, License no. 100019345 Crown Copyright Reserved.

NB. Levels quoted in metres Ordnance Newlyn Datum. The value -9999.00 indicates that no survey information is available

Manhole Reference	Manhole Cover Level	Manhole Invert Level
191S	n/a	n/a
091C	n/a	n/a
091B	n/a	n/a
091A	n/a	n/a
091G	n/a	n/a
091D	n/a	n/a
191J	n/a	n/a
191B	n/a	n/a
191A	n/a	n/a
191G	n/a	n/a
291D	n/a	n/a
291B	n/a	n/a
291C	n/a	n/a
0502	81.079	79.379
0501	81.22	79.22
1601	82.73	79.52
1701	83.87	79.67
1702	84.44	79.84
1703	84.17	80.85
1704	84.41	80.21
171A	n/a	n/a
2801	n/a	n/a
081A	n/a	n/a
191N	n/a	n/a
181C	n/a	n/a
181A	n/a	n/a
191Q	n/a	n/a
191R	n/a	n/a
181B	n/a	n/a
191L	n/a	n/a
191M	n/a	n/a
191K	n/a	n/a
191F	n/a	n/a
191P	n/a	n/a
091H	n/a	n/a
191I	n/a	n/a
091E	n/a	n/a
191C	n/a	n/a
091F	n/a	n/a
191O	n/a	n/a
191H	n/a	n/a
0504	82.09	80.06
0503	81.4	79.78
291A	n/a	n/a
2802	n/a	n/a
2901	n/a	n/a

The position of the apparatus shown on this plan is given without obligation and warranty, and the accuracy cannot be guaranteed. Service pipes are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Thames Water for any error or omission. The actual position of mains and services must be verified and established on site before any works are undertaken.



ALS Sewer Map Key

Public Sewer Types (Operated & Maintained by Thames Water)

	Foul: A sewer designed to convey waste water from domestic and industrial sources to a treatment works.
	Surface Water: A sewer designed to convey surface water (e.g. rain water from roofs, yards and car parks) to rivers or watercourses.
	Combined: A sewer designed to convey both waste water and surface water from domestic and industrial sources to a treatment works.
	Trunk Surface Water
	Trunk Foul
	Storm Relief
	Trunk Combined
	Vent Pipe
	Bio-solids (Sludge)
	Proposed Thames Surface Water Sewer
	Proposed Thames Water Foul Sewer
	Gallery
	Foul Rising Main
	Surface Water Rising Main
	Combined Rising Main
	Sludge Rising Main
	Vacuum

Notes:

- 1) All levels associated with the plans are to Ordnance Datum Newlyn.
- 2) All measurements on the plans are metric.
- 3) Arrows (on gravity fed sewers) or flecks (on rising mains) indicate direction of flow.
- 4) Most private pipes are not shown on our plans, as in the past, this information has not been recorded.
- 5) 'na' or '0' on a manhole level indicates that data is unavailable.

Sewer Fittings

A feature in a sewer that does not affect the flow in the pipe. Example: a vent is a fitting as the function of a vent is to release excess gas.

	Air Valve
	Dam Chase
	Fitting
	Meter
	Vent Column

Operational Controls

A feature in a sewer that changes or diverts the flow in the sewer. Example: A hydrobrake limits the flow passing downstream.

	Control Valve
	Drop Pipe
	Ancillary
	Weir

End Items

End symbols appear at the start or end of a sewer pipe. Examples: an Undefined End at the start of a sewer indicates that Thames Water has no knowledge of the position of the sewer upstream of that symbol. Outfall on a surface water sewer indicates that the pipe discharges into a stream or river.

	Outfall
	Undefined End
	Inlet

Other Symbols

Symbols used on maps which do not fall under other general categories

	▲/▲ Public/Private Pumping Station
	* Change of characteristic indicator (C.O.C.I.)
	☒ Invert Level
	<1 Summit

Areas

Lines denoting areas of underground surveys, etc.

	Agreement
	Operational Site
	Chamber
	Tunnel
	Conduit Bridge

Other Sewer Types (Not Operated or Maintained by Thames Water)

	Foul Sewer		Surface Water Sewer
	Combined Sewer		Gully
	Culverted Watercourse		Proposed
	Abandoned Sewer		

Asset Location Search Water Map - ALS/ALS Standard/2018_3816510

SP5824SE




The width of the displayed area is 500m and the centre of the map is located at OS coordinates 458750,224250

The position of the apparatus shown on this plan is given without obligation and warranty, and the accuracy cannot be guaranteed. Service pipes are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Thames Water for any error or omission. The actual position of mains and services must be verified and established on site before any works are undertaken.

Based on the Ordnance Survey Map with the Sanction of the controller of H.M. Stationery Office, License no. 100019345 Crown Copyright Reserved.

Asset Location Search Water Map - ALS/ALS Standard/2018_3816510


SP5824NE

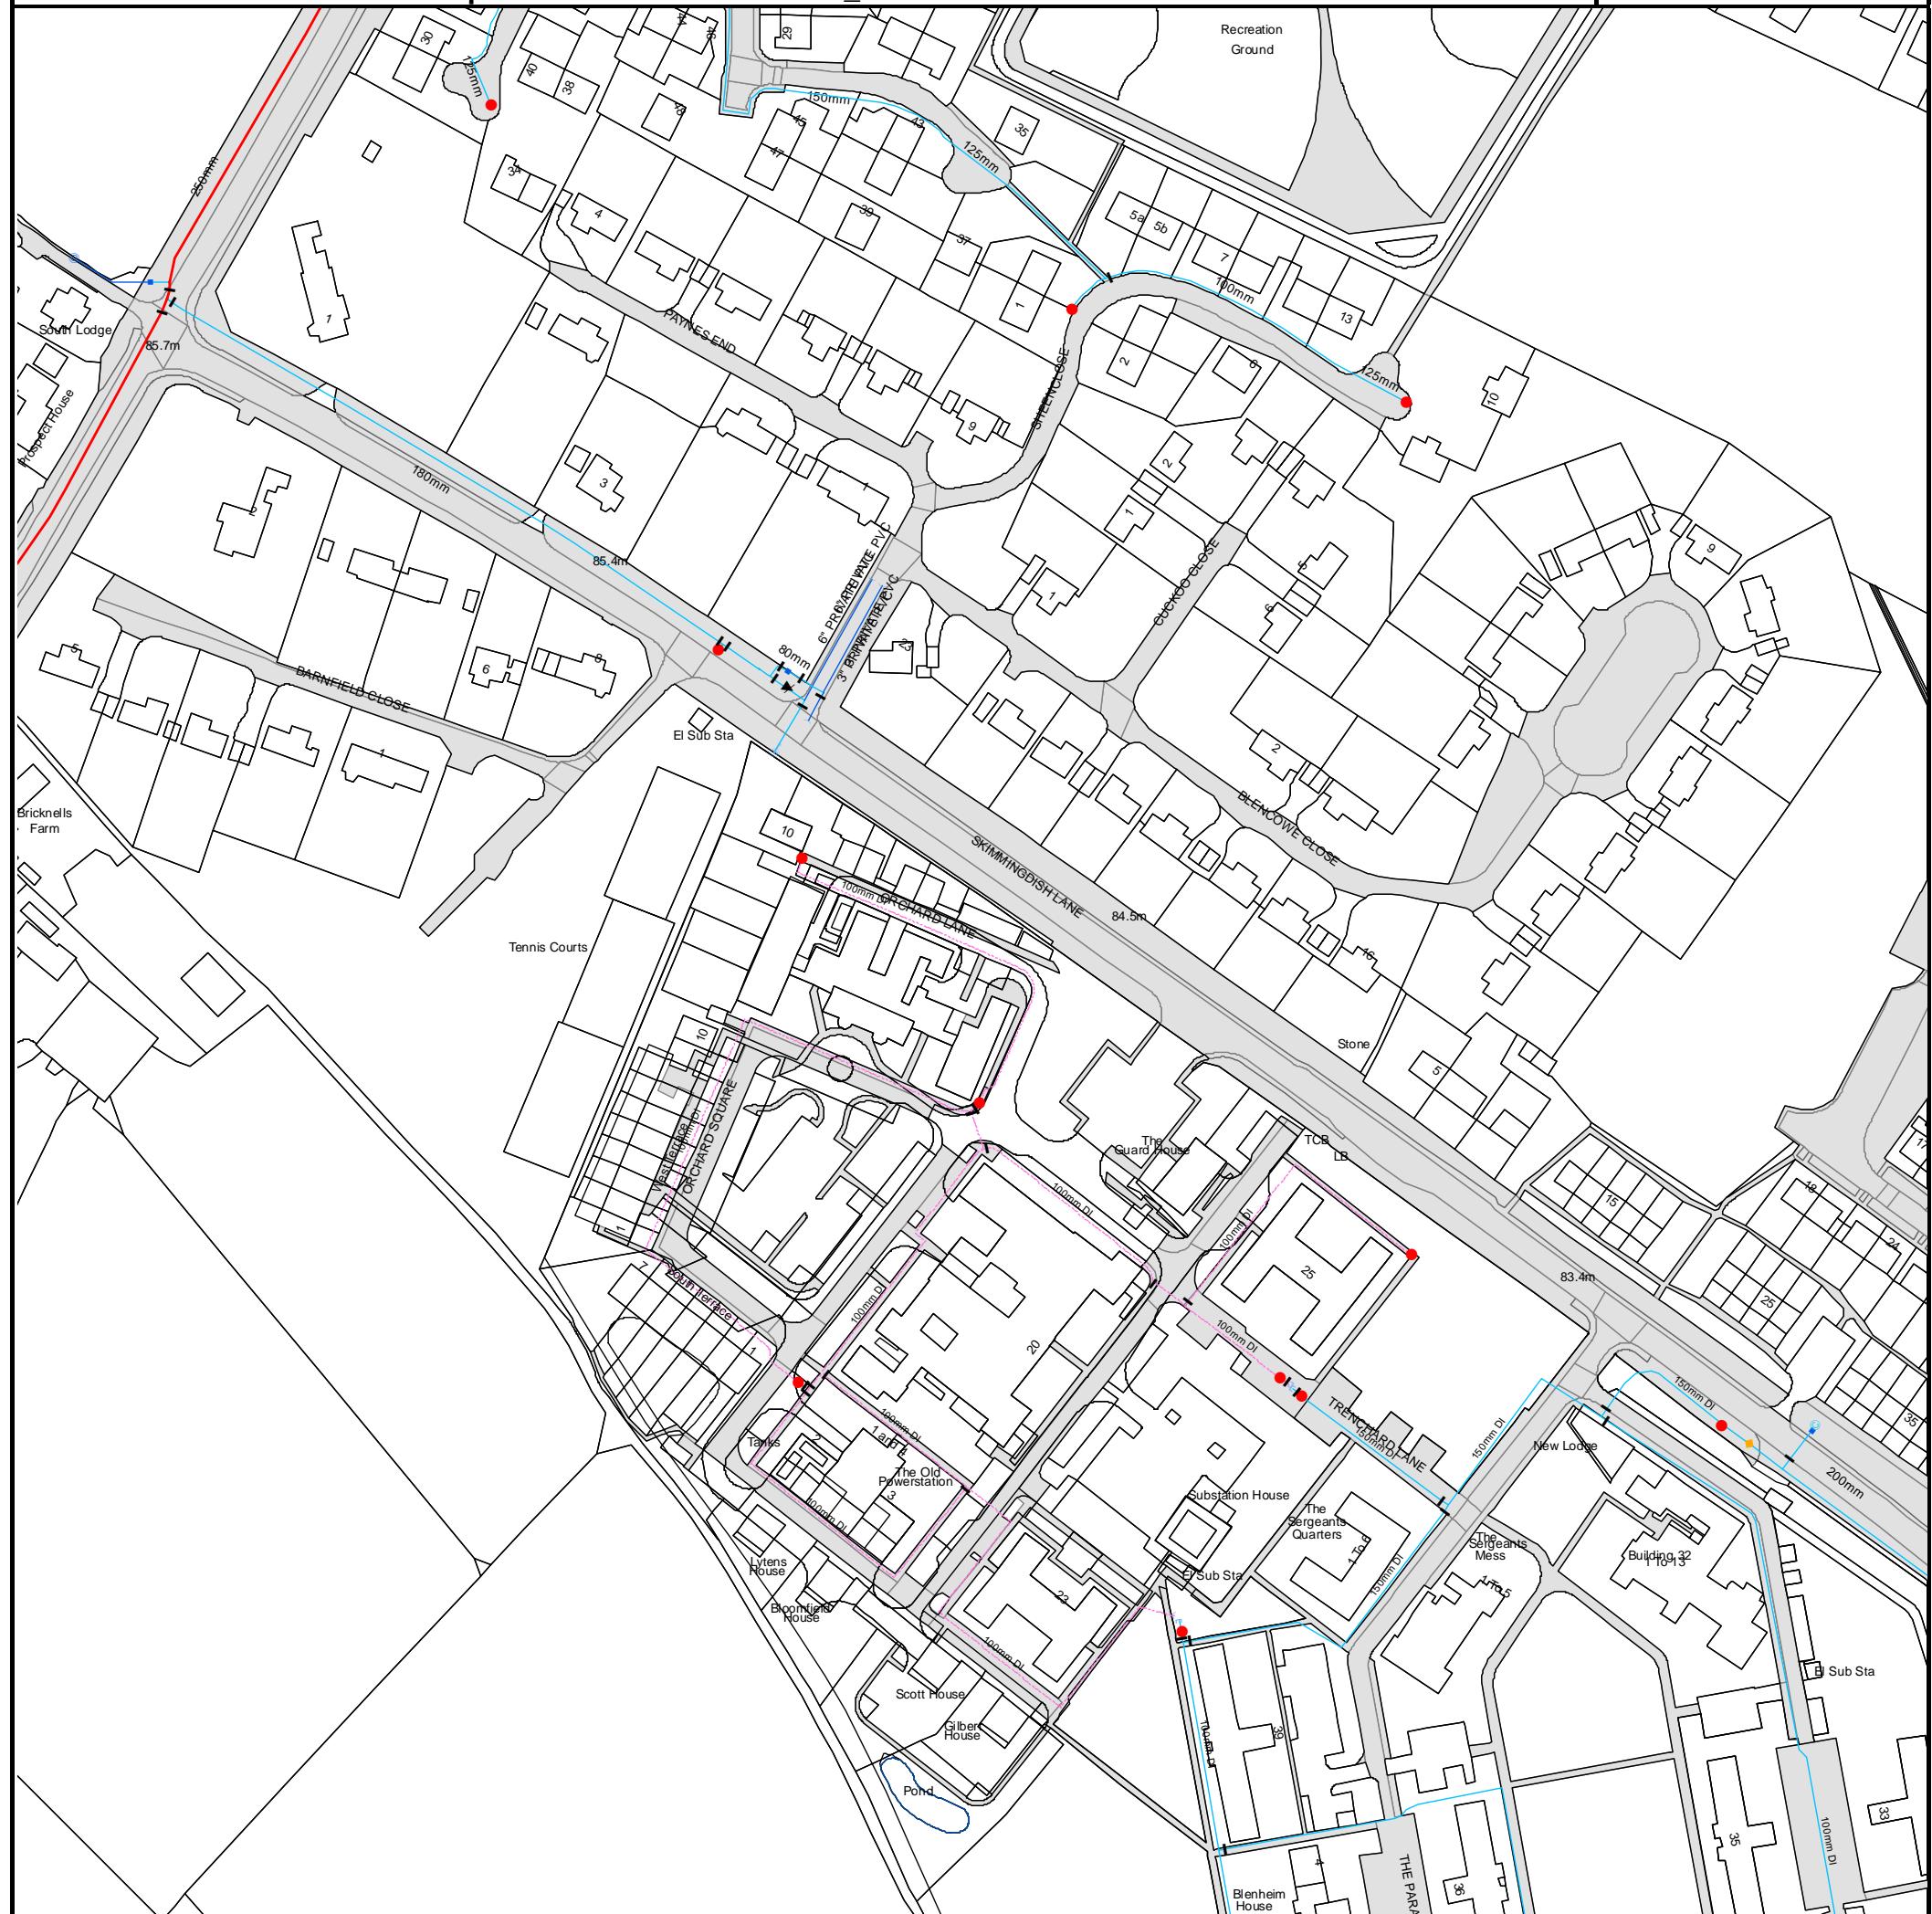

The width of the displayed area is 500m and the centre of the map is located at OS coordinates 458750,224750

The position of the apparatus shown on this plan is given without obligation and warranty, and the accuracy cannot be guaranteed. Service pipes are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Thames Water for any error or omission. The actual position of mains and services must be verified and established on site before any works are undertaken.

Based on the Ordnance Survey Map with the Sanction of the controller of H.M. Stationery Office, License no. 100019345 Crown Copyright Reserved.

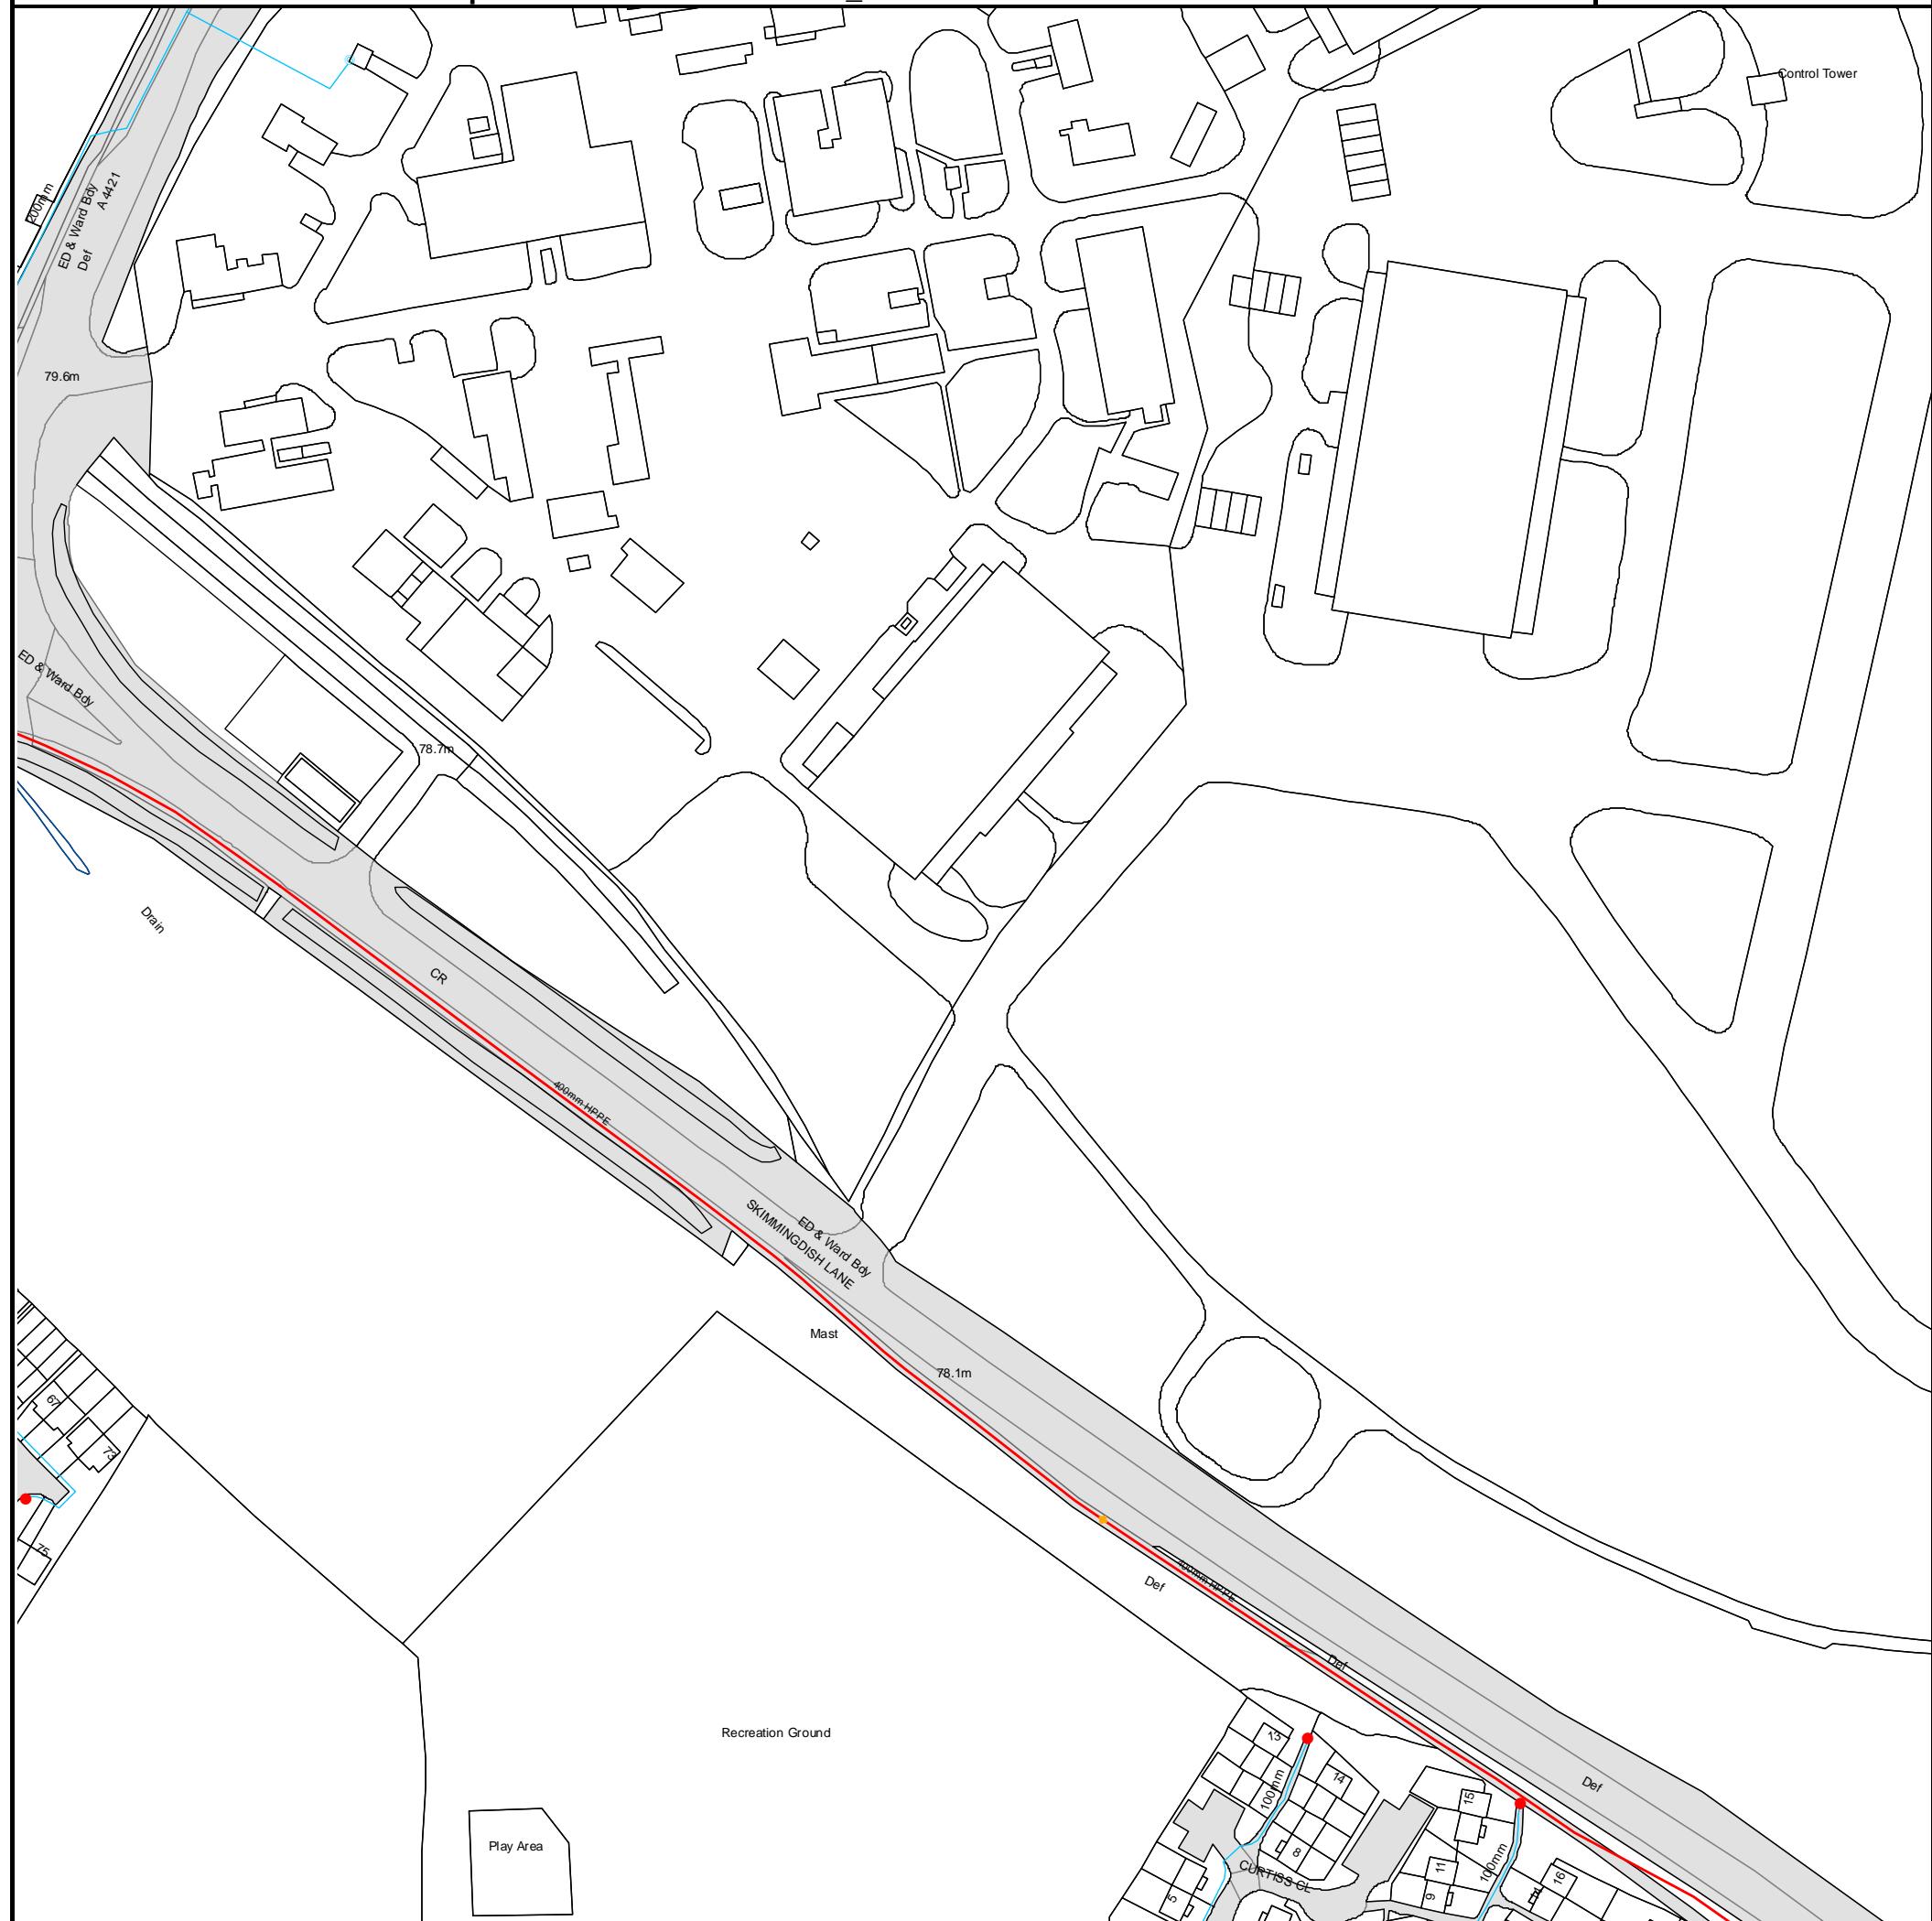

The width of the displayed area is 500m and the centre of the map is located at OS coordinates 459250, 224250

The position of the apparatus shown on this plan is given without obligation and warranty, and the accuracy cannot be guaranteed. Service pipes are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Thames Water for any error or omission. The actual position of mains and services must be verified and established on site before any works are undertaken.

Based on the Ordnance Survey Map with the Sanction of the controller of H.M. Stationery Office, License no. 100019345 Crown Copyright Reserved.

Asset Location Search Water Map - ALS/ALS Standard/2018_3816510

SP5924NW



The width of the displayed area is 500m and the centre of the map is located at OS coordinates 459250,224750

The position of the apparatus shown on this plan is given without obligation and warranty, and the accuracy cannot be guaranteed. Service pipes are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Thames Water for any error or omission. The actual position of mains and services must be verified and established on site before any works are undertaken.

Based on the Ordnance Survey Map with the Sanction of the controller of H.M. Stationery Office, License no. 100019345 Crown Copyright Reserved.



ALS Water Map Key

Water Pipes (Operated & Maintained by Thames Water)

- 4"** Distribution Main: The most common pipe shown on water maps. With few exceptions, domestic connections are only made to distribution mains.
- 16"** Trunk Main: A main carrying water from a source of supply to a treatment plant or reservoir, or from one treatment plant or reservoir to another. Also a main transferring water in bulk to smaller water mains used for supplying individual customers.
- 3" SUPPLY** Supply Main: A supply main indicates that the water main is used as a supply for a single property or group of properties.
- 3" FIRE** Fire Main: Where a pipe is used as a fire supply, the word FIRE will be displayed along the pipe.
- 3" METERED** Metered Pipe: A metered main indicates that the pipe in question supplies water for a single property or group of properties and that quantity of water passing through the pipe is metered even though there may be no meter symbol shown.
- Transmission Tunnel:** A very large diameter water pipe. Most tunnels are buried very deep underground. These pipes are not expected to affect the structural integrity of buildings shown on the map provided.
- Proposed Main:** A main that is still in the planning stages or in the process of being laid. More details of the proposed main and its reference number are generally included near the main.

PIPE DIAMETER	DEPTH BELOW GROUND
Up to 300mm (12")	900mm (3')
300mm - 600mm (12" - 24")	1100mm (3' 8")
600mm and bigger (24" plus)	1200mm (4')

Valves

- I General Purpose Valve
- ♦ Air Valve
- ▲ Pressure Control Valve
- X Customer Valve

Hydrants

- ● Single Hydrant

Meters

- ■ Meter

End Items

Symbol indicating what happens at the end of a water main.

- | Blank Flange
- T Capped End
- O Emptying Pit
- ⓧ Undefined End
- || Manifold
- ○ Customer Supply
- L Fire Supply

Operational Sites

- ⊕ Booster Station
- ⊖ Other
- ⊘ Other (Proposed)
- ▲ Pumping Station
- ▾ Service Reservoir
- ⊕ Shaft Inspection
- ⊖ Treatment Works
- ⊖ Unknown
- ⊖ Water Tower

Other Symbols

- ☒ Data Logger

Other Water Pipes (Not Operated or Maintained by Thames Water)

Other Water Company Main: Occasionally other water company water pipes may overlap the border of our clean water coverage area. These mains are denoted in purple and in most cases have the owner of the pipe displayed along them.

Private Main: Indicates that the water main in question is not owned by Thames Water. These mains normally have text associated with them indicating the diameter and owner of the pipe.

Terms and Conditions

All sales are made in accordance with Thames Water Utilities Limited (TWUL) standard terms and conditions unless previously agreed in writing.

1. All goods remain in the property of Thames Water Utilities Ltd until full payment is received.
2. Provision of service will be in accordance with all legal requirements and published TWUL policies.
3. All invoices are strictly due for payment 14 days from due date of the invoice. Any other terms must be accepted/agreed in writing prior to provision of goods or service, or will be held to be invalid.
4. Thames Water does not accept post-dated cheques-any cheques received will be processed for payment on date of receipt.
5. In case of dispute TWUL's terms and conditions shall apply.
6. Penalty interest may be invoked by TWUL in the event of unjustifiable payment delay. Interest charges will be in line with UK Statute Law 'The Late Payment of Commercial Debts (Interest) Act 1998'.
7. Interest will be charged in line with current Court Interest Charges, if legal action is taken.
8. A charge may be made at the discretion of the company for increased administration costs.

A copy of Thames Water's standard terms and conditions are available from the Commercial Billing Team (cashoperations@thameswater.co.uk).

We publish several Codes of Practice including a guaranteed standards scheme. You can obtain copies of these leaflets by calling us on 0800 316 9800

If you are unhappy with our service you can speak to your original goods or customer service provider. If you are not satisfied with the response, your complaint will be reviewed by the Customer Services Director. You can write to her at: Thames Water Utilities Ltd. PO Box 492, Swindon, SN38 8TU.

If the Goods or Services covered by this invoice falls under the regulation of the 1991 Water Industry Act, and you remain dissatisfied you can refer your complaint to Consumer Council for Water on 0121 345 1000 or write to them at Consumer Council for Water, 1st Floor, Victoria Square House, Victoria Square, Birmingham, B2 4AJ.

Ways to pay your bill

Credit Card	BACS Payment	Telephone Banking	Cheque
Call 0845 070 9148 quoting your invoice number starting CBA or ADS / OSS	Account number 90478703 Sort code 60-00-01 A remittance advice must be sent to: Thames Water Utilities Ltd., PO Box 3189, Slough SL1 4WW. or email ps.billing@thameswater.co.uk	By calling your bank and quoting: Account number 90478703 Sort code 60-00-01 and your invoice number	Made payable to ' Thames Water Utilities Ltd' Write your Thames Water account number on the back. Send to: Thames Water Utilities Ltd., PO Box 3189, Slough SL1 4WW or by DX to 151280 Slough 13

Thames Water Utilities Ltd Registered in England & Wales No. 2366661 Registered Office Clearwater Court, Vastern Rd, Reading, Berks, RG1 8DB.



Search Code

IMPORTANT CONSUMER PROTECTION INFORMATION

This search has been produced by Thames Water Property Searches, Clearwater Court, Vastern Road, Reading RG1 8DB, which is registered with the Property Codes Compliance Board (PCCB) as a subscriber to the Search Code. The PCCB independently monitors how registered search firms maintain compliance with the Code.

The Search Code:

- provides protection for homebuyers, sellers, estate agents, conveyancers and mortgage lenders who rely on the information included in property search reports undertaken by subscribers on residential and commercial property within the United Kingdom
- sets out minimum standards which firms compiling and selling search reports have to meet
- promotes the best practise and quality standards within the industry for the benefit of consumers and property professionals
- enables consumers and property professionals to have confidence in firms which subscribe to the code, their products and services.

By giving you this information, the search firm is confirming that they keep to the principles of the Code. This provides important protection for you.

The Code's core principles

Firms which subscribe to the Search Code will:

- display the Search Code logo prominently on their search reports
- act with integrity and carry out work with due skill, care and diligence
- at all times maintain adequate and appropriate insurance to protect consumers
- conduct business in an honest, fair and professional manner
- handle complaints speedily and fairly
- ensure that products and services comply with industry registration rules and standards and relevant laws
- monitor their compliance with the Code

Complaints

If you have a query or complaint about your search, you should raise it directly with the search firm, and if appropriate ask for any complaint to be considered under their formal internal complaints procedure. If you remain dissatisfied with the firm's final response, after your complaint has been formally considered, or if the firm has exceeded the response timescales, you may refer your complaint for consideration under The Property Ombudsman scheme (TPOs). The Ombudsman can award compensation of up to £5,000 to you if he finds that you have suffered actual loss as a result of your search provider failing to keep to the Code.

Please note that all queries or complaints regarding your search should be directed to your search provider in the first instance, not to TPOs or to the PCCB.

TPOs Contact Details

The Property Ombudsman scheme
Milford House
43-55 Milford Street
Salisbury
Wiltshire SP1 2BP
Tel: 01722 333306
Fax: 01722 332296
Email: admin@tpos.co.uk

You can get more information about the PCCB from www.propertycodes.org.uk

PLEASE ASK YOUR SEARCH PROVIDER IF YOU WOULD LIKE A COPY OF THE SEARCH CODE



Geo-Integrity Ltd.
www.geo-integrity.co.uk
murraybateman@geo-integrity.co.uk
07858 367 125
01280 816409



Trial Pit Infiltration Testing to BRE Digest 365


Client: Bicester Heritage
Site: New Technical Site
Dimensions: 0.70m x 1.50m x 0.81m
(width x length x depth)

Report No: 18-08-08
Date Tested: 17/09/18
Test Location: TP1

Test Response Zone Description - : Weathered Limestone

Time	Depth BGL	Time	Depth BGL	Time	Depth BGL
0	0.58	8	0.71		
1	0.59	10	0.74		
2	0.62	15	0.79		
3	0.64	18	0.81		
4	0.67				
5	0.68				
6	0.69				

Calculated Soil Infiltration Rate = 1.42×10^{-4} m/s to 1.72×10^{-4} m/s

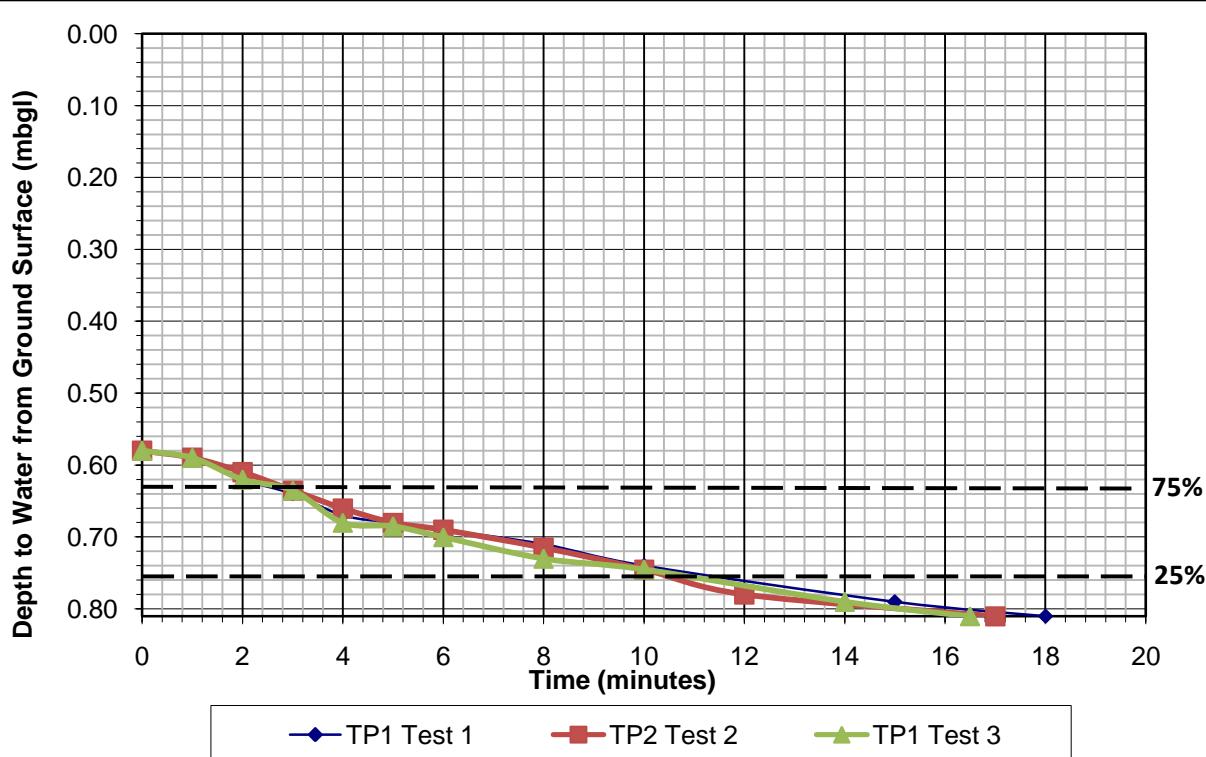



Geo-Integrity Ltd.
www.geo-integrity.co.uk
murraybateman@geo-integrity.co.uk
07858 367 125
01280 816409



Trial Pit Infiltration Testing to BRE Digest 365


Client: Bicester Heritage
Site: New Technical Site
Dimensions: 0.60m x 1.90m x 0.50m
(width x length x depth)

Report No: 18-08-08
Date Tested: 17/09/18
Test Location: TP2

Test Response Zone Description - : Weathered Limestone

Time	Depth BGL	Time	Depth BGL	Time	Depth BGL
0	0.32	7	0.39		
1	0.34	10	0.41		
2	0.35	15	0.46		
3	0.36	19.75	0.50		
4	0.37				
5	0.37				
6	0.38				

Calculated Soil Infiltration Rate = 9.78×10^{-5} m/s to 1.02×10^{-4} m/s

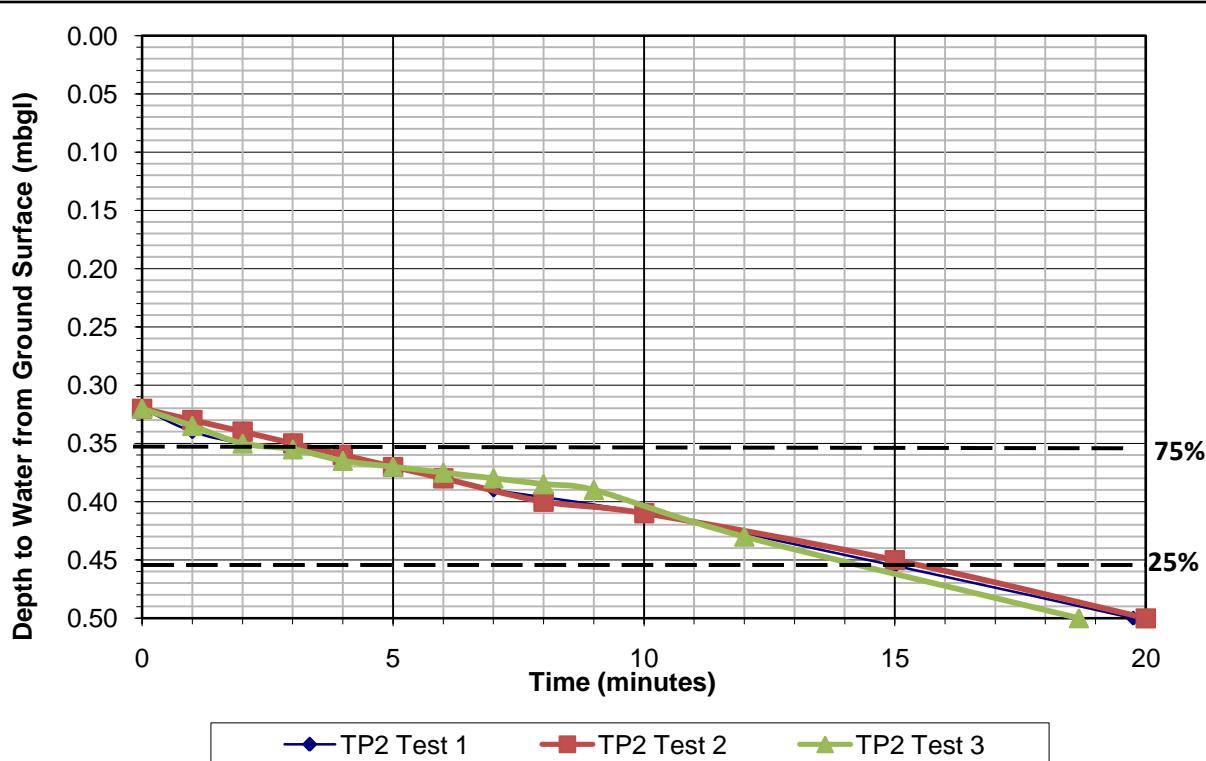



Geo-Integrity Ltd.
www.geo-integrity.co.uk
murraybateman@geo-integrity.co.uk
07858 367 125
01280 816409



Trial Pit Infiltration Testing to BRE Digest 365

Client: Bicester Heritage
Site: New Technical Site
Dimensions: 0.70m x 1.30m x 0.52m
(width x length x depth)


Report No: 18-08-08
Date Tested: 17/09/18
Test Location: TP3

Test Response Zone Description - : Made Ground

Time	Depth BGL	Time	Depth BGL	Time	Depth BGL
0	0.36	8	0.37	60	0.37
1	0.37	10	0.37	75	0.37
2	0.37	15	0.37	80	0.37
3	0.37	20	0.37	90	0.37
4	0.37	30	0.37	110	0.37
5	0.37	45	0.37	120	0.37
6	0.37	50	0.37	1440	0.38

Unable to Calculate Average Soil Infiltration Rate

Comment: Insufficient drop in water level.

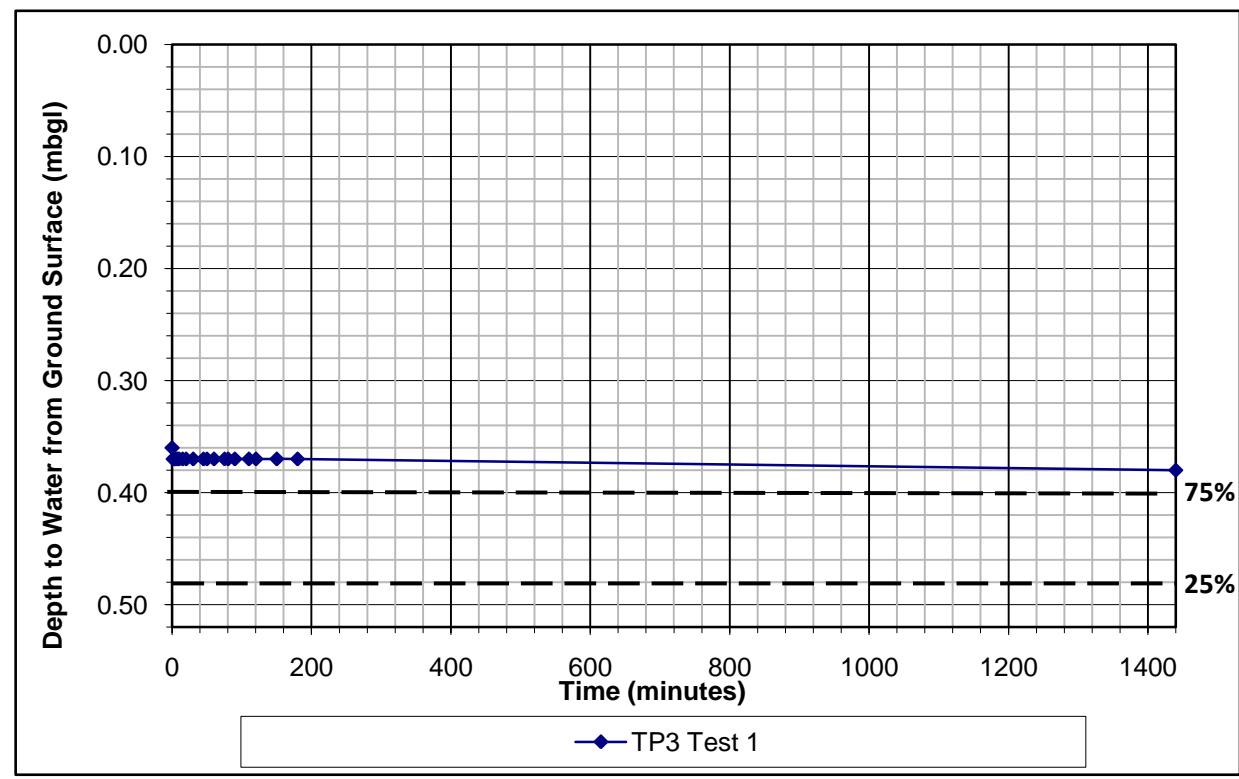

Appendix B

Existing Drainage Calculations

AKSWard		Page 1
Seacourt Tower West Way Oxford	New Technical Site	
Date 18/07/2018 File Qbar.srcx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1	

ICP SUDS Mean Annual Flood

Input

Return Period (years)	30	Soil	0.150
Area (ha)	1.080	Urban	0.065
SAAR (mm)	682	Region Number	Region 6

Results 1/s

QBAR Rural 0.4
QBAR Urban 0.5

Q30 years 1.2

Q1 year 0.5
Q30 years 1.2
Q100 years 1.6

AKSWard		Page 1
Seacourt Tower West Way Oxford	New Technical Site	
Date 18/07/2018 File Qbar.srcx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1	

Greenfield Runoff Volume

FSR Data

Return Period (years)	1
Storm Duration (mins)	360
Region	England and Wales
M5-60 (mm)	20.000
Ratio R	0.404
Areal Reduction Factor	1.00
Area (ha)	1.060
SAAR (mm)	685
CWI	102.300
Urban	0.065
SPR	10.000

Results

Percentage Runoff (%) 5.61
 Greenfield Runoff Volume (m³) 12.935

AKSWard		Page 1
Seacourt Tower West Way Oxford	New Technical Site	
Date 18/07/2018 File Qbar.srcx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1	

Greenfield Runoff Volume

FSR Data

Return Period (years)	30
Storm Duration (mins)	360
Region	England and Wales
M5-60 (mm)	20.000
Ratio R	0.404
Areal Reduction Factor	1.00
Area (ha)	1.060
SAAR (mm)	685
CWI	102.300
Urban	0.065
SPR	10.000

Results

Percentage Runoff (%) 7.50
 Greenfield Runoff Volume (m³) 38.156

AKSWard		Page 1
Seacourt Tower West Way Oxford	New Technical Site	
Date 18/07/2018 File Qbar.srcx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1	

Greenfield Runoff Volume

FSR Data

Return Period (years)	100
Storm Duration (mins)	360
Region	England and Wales
M5-60 (mm)	20.000
Ratio R	0.404
Areal Reduction Factor	1.00
Area (ha)	1.060
SAAR (mm)	685
CWI	102.300
Urban	0.065
SPR	10.000

Results

Percentage Runoff (%) 9.48
 Greenfield Runoff Volume (m³) 62.554

Appendix C
Proposed Site Plans

GENERAL NOTES

- All setting out to be in accordance with the Architects drawings. Any discrepancies between the Engineers and Architects drawings to be referred to the Architect before proceeding. Dimensions must not be scaled.
- All drainage to be installed in accordance with relevant Building Regulations documents and Current Sewers for Adoption where applicable.
- Connections to Public sewers to be agreed and inspected by Water Authority.
- Invert level, size and cover levels to existing manholes and sewers to be checked prior to any construction. Any discrepancies to be reported immediately.
- Invert to base of soil stack bends to be 450mm below lowest branch connection for up to 3 storeys buildings. For buildings up to 5 storeys the invert to base of soil stack bends should be not less than 750mm.
- All RWP & Foul Water drain point setting out is to be confirmed by Architect.
- All RWP & SWP sizes & setting out by Architect / M&E Engineer. All below ground connections to match above ground outlet size, Min 100/110mm diameter.
- Foul drains to project 100mm above finished floor level.
- All internal Manholes and Inspection Chambers to have double sealed recessed covers to suit floor finishes by Architect.
- All external covers in footpath and roads in non tarmac areas to have recessed trays to suit the paving material.
- Refer to drainage specification for pipe materials.
- All pipework to be 100/110 UNO. Refer to note 7 connection sizes.
- All foul and surface water drainage stacks to have above ground rodding access, refer to above ground drainage layout by others.
- This drawing has been produced in colour and should be reproduced in colour for clarity.
- A CCTV Survey and report in WINCAN format for all new drainage will be required before the "As Built" drawings will be issued.

IDENTIFIES RISKS DURING THE CONSTRUCTION PROCESS ON THE DRAWINGS:

NOTE: The list below and notes on the drawing identify risks which are deemed to be unusual, abnormal, residual or unexpected to a competent contractor carrying out the works. These notes relate to risks which we have been unable to design out.

Key

- Road Gully
- Storm Polypropylene Inspection Chamber
- Storm Concrete Inspection Chamber
- Storm Concrete Manhole
- Permeable Tarmac
- Grasscrete Paving
- Foul Polypropylene Inspection Chamber
- Foul Concrete Inspection Chamber
- Foul Concrete Manhole
- FW New Foul Sewer
- SW New Surface Water Sewer
- - - LD New Linear Drainage System
- Existing Drainage
- FW Existing Foul Sewer
- SW Existing Surface Water Sewer
- X Ex SW Existing Sewers to be abandoned and grouted up either end

P02 Drainage updated to suit infiltration rates NJ GT 04.10.18

P01 Preliminary Issue NJ GT 18.07.18

Rev. Amendment Dm Chkd Date

Drg. Status Suitability

Preliminary

AKS Ward®

CONSTRUCTION CONSULTANTS

Seacourt Tower London

West Way Hitchin

Oxford Oxford

OX2 0JJ Southampton

Tel: 01865 240071 Birmingham

Fax: 01865 240066

e-mail: oxford@aksward.com

web: www.aksward.com

Client **Bicester Heritage Ltd.**

Project **New Technical Site**

Title **Drainage Layout Sheet 1 of 2**


Reviewed Scheme GT Date 18.07.18

Reviewed Final Date

Scales at A1 1:200 Project No. **X162034**


Project Ref. Originator Zone Level Type Role Drg. No. Rev.

BHH AKSW XX GF DR C 9201 P02

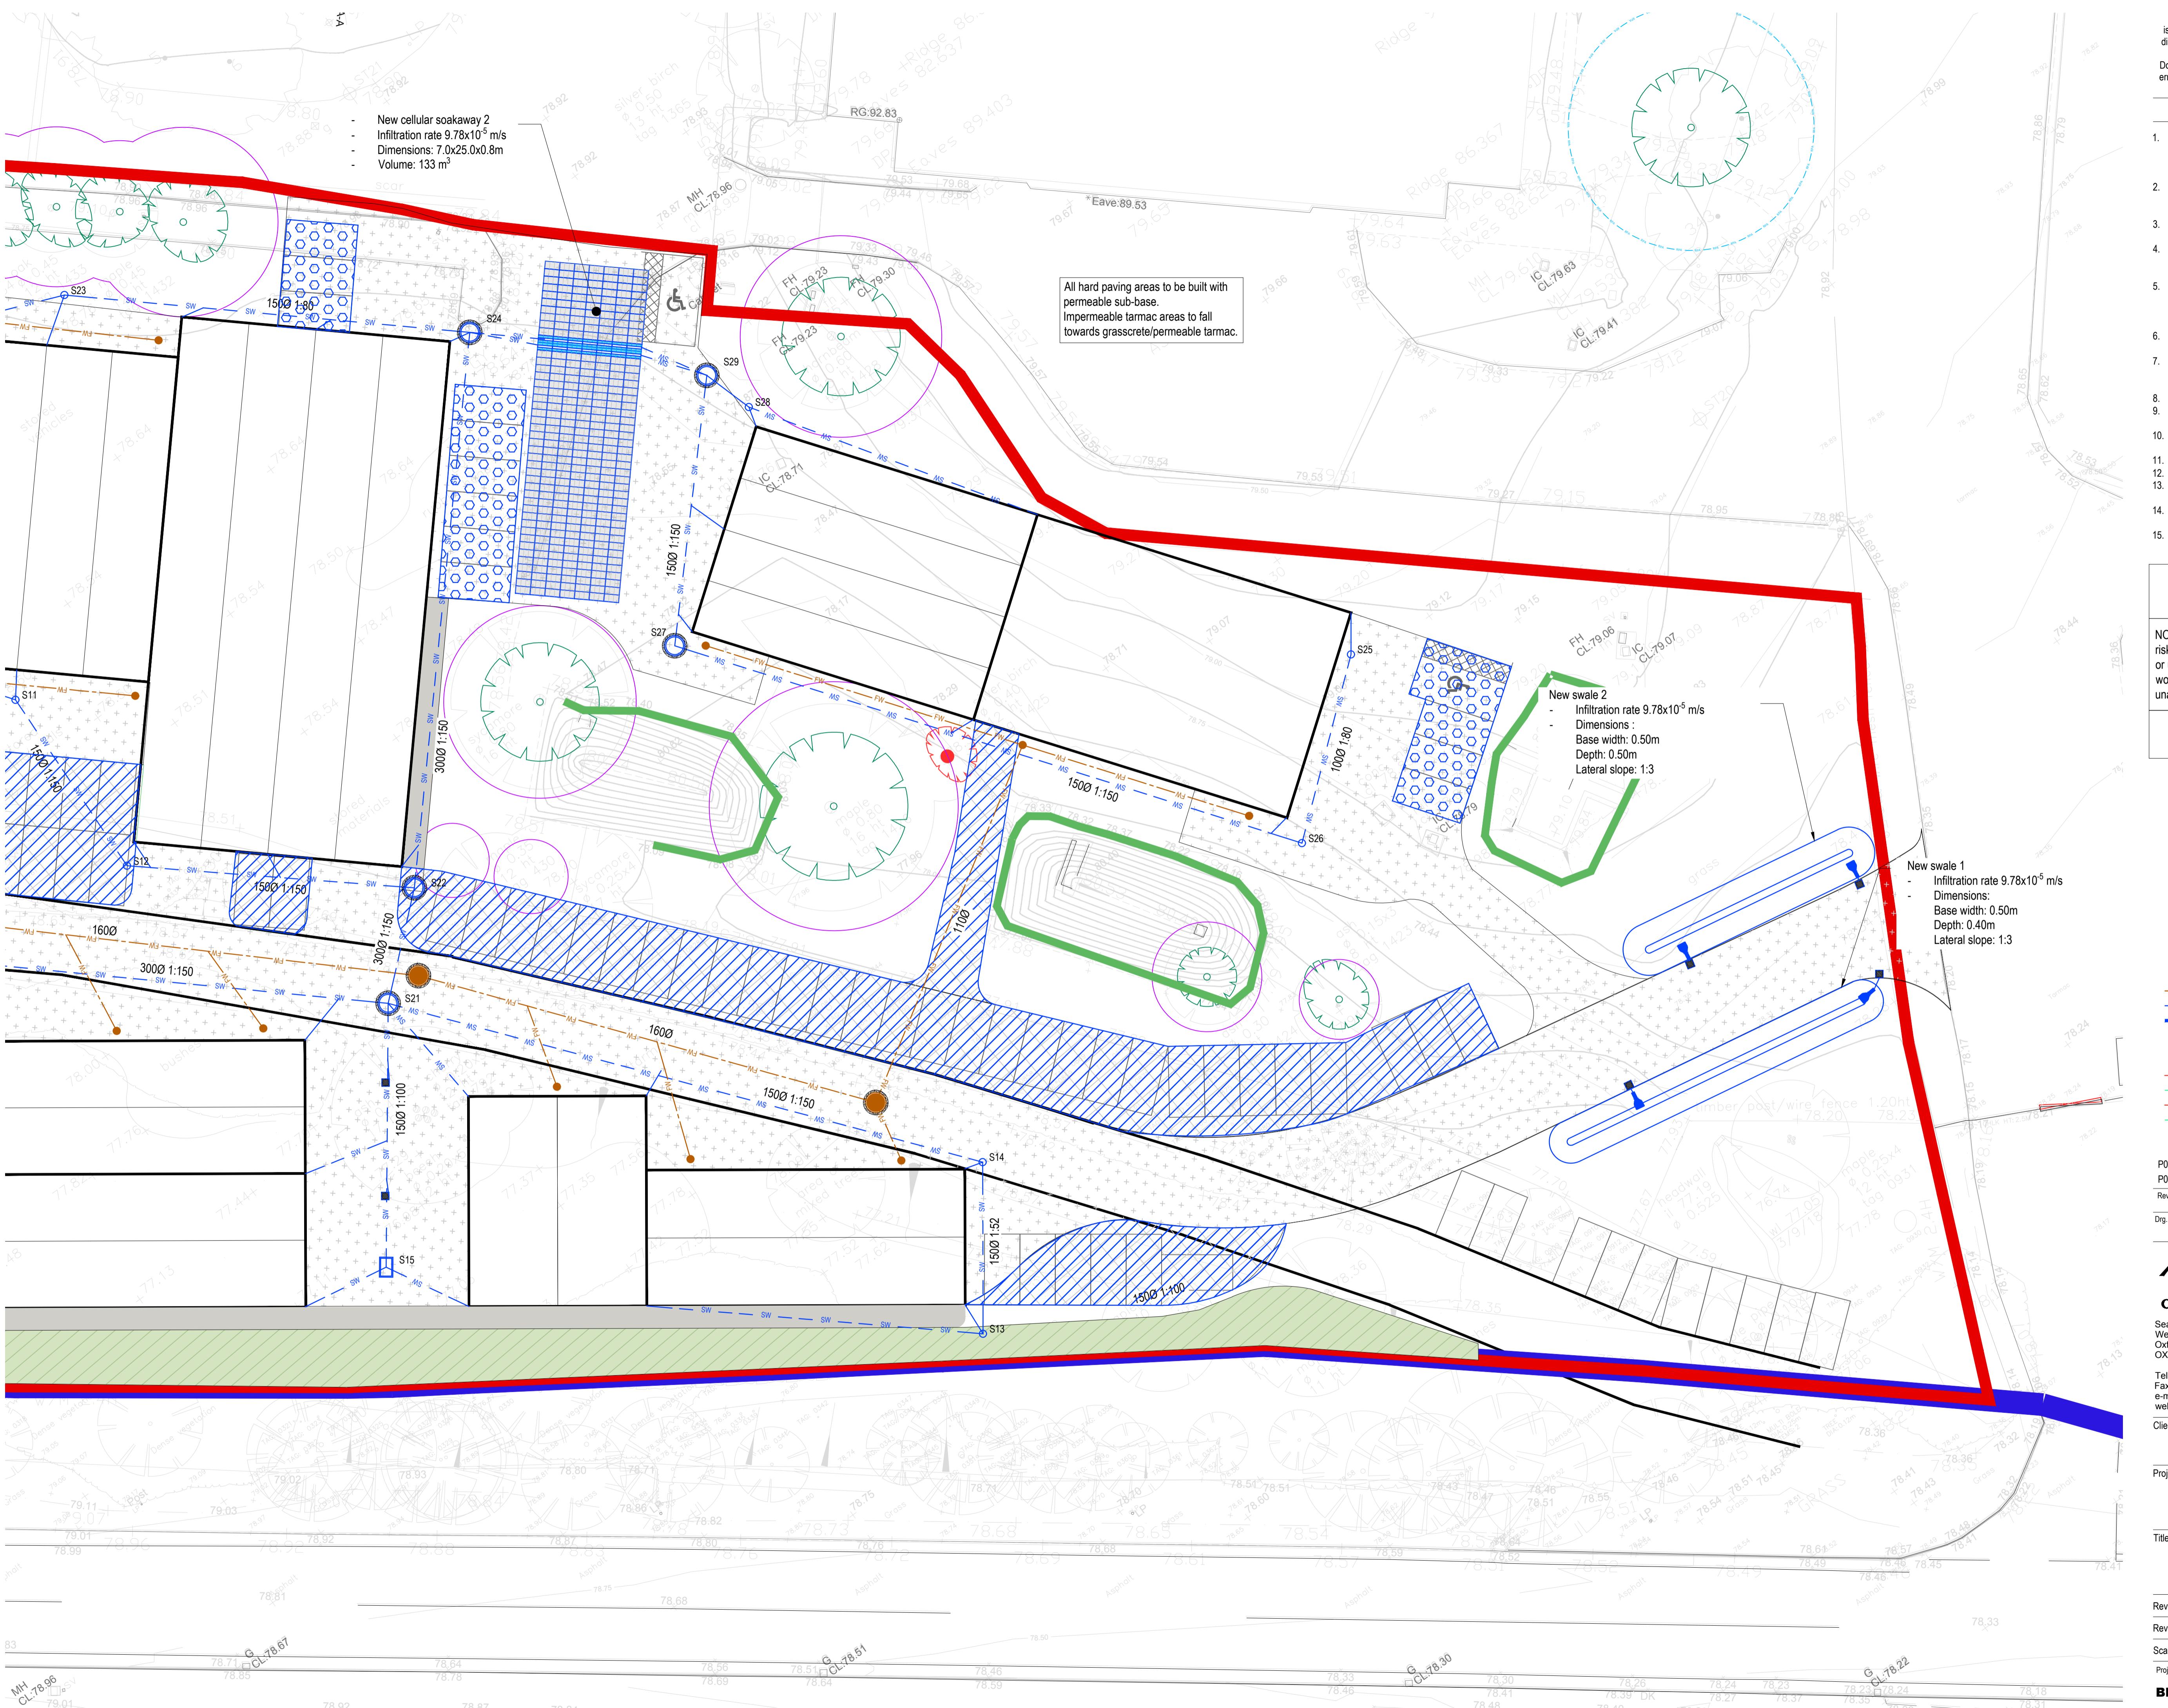


GENERAL NOTES

- All setting out to be in accordance with the Architects drawings. Any discrepancies between the Engineers and Architects drawings to be referred to the Architect before proceeding. Dimensions must not be scaled.
- All drainage to be installed in accordance with relevant Building Regulations documents and Current Sewers for Adoption where applicable.
- Connections to Public sewers to be agreed and inspected by Water Authority.
- Invert level, size and cover levels to existing manholes and sewers to be checked prior to any construction. Any discrepancies to be reported immediately.
- Invert to base of soil stack bends to be 450mm below lowest branch connection for up to 3 storeys buildings. For buildings up to 5 storeys the invert to base of soil stack bends should be not less than 750mm.
- All RWP & Foul Water drain point setting out is to be confirmed by Architect.
- All RWP & SVP sizes & setting out by Architect / M&E Engineer. All below ground connections to match above ground outlet size, Min 100/110mm diameter.
- Foul drains to project 100mm above finished floor level.
- All internal Manholes and Inspection Chambers to have double sealed recessed covers to suit floor finishes by Architect.
- All external covers in footpath and roads in non tarmac areas to have recessed trays to suit the paving material.
- Refer to drainage specification for pipe materials.
- All pipework to be 100/110 UNO. Refer to note 7 connection sizes.
- All foul and surface water drainage stacks to have above ground rodding access, refer to above ground drainage layout by others.
- This drawing has been produced in colour and should be reproduced in colour for clarity.
- A CCTV Survey and report in WINCAN format for all new drainage will be required before the "As Built" drawings will be issued.

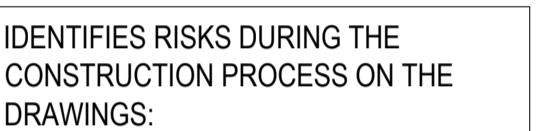

IDENTIFIES RISKS DURING THE CONSTRUCTION PROCESS ON THE DRAWINGS:

NOTE: The list below and notes on the drawing identify risks which are deemed to be unusual, abnormal, residual or unexpected to a competent contractor carrying out the works. These notes relate to risks which we have been unable to design out.

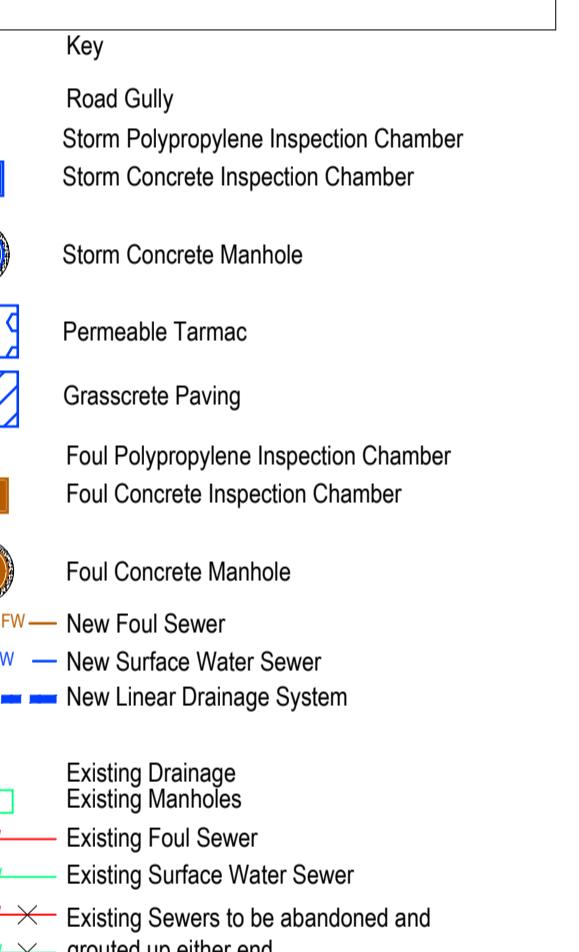

P02 Drainage updated to suit infiltration rates NJ GT 04.10.18

P01 Preliminary Issue NJ GT 18.07.18

Rev. Amendment Dm Chkd Date

Drg. Status Suitability

Preliminary

AKSWard®

CONSTRUCTION CONSULTANTS

Seacourt Tower
West Way
Oxford OX2 0JJ
Tel: 01865 240071
Fax: 01865 240066
e-mail: oxford@aksward.com
web: www.aksward.com

Client **Bicester Heritage Ltd.**

Project **New Technical Site**

Title **Drainage Layout Sheet 1 of 2**

Reviewed Scheme GT Date 18.07.18

Reviewed Final Date

Scales at A1 1:200 Project No. **X162034**


Project Ref. Originator Zone Level Type Role Drg No. Rev.

BHH AKSW-XX-GF-DR-C 9201 P02

London
Hitchin
Oxford
Southampton
Birmingham

GENERAL NOTES

- All setting out to be in accordance with the Architects drawings. Any discrepancies between the Engineers and Architects drawings must be referred to the Architect before proceeding. Dimensions must not be scaled.

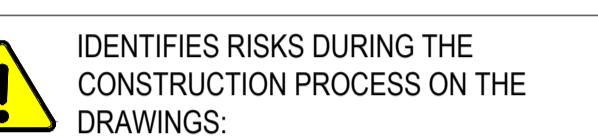

NOTE: The list below and notes on the drawing identify risks which are deemed to be unusual, abnormal, residual or unexpected to a competent contractor carrying out the works. These notes relate to risks which we have been unable to design out.

P01	Preliminary Issue	NJ	GT	19.07.18
Rev.	Amendment	Dm	Chkd	Date
Drg. Status	Preliminary			Suitability

AKSWard®
CONSTRUCTION CONSULTANTS

Seacourt Tower
West Way
Oxford
OX2 0JJ
Tel: 01865 240071
Fax: 01865 248006
e-mail: oxford@aksward.com
web: www.aksward.com

Client **Bicester Heritage Ltd.**

Project **New Technical Site**

Title **Exceedance Flood Path
Events Greater than
100 year + Climate Change**

Reviewed Scheme GT Date 19.07.18

Reviewed Final Date

Scales at A1 1:200 Project No. **X162034**

Project Ref. Originator Zone Level Type Role Drg. No. Rev.

BHH AKSW XX GF DR C 9208 P01



GENERAL NOTES

- All setting out to be in accordance with the Architects drawings. Any discrepancies between the Engineers and the Architects drawings must be referred to the Architect before proceeding. Dimensions must not be scaled.

! IDENTIFIES RISKS DURING THE CONSTRUCTION PROCESS ON THE DRAWINGS:

NOTE: The list below and notes on the drawing identify risks which are deemed to be unusual, abnormal, residual or unexpected to a competent contractor carrying out the works. These notes relate to risks which we have been unable to design out.



P01	Preliminary Issue	NJ	GT	19.07.18
Rev.	Amendment	Dm	Chkd	Date

Preliminary

AKSWard®

CONSTRUCTION CONSULTANTS

Seacourt Tower
West Way
Oxford
OX2 0JJ
Tel: 01865 240071
Fax: 01865 248006
e-mail: oxford@aksward.com
web: www.aksward.com

London
Hitchin
Oxford
Southampton
Birmingham

Client Bicester Heritage Ltd.

Project New Technical Site

Title Surface Water Flood Path

Reviewed Scheme	GT	Date	19.07.18
-----------------	----	------	----------

Reviewed Final	Date
----------------	------

Scales at A1	1:200	Project No.	X162034
--------------	-------	-------------	---------

Project Ref.	Originator	Zone	Level	Type	Role	Dig No.	Rev.
--------------	------------	------	-------	------	------	---------	------

BHH AKSW XX GF DR C 9209 P01

Appendix D
Proposed Drainage Calculations

AKSWard Ltd		Page 1
Seacourt Tower West Way Oxford OX2 0JJ	New Technical Site SWS to Soakaway	
Date 18/07/2018 File Proposed_SWS_P03.mdx	Designed by NJ Checked by GT	
Micro Drainage	Network 2018.1.1	

STORM SEWER DESIGN by the Modified Rational Method

Design Criteria for Storm

Pipe Sizes STANDARD Manhole Sizes STANDARD

FSR Rainfall Model - England and Wales

Return Period (years)	30	PIMP (%)	100
M5-60 (mm)	20.000	Add Flow / Climate Change (%)	0
Ratio R	0.404	Minimum Backdrop Height (m)	0.200
Maximum Rainfall (mm/hr)	50	Maximum Backdrop Height (m)	1.500
Maximum Time of Concentration (mins)	30	Min Design Depth for Optimisation (m)	1.200
Foul Sewage (l/s/ha)	0.000	Min Vel for Auto Design only (m/s)	1.00
Volumetric Runoff Coeff.	0.750	Min Slope for Optimisation (1:X)	500

Designed with Level Soffits

Simulation Criteria for Storm

Volumetric Runoff Coeff 0.750 Additional Flow - % of Total Flow 0.000

Areal Reduction Factor 1.000 MADD Factor * 10m³/ha Storage 2.000

Hot Start (mins) 0 Inlet Coeffiecient 0.800

Hot Start Level (mm) 0 Flow per Person per Day (l/per/day) 0.000

Manhole Headloss Coeff (Global) 0.500 Run Time (mins) 60

Foul Sewage per hectare (l/s) 0.000 Output Interval (mins) 1

Number of Input Hydrographs 0 Number of Storage Structures 2

Number of Online Controls 2 Number of Time/Area Diagrams 0

Number of Offline Controls 0 Number of Real Time Controls 0

Synthetic Rainfall Details

Rainfall Model	FSR	Profile Type	Summer
Return Period (years)	30	Cv (Summer)	0.750
Region	England and Wales	Cv (Winter)	0.840
M5-60 (mm)	20.000	Storm Duration (mins)	30
Ratio R	0.404		

AKSWard Ltd		Page 2
Seacourt Tower West Way Oxford OX2 0JJ	New Technical Site SWS to Soakaway	
Date 18/07/2018 File Proposed_SWS_P03.mdx	Designed by NJ Checked by GT	
Micro Drainage	Network 2018.1.1	

Online Controls for Storm

Pump Manhole: Soakaway 1, DS/PN: S1.006, Volume (m³): 2.3

Invert Level (m) 77.139

Depth (m)	Flow (l/s)						
0.100	0.0000	0.900	0.0000	1.700	0.0000	2.500	0.0000
0.200	0.0000	1.000	0.0000	1.800	0.0000	2.600	0.0000
0.300	0.0000	1.100	0.0000	1.900	0.0000	2.700	0.0000
0.400	0.0000	1.200	0.0000	2.000	0.0000	2.800	0.0000
0.500	0.0000	1.300	0.0000	2.100	0.0000	2.900	0.0000
0.600	0.0000	1.400	0.0000	2.200	0.0000	3.000	0.0000
0.700	0.0000	1.500	0.0000	2.300	0.0000		
0.800	0.0000	1.600	0.0000	2.400	0.0000		

Pump Manhole: Soakaway 2, DS/PN: S6.004, Volume (m³): 3.0

Invert Level (m) 76.408

Depth (m)	Flow (l/s)						
0.100	0.0000	0.900	0.0000	1.700	0.0000	2.500	0.0000
0.200	0.0000	1.000	0.0000	1.800	0.0000	2.600	0.0000
0.300	0.0000	1.100	0.0000	1.900	0.0000	2.700	0.0000
0.400	0.0000	1.200	0.0000	2.000	0.0000	2.800	0.0000
0.500	0.0000	1.300	0.0000	2.100	0.0000	2.900	0.0000
0.600	0.0000	1.400	0.0000	2.200	0.0000	3.000	0.0000
0.700	0.0000	1.500	0.0000	2.300	0.0000		
0.800	0.0000	1.600	0.0000	2.400	0.0000		

AKSWard Ltd		Page 3
Seacourt Tower West Way Oxford OX2 0JJ	New Technical Site SWS to Soakaway	
Date 18/07/2018 File Proposed_SWS_P03.mdx	Designed by NJ Checked by GT	
Micro Drainage	Network 2018.1.1	

Storage Structures for Storm

Cellular Storage Manhole: Soakaway 1, DS/PN: S1.006

Invert Level (m) 76.539 Safety Factor 2.0
 Infiltration Coefficient Base (m/hr) 0.35208 Porosity 0.95
 Infiltration Coefficient Side (m/hr) 0.35208

Depth (m)	Area (m ²)	Inf. Area (m ²)	Depth (m)	Area (m ²)	Inf. Area (m ²)
0.000	72.0	72.0	0.801	0.0	100.8
0.800	72.0	100.8			

Cellular Storage Manhole: Soakaway 2, DS/PN: S6.004

Invert Level (m) 75.800 Safety Factor 2.0
 Infiltration Coefficient Base (m/hr) 0.35208 Porosity 0.95
 Infiltration Coefficient Side (m/hr) 0.35208

Depth (m)	Area (m ²)	Inf. Area (m ²)	Depth (m)	Area (m ²)	Inf. Area (m ²)
0.000	175.0	175.0	0.801	0.0	226.2
0.800	175.0	226.2			

AKSward Ltd		Page 4
Seacourt Tower West Way Oxford OX2 0JJ	New Technical Site SWS to Soakaway	
Date 18/07/2018 File Proposed_SWS_P03.mdx	Designed by NJ Checked by GT	
Micro Drainage	Network 2018.1.1	

1 year Return Period Summary of Critical Results by Maximum Level (Rank 1)
for Storm

Simulation Criteria

Areal Reduction Factor 1.000 Additional Flow - % of Total Flow 0.000
Hot Start (mins) 0 MADD Factor * 10m³/ha Storage 2.000
Hot Start Level (mm) 0 Inlet Coeffiecient 0.800
Manhole Headloss Coeff (Global) 0.500 Flow per Person per Day (l/per/day) 0.000
Foul Sewage per hectare (l/s) 0.000

Number of Input Hydrographs 0 Number of Storage Structures 2
Number of Online Controls 2 Number of Time/Area Diagrams 0
Number of Offline Controls 0 Number of Real Time Controls 0

Synthetic Rainfall Details

Rainfall Model FSR Ratio R 0.404
Region England and Wales Cv (Summer) 0.750
M5-60 (mm) 20.000 Cv (Winter) 0.840

Margin for Flood Risk Warning (mm) 300.0
Analysis Timestep 2.5 Second Increment (Extended)
DTS Status ON
DVD Status ON
Inertia Status ON

Profile(s)
Duration(s) (mins) 15, 30, 60, 120, 180, 240, 360, 480, 600, Summer and Winter
720, 960, 1440, 2160, 2880, 4320, 5760,
7200, 8640, 10080
Return Period(s) (years) 1, 30, 100
Climate Change (%) 0, 0, 40

PN	US/MH Name	Storm	Return Period	Climate Change	First (X) Surcharge	First (Y) Flood	First (Z) Overflow
S1.000	S01	15 Winter	1	+0%	100/15 Summer		
S1.001	S02	15 Winter	1	+0%	30/15 Summer		
S2.000	S03	15 Winter	1	+0%	100/15 Summer		
S1.002	S04	15 Winter	1	+0%	100/15 Summer		
S3.000	S05	15 Winter	1	+0%	100/15 Summer	100/120 Winter	
S1.003	S06	15 Winter	1	+0%	30/15 Summer		
S1.004	S07	15 Winter	1	+0%	30/15 Summer		
S4.000	S08	15 Winter	1	+0%	100/15 Summer		
S1.005	S09	15 Winter	1	+0%	30/15 Summer		
S5.000	S10	15 Winter	1	+0%	100/120 Winter		
S1.006	Soakaway	1 60 Winter	1	+0%	100/30 Winter		
S6.000	S11	15 Winter	1	+0%	100/15 Summer		
S6.001	S12	15 Winter	1	+0%	100/15 Summer		
S7.000	S13	15 Winter	1	+0%	100/15 Summer		
S7.001	S14	15 Winter	1	+0%	100/15 Summer		
S8.000	S15	15 Winter	1	+0%	100/15 Summer		
S9.000	S16	15 Winter	1	+0%	100/15 Summer		

AKSWard Ltd		Page 5
Seacourt Tower West Way Oxford OX2 0JJ	New Technical Site SWS to Soakaway	
Date 18/07/2018 File Proposed_SWS_P03.mdx	Designed by NJ Checked by GT	
Micro Drainage	Network 2018.1.1	

1 year Return Period Summary of Critical Results by Maximum Level (Rank 1)
for Storm

PN	US/MH Name	Overflow Act.	Water	Surcharged	Flooded	Pipe			
			Level (m)	Depth (m)	Volume (m³)	Flow / Cap.	Overflow (l/s)	Flow (l/s)	Status
S1.000	S01		78.225	-0.075	0.000	0.14		0.9	OK
S1.001	S02		78.151	-0.083	0.000	0.41		5.5	OK
S2.000	S03		78.221	-0.079	0.000	0.10		0.7	OK
S1.002	S04		77.972	-0.160	0.000	0.18		7.3	OK
S3.000	S05		77.735	-0.190	0.000	0.06		2.9	OK
S1.003	S06		77.560	-0.133	0.000	0.35		13.6	OK
S1.004	S07		77.400	-0.124	0.000	0.41		15.5	OK
S4.000	S08		78.235	-0.065	0.000	0.27		1.7	OK
S1.005	S09		77.320	-0.095	0.000	0.63		19.9	OK
S5.000	S10		78.225	-0.075	0.000	0.14		0.8	OK
S1.006	Soakaway 1		76.683	-0.681	0.000	0.00		0.0	OK
S6.000	S11		77.739	-0.111	0.000	0.15		2.0	OK
S6.001	S12		77.670	-0.090	0.000	0.33		4.5	OK
S7.000	S13		77.739	-0.111	0.000	0.15		3.4	OK
S7.001	S14		77.504	-0.100	0.000	0.24		3.4	OK
S8.000	S15		77.762	-0.088	0.000	0.35		4.7	OK
S9.000	S16		77.717	-0.083	0.000	0.07		0.4	OK

PN	US/MH Name	Level
		Exceeded
S1.000	S01	
S1.001	S02	
S2.000	S03	
S1.002	S04	
S3.000	S05	1
S1.003	S06	
S1.004	S07	
S4.000	S08	
S1.005	S09	
S5.000	S10	
S1.006	Soakaway 1	
S6.000	S11	
S6.001	S12	
S7.000	S13	
S7.001	S14	
S8.000	S15	
S9.000	S16	

AKSWard Ltd		Page 6
Seacourt Tower West Way Oxford OX2 0JJ	New Technical Site SWS to Soakaway	
Date 18/07/2018 File Proposed_SWS_P03.mdx	Designed by NJ Checked by GT	
Micro Drainage	Network 2018.1.1	

1 year Return Period Summary of Critical Results by Maximum Level (Rank 1)
for Storm

PN	US/MH Name	Return Storm	Climate Period	First (X) Change	First (Y) Surcharge	First (Z) Flood	Overflow Overflow	Overflow Act.
S9.001	S17 15 Winter	1	+0%	100/15	Summer			
S10.000	S18 15 Winter	1	+0%	100/15	Summer			
S9.002	S19 15 Winter	1	+0%	100/15	Summer			
S9.003	S20 15 Winter	1	+0%	100/15	Summer			
S7.002	S21 15 Winter	1	+0%	30/15	Summer			
S6.002	S22 15 Winter	1	+0%	100/15	Summer			
S11.000	S23 15 Winter	1	+0%	100/15	Summer			
S6.003	S24 15 Winter	1	+0%	30/15	Summer			
S12.000	S25 15 Winter	1	+0%	100/15	Summer			
S12.001	S26 15 Winter	1	+0%	100/15	Summer			
S12.002	S27 15 Winter	1	+0%	100/15	Summer			
S12.003	S28 15 Winter	1	+0%	30/15	Summer			
S12.004	S29 15 Winter	1	+0%	30/15	Summer			
S12.005	S30 15 Winter	1	+0%	30/15	Summer			
S6.004	Soakaway 2 30 Winter	1	+0%	100/60	Winter			

PN	US/MH Name	Water Level (m)	Surcharged Depth (m)	Flooded Volume (m³)	Flow / Overflow Cap. (l/s)	Pipe Flow (l/s)	Level Status	Level Exceeded
S9.001	S17 77.520	-0.110	0.000	0.16		2.2	OK	
S10.000	S18 77.745	-0.105	0.000	0.19		2.5	OK	
S9.002	S19 77.363	-0.139	0.000	0.31		11.5	OK	
S9.003	S20 77.175	-0.215	0.000	0.17		14.8	OK	
S7.002	S21 76.899	-0.170	0.000	0.38		23.6	OK	
S6.002	S22 76.839	-0.176	0.000	0.35		29.7	OK	
S11.000	S23 77.754	-0.096	0.000	0.28		3.9	OK	
S6.003	S24 76.628	-0.136	0.000	0.58		35.7	OK	
S12.000	S25 78.029	-0.071	0.000	0.18		1.2	OK	
S12.001	S26 77.825	-0.110	0.000	0.16		2.1	OK	
S12.002	S27 77.676	-0.111	0.000	0.15		2.1	OK	
S12.003	S28 77.550	-0.089	0.000	0.34		4.6	OK	
S12.004	S29 77.464	-0.062	0.000	0.64		7.1	OK	
S12.005	S30 77.426	-0.069	0.000	0.57		7.1	OK	
S6.004	Soakaway 2 75.916	-0.792	0.000	0.00		0.0	OK	

AKSward Ltd		Page 7
Seacourt Tower West Way Oxford OX2 0JJ	New Technical Site SWS to Soakaway	
Date 18/07/2018 File Proposed_SWS_P03.mdx	Designed by NJ Checked by GT	
Micro Drainage	Network 2018.1.1	

30 year Return Period Summary of Critical Results by Maximum Level (Rank 1)
for Storm

Simulation Criteria

Areal Reduction Factor 1.000 Additional Flow - % of Total Flow 0.000
Hot Start (mins) 0 MADD Factor * 10m³/ha Storage 2.000
Hot Start Level (mm) 0 Inlet Coeffiecient 0.800
Manhole Headloss Coeff (Global) 0.500 Flow per Person per Day (l/per/day) 0.000
Foul Sewage per hectare (l/s) 0.000

Number of Input Hydrographs 0 Number of Storage Structures 2
Number of Online Controls 2 Number of Time/Area Diagrams 0
Number of Offline Controls 0 Number of Real Time Controls 0

Synthetic Rainfall Details

Rainfall Model FSR Ratio R 0.404
Region England and Wales Cv (Summer) 0.750
M5-60 (mm) 20.000 Cv (Winter) 0.840

Margin for Flood Risk Warning (mm) 300.0
Analysis Timestep 2.5 Second Increment (Extended)
DTS Status ON
DVD Status ON
Inertia Status ON

Profile(s) Summer and Winter
Duration(s) (mins) 15, 30, 60, 120, 180, 240, 360, 480, 600,
720, 960, 1440, 2160, 2880, 4320, 5760,
7200, 8640, 10080
Return Period(s) (years) 1, 30, 100
Climate Change (%) 0, 0, 40

PN	US/MH Name	Storm	Return Period	Climate Change	First (X) Surcharge	First (Y) Flood	First (Z) Overflow
S1.000	S01 15 Winter	30	+0%	100/15 Summer			
S1.001	S02 15 Winter	30	+0%	30/15 Summer			
S2.000	S03 15 Winter	30	+0%	100/15 Summer			
S1.002	S04 15 Winter	30	+0%	100/15 Summer			
S3.000	S05 15 Winter	30	+0%	100/15 Summer	100/120 Winter		
S1.003	S06 15 Winter	30	+0%	30/15 Summer			
S1.004	S07 15 Winter	30	+0%	30/15 Summer			
S4.000	S08 15 Winter	30	+0%	100/15 Summer			
S1.005	S09 15 Winter	30	+0%	30/15 Summer			
S5.000	S10 15 Winter	30	+0%	100/120 Winter			
S1.006	Soakaway 1 60 Winter	30	+0%	100/30 Winter			
S6.000	S11 15 Winter	30	+0%	100/15 Summer			
S6.001	S12 15 Winter	30	+0%	100/15 Summer			
S7.000	S13 15 Winter	30	+0%	100/15 Summer			
S7.001	S14 15 Winter	30	+0%	100/15 Summer			
S8.000	S15 15 Winter	30	+0%	100/15 Summer			
S9.000	S16 15 Winter	30	+0%	100/15 Summer			

AKSward Ltd		Page 8
Seacourt Tower West Way Oxford OX2 0JJ	New Technical Site SWS to Soakaway	
Date 18/07/2018 File Proposed_SWS_P03.mdx	Designed by NJ Checked by GT	
Micro Drainage Network 2018.1.1		

30 year Return Period Summary of Critical Results by Maximum Level (Rank 1)
for Storm

PN	US/MH Name	Overflow Act.	Water	Surcharged	Flooded	Pipe		
			Level (m)	Depth (m)	Volume (m³)	Flow / Cap.	Overflow (l/s)	Flow (l/s)
S1.000	S01	78.290	-0.010	0.000	0.35		2.2	OK
S1.001	S02	78.273	0.039	0.000	1.17		15.7	SURCHARGED
S2.000	S03	78.233	-0.067	0.000	0.24		1.7	OK
S1.002	S04	78.023	-0.109	0.000	0.51		20.4	OK
S3.000	S05	77.762	-0.163	0.000	0.14		7.3	OK
S1.003	S06	77.735	0.042	0.000	0.89		34.8	SURCHARGED
S1.004	S07	77.599	0.075	0.000	1.05		39.3	SURCHARGED
S4.000	S08	78.260	-0.040	0.000	0.65		4.3	OK
S1.005	S09	77.480	0.066	0.000	1.56		49.3	SURCHARGED
S5.000	S10	78.240	-0.060	0.000	0.34		2.1	OK
S1.006	Soakaway 1	77.005	-0.360	0.000	0.00		0.0	OK
S6.000	S11	77.764	-0.086	0.000	0.38		5.0	OK
S6.001	S12	77.725	-0.035	0.000	0.92		12.4	OK
S7.000	S13	77.763	-0.087	0.000	0.37		8.3	OK
S7.001	S14	77.538	-0.066	0.000	0.59		8.3	OK
S8.000	S15	77.809	-0.041	0.000	0.86		11.5	OK
S9.000	S16	77.728	-0.072	0.000	0.17		1.1	OK

PN	US/MH Name	Level
		Exceeded
S1.000	S01	
S1.001	S02	
S2.000	S03	
S1.002	S04	
S3.000	S05	1
S1.003	S06	
S1.004	S07	
S4.000	S08	
S1.005	S09	
S5.000	S10	
S1.006	Soakaway 1	
S6.000	S11	
S6.001	S12	
S7.000	S13	
S7.001	S14	
S8.000	S15	
S9.000	S16	

AKSWard Ltd		Page 9
Seacourt Tower West Way Oxford OX2 0JJ	New Technical Site SWS to Soakaway	
Date 18/07/2018 File Proposed_SWS_P03.mdx	Designed by NJ Checked by GT	
Micro Drainage	Network 2018.1.1	

30 year Return Period Summary of Critical Results by Maximum Level (Rank 1)
for Storm

PN	US/MH Name	Return Storm	Climate Period	First (X) Change	First (Y) Surcharge	First (Z) Flood	Overflow Overflow	Overflow Act.
S9.001	S17 15 Winter	30	+0%	100/15	Summer			
S10.000	S18 15 Winter	30	+0%	100/15	Summer			
S9.002	S19 15 Winter	30	+0%	100/15	Summer			
S9.003	S20 15 Winter	30	+0%	100/15	Summer			
S7.002	S21 15 Winter	30	+0%	30/15	Summer			
S6.002	S22 15 Winter	30	+0%	100/15	Summer			
S11.000	S23 15 Winter	30	+0%	100/15	Summer			
S6.003	S24 15 Winter	30	+0%	30/15	Summer			
S12.000	S25 15 Winter	30	+0%	100/15	Summer			
S12.001	S26 15 Winter	30	+0%	100/15	Summer			
S12.002	S27 15 Winter	30	+0%	100/15	Summer			
S12.003	S28 15 Winter	30	+0%	30/15	Summer			
S12.004	S29 15 Winter	30	+0%	30/15	Summer			
S12.005	S30 15 Winter	30	+0%	30/15	Summer			
S6.004	Soakaway 2	60 Winter	30	+0%	100/60	Winter		

PN	US/MH Name	Water Level (m)	Surcharged Depth (m)	Flooded Volume (m³)	Flow / Cap. (l/s)	Overflow (l/s)	Pipe Flow (l/s)	Level Status	Level Exceeded
S9.001	S17 77.552	-0.078	0.000	0.47		6.3		OK	
S10.000	S18 77.774	-0.076	0.000	0.48		6.3		OK	
S9.002	S19 77.444	-0.058	0.000	0.89		33.5		OK	
S9.003	S20 77.244	-0.145	0.000	0.51		43.0		OK	
S7.002	S21 77.097	0.028	0.000	0.97		59.7		SURCHARGED	
S6.002	S22 77.013	-0.002	0.000	0.88		73.5		OK	
S11.000	S23 77.793	-0.057	0.000	0.69		9.5		OK	
S6.003	S24 76.819	0.055	0.000	1.44		88.3		SURCHARGED	
S12.000	S25 78.047	-0.053	0.000	0.44		2.8		OK	
S12.001	S26 77.854	-0.081	0.000	0.42		5.8		OK	
S12.002	S27 77.741	-0.046	0.000	0.40		5.5		OK	
S12.003	S28 77.715	0.077	0.000	0.87		11.6		SURCHARGED	
S12.004	S29 77.630	0.104	0.000	1.62		17.9		SURCHARGED	
S12.005	S30 77.544	0.050	0.000	1.43		17.9		SURCHARGED	
S6.004	Soakaway 2	76.186	-0.522	0.000	0.00	0.0		OK	

AKSward Ltd		Page 1
Seacourt Tower West Way Oxford OX2 0JJ	New Technical Site SWS to Soakaway	
Date 18/07/2018	Designed by NJ	
File Proposed_SWS_P03_noCC.mdx	Checked by GT	
Micro Drainage	Network 2018.1.1	

100 year Return Period Summary of Critical Results by Maximum Level (Rank 1) for Storm

Simulation Criteria

Areal Reduction Factor	1.000	Additional Flow - % of Total Flow	0.000
Hot Start (mins)	0	MADD Factor * 10^3 /ha Storage	2.000
Hot Start Level (mm)	0	Inlet Coefficient	0.800
Manhole Headloss Coeff (Global)	0.500	Flow per Person per Day (l/per/day)	0.000
Foul Sewage per hectare (l/s)	0.000		

Number of Input Hydrographs 0 Number of Storage Structures 2
Number of Online Controls 2 Number of Time/Area Diagrams 0
Number of Offline Controls 0 Number of Real Time Controls 0

Synthetic Rainfall Details

Rainfall Model	FSR	Ratio R	0.404
Region	England and Wales	Cv (Summer)	0.750
M5-60 (mm)	20.000	Cv (Winter)	0.840

Profile(s)	Summer and Winter
Duration(s) (mins)	15, 30, 60, 120, 180, 240, 360, 480, 600, 720, 960, 1440, 2160, 2880, 4320, 5760, 7200, 8640, 10080

Return Period(s) (years) 100
Climate Change (%) 0

PN	US/MH Name	Storm	Period	Climate Change	First (X) Surcharge	First (Y) Flood	First (Z) Overflow	Overflow Act.
S1.000	S01	15 Winter	100	+0%	100/15	Summer		
S1.001	S02	15 Winter	100	+0%	100/15	Summer		
S2.000	S03	15 Winter	100	+0%				
S1.002	S04	15 Winter	100	+0%				
S3.000	S05	15 Winter	100	+0%				
S1.003	S06	15 Winter	100	+0%	100/15	Summer		
S1.004	S07	15 Winter	100	+0%	100/15	Summer		
S4.000	S08	15 Winter	100	+0%				
S1.005	S09	15 Winter	100	+0%	100/15	Summer		
S5.000	S10	15 Winter	100	+0%				
S1.006	Soakaway 1	60 Winter	100	+0%				
S6.000	S11	15 Winter	100	+0%				
S6.001	S12	15 Winter	100	+0%	100/15	Summer		
S7.000	S13	15 Winter	100	+0%				
S7.001	S14	15 Winter	100	+0%				
S8.000	S15	15 Winter	100	+0%	100/15	Summer		
S9.000	S16	15 Winter	100	+0%				

AKSward Ltd		Page 2
Seacourt Tower West Way Oxford OX2 0JJ	New Technical Site SWS to Soakaway	
Date 18/07/2018 File Proposed_SWS_P03_noCC.mdx	Designed by NJ Checked by GT	
Micro Drainage	Network 2018.1.1	

100 year Return Period Summary of Critical Results by Maximum Level (Rank 1) for Storm

PN	US/MH Name	Water	Surcharged	Flooded	Pipe			Level Exceeded
		Level (m)	Depth (m)	Volume (m³)	Flow / Cap.	Overflow (l/s)	Flow (l/s)	
S1.000	S01 78.395	0.095	0.000	0.46		2.9	SURCHARGED	
S1.001	S02 78.372	0.138	0.000	1.52		20.3	FLOOD RISK	
S2.000	S03 78.239	-0.061	0.000	0.32		2.2	OK	
S1.002	S04 78.043	-0.089	0.000	0.65		26.3	OK	
S3.000	S05 77.908	-0.017	0.000	0.16		8.4	OK	
S1.003	S06 77.893	0.200	0.000	1.07		41.9	SURCHARGED	
S1.004	S07 77.704	0.180	0.000	1.25		46.9	SURCHARGED	
S4.000	S08 78.272	-0.028	0.000	0.85		5.5	OK	
S1.005	S09 77.537	0.123	0.000	1.88		59.2	SURCHARGED	
S5.000	S10 78.247	-0.053	0.000	0.44		2.7	OK	
S1.006	Soakaway 1	77.190	-0.174	0.000	0.00	0.0	OK	
S6.000	S11 77.826	-0.024	0.000	0.48		6.4	OK	
S6.001	S12 77.800	0.040	0.000	1.15		15.7	SURCHARGED	
S7.000	S13 77.773	-0.077	0.000	0.48		10.7	OK	
S7.001	S14 77.554	-0.050	0.000	0.76		10.7	OK	
S8.000	S15 77.872	0.022	0.000	1.10		14.9	SURCHARGED	
S9.000	S16 77.732	-0.068	0.000	0.22		1.4	OK	

AKSward Ltd		Page 3
Seacourt Tower West Way Oxford OX2 0JJ	New Technical Site SWS to Soakaway	
Date 18/07/2018 File Proposed_SWS_P03_noCC.mdx	Designed by NJ Checked by GT	
Micro Drainage	Network 2018.1.1	

100 year Return Period Summary of Critical Results by Maximum Level (Rank 1) for Storm

PN	US/MH Name	Return Storm	Climate Period	First (X) Change	First (Y) Surcharge	First (Z) Flood	Overflow Overflow	Overflow Act.
S9.001	S17 15 Winter	100	+0%					
S10.000	S18 15 Winter	100	+0%					
S9.002	S19 15 Winter	100	+0%	100/15	Summer			
S9.003	S20 15 Winter	100	+0%					
S7.002	S21 15 Winter	100	+0%	100/15	Summer			
S6.002	S22 15 Winter	100	+0%	100/15	Summer			
S11.000	S23 15 Winter	100	+0%					
S6.003	S24 15 Winter	100	+0%	100/15	Summer			
S12.000	S25 15 Winter	100	+0%					
S12.001	S26 15 Winter	100	+0%					
S12.002	S27 15 Winter	100	+0%	100/15	Summer			
S12.003	S28 15 Winter	100	+0%	100/15	Summer			
S12.004	S29 15 Winter	100	+0%	100/15	Summer			
S12.005	S30 15 Winter	100	+0%	100/15	Summer			
S6.004	Soakaway 2 60 Winter	100	+0%					

PN	US/MH Name	Water Level (m)	Surcharged Depth (m)	Flooded Volume (m³)	Flow / Cap. (l/s)	Overflow (l/s)	Pipe Flow (l/s)	Pipe Status	Level Exceeded
S9.001	S17 77.578	-0.051	0.000	0.60			8.1	OK	
S10.000	S18 77.786	-0.064	0.000	0.62			8.1	OK	
S9.002	S19 77.531	0.028	0.000	1.12			42.2	SURCHARGED	
S9.003	S20 77.386	-0.004	0.000	0.61			51.8	OK	
S7.002	S21 77.276	0.207	0.000	1.19			73.0	SURCHARGED	
S6.002	S22 77.188	0.173	0.000	1.08			90.8	SURCHARGED	
S11.000	S23 77.812	-0.038	0.000	0.89			12.4	OK	
S6.003	S24 76.885	0.121	0.000	1.77			108.8	SURCHARGED	
S12.000	S25 78.055	-0.045	0.000	0.58			3.7	OK	
S12.001	S26 77.904	-0.031	0.000	0.55			7.5	OK	
S12.002	S27 77.872	0.085	0.000	0.55			7.5	SURCHARGED	
S12.003	S28 77.844	0.205	0.000	1.03			13.8	SURCHARGED	
S12.004	S29 77.721	0.195	0.000	1.96			21.7	SURCHARGED	
S12.005	S30 77.594	0.100	0.000	1.73			21.7	SURCHARGED	
S6.004	Soakaway 2 76.346	-0.362	0.000	0.00			0.0	OK	

AKSward Ltd		Page 10
Seacourt Tower West Way Oxford OX2 0JJ	New Technical Site SWS to Soakaway	
Date 18/07/2018 File Proposed_SWS_P03.mdx	Designed by NJ Checked by GT	
Micro Drainage	Network 2018.1.1	

100 year Return Period Summary of Critical Results by Maximum Level (Rank 1) for Storm

Simulation Criteria

Areal Reduction Factor 1.000 Additional Flow - % of Total Flow 0.000
 Hot Start (mins) 0 MADD Factor * 10m³/ha Storage 2.000
 Hot Start Level (mm) 0 Inlet Coeffiecient 0.800
 Manhole Headloss Coeff (Global) 0.500 Flow per Person per Day (l/per/day) 0.000
 Foul Sewage per hectare (l/s) 0.000

Number of Input Hydrographs 0 Number of Storage Structures 2
 Number of Online Controls 2 Number of Time/Area Diagrams 0
 Number of Offline Controls 0 Number of Real Time Controls 0

Synthetic Rainfall Details

Rainfall Model FSR Ratio R 0.404
 Region England and Wales Cv (Summer) 0.750
 M5-60 (mm) 20.000 Cv (Winter) 0.840

Margin for Flood Risk Warning (mm) 300.0
 Analysis Timestep 2.5 Second Increment (Extended)
 DTS Status ON
 DVD Status ON
 Inertia Status ON

Profile(s)
 Duration(s) (mins) 15, 30, 60, 120, 180, 240, 360, 480, 600, Summer and Winter
 720, 960, 1440, 2160, 2880, 4320, 5760,
 7200, 8640, 10080

Return Period(s) (years) 1, 30, 100
 Climate Change (%) 0, 0, 40

PN	US/MH		Storm	Return Period	Climate Change	First (X)	First (Y)	First (Z)
	Name	Surcharge				Flood	Overflow	
S1.000	S01	15 Winter	100	+40%	100/15 Summer			
S1.001	S02	15 Winter	100	+40%	30/15 Summer			
S2.000	S03	120 Winter	100	+40%	100/15 Summer			
S1.002	S04	120 Winter	100	+40%	100/15 Summer			
S3.000	S05	120 Winter	100	+40%	100/15 Summer	100/120 Winter		
S1.003	S06	120 Winter	100	+40%	30/15 Summer			
S1.004	S07	120 Winter	100	+40%	30/15 Summer			
S4.000	S08	120 Winter	100	+40%	100/15 Summer			
S1.005	S09	120 Winter	100	+40%	30/15 Summer			
S5.000	S10	120 Winter	100	+40%	100/120 Winter			
S1.006	Soakaway 1	120 Winter	100	+40%	100/30 Winter			
S6.000	S11	15 Winter	100	+40%	100/15 Summer			
S6.001	S12	15 Winter	100	+40%	100/15 Summer			
S7.000	S13	15 Winter	100	+40%	100/15 Summer			
S7.001	S14	15 Winter	100	+40%	100/15 Summer			
S8.000	S15	15 Winter	100	+40%	100/15 Summer			
S9.000	S16	15 Winter	100	+40%	100/15 Summer			

AKSWard Ltd Seacourt Tower West Way Oxford OX2 0JJ		Page 11 New Technical Site SWS to Soakaway	
Date 18/07/2018 File Proposed_SWS_P03.mdx		Designed by NJ Checked by GT	
Micro Drainage		Network 2018.1.1	

100 year Return Period Summary of Critical Results by Maximum Level (Rank 1) for Storm

PN	US/MH Name	Overflow Act.	Water	Surcharged	Flooded	Pipe		
			Level (m)	Depth (m)	Volume (m³)	Flow / Cap. (l/s)	Overflow (l/s)	Flow (l/s)
S1.000	S01		78.640	0.340	0.000	0.60		3.8 SURCHARGED
S1.001	S02		78.595	0.361	0.000	1.97		26.4 FLOOD RISK
S2.000	S03		78.509	0.209	0.000	0.14		1.0 SURCHARGED
S1.002	S04		78.508	0.375	0.000	0.30		12.0 SURCHARGED
S3.000	S05		78.501	0.576	0.574	0.08		4.2 FLOOD
S1.003	S06		78.502	0.809	0.000	0.57		22.4 FLOOD RISK
S1.004	S07		78.496	0.972	0.000	0.68		25.6 SURCHARGED
S4.000	S08		78.495	0.195	0.000	0.39		2.5 SURCHARGED
S1.005	S09		78.489	1.075	0.000	1.04		32.7 SURCHARGED
S5.000	S10		78.486	0.186	0.000	0.20		1.2 SURCHARGED
S1.006	Soakaway 1		78.484	1.120	0.000	0.00		0.0 SURCHARGED
S6.000	S11		78.024	0.174	0.000	0.69		9.2 SURCHARGED
S6.001	S12		77.982	0.222	0.000	1.62		22.0 SURCHARGED
S7.000	S13		77.929	0.079	0.000	0.67		15.0 SURCHARGED
S7.001	S14		77.861	0.257	0.000	0.91		12.8 SURCHARGED
S8.000	S15		78.006	0.156	0.000	1.53		20.7 SURCHARGED
S9.000	S16		78.102	0.302	0.000	0.30		1.9 SURCHARGED

PN	US/MH Name	Level
		Exceeded
S1.000	S01	
S1.001	S02	
S2.000	S03	
S1.002	S04	
S3.000	S05	1
S1.003	S06	
S1.004	S07	
S4.000	S08	
S1.005	S09	
S5.000	S10	
S1.006	Soakaway 1	
S6.000	S11	
S6.001	S12	
S7.000	S13	
S7.001	S14	
S8.000	S15	
S9.000	S16	

AKSward Ltd		Page 12
Seacourt Tower West Way Oxford OX2 0JJ	New Technical Site SWS to Soakaway	
Date 18/07/2018 File Proposed_SWS_P03.mdx	Designed by NJ Checked by GT	
Micro Drainage	Network 2018.1.1	

100 year Return Period Summary of Critical Results by Maximum Level (Rank 1) for Storm

PN	US/MH Name	Storm	Return Period	Climate Change	First (X) Surcharge	First (Y) Flood	First (Z) Overflow	Overflow Act.
S9.001	S17	15 Winter	100	+40%	100/15	Summer		
S10.000	S18	15 Winter	100	+40%	100/15	Summer		
S9.002	S19	15 Winter	100	+40%	100/15	Summer		
S9.003	S20	15 Winter	100	+40%	100/15	Summer		
S7.002	S21	15 Winter	100	+40%	30/15	Summer		
S6.002	S22	15 Winter	100	+40%	100/15	Summer		
S11.000	S23	15 Winter	100	+40%	100/15	Summer		
S6.003	S24	120 Winter	100	+40%	30/15	Summer		
S12.000	S25	15 Winter	100	+40%	100/15	Summer		
S12.001	S26	15 Winter	100	+40%	100/15	Summer		
S12.002	S27	15 Winter	100	+40%	100/15	Summer		
S12.003	S28	15 Winter	100	+40%	30/15	Summer		
S12.004	S29	15 Winter	100	+40%	30/15	Summer		
S12.005	S30	15 Winter	100	+40%	30/15	Summer		
S6.004	Soakaway 2	120 Winter	100	+40%	100/60	Winter		

PN	US/MH Name	Water Level (m)	Surcharged Depth (m)	Flooded Volume (m³)	Flow / Cap. (l/s)	Overflow (l/s)	Pipe Flow (l/s)	Status	Level Exceeded
S9.001	S17	78.088	0.458	0.000	0.68		9.3	SURCHARGED	
S10.000	S18	78.081	0.231	0.000	0.80		10.4	SURCHARGED	
S9.002	S19	78.037	0.534	0.000	1.36		51.5	SURCHARGED	
S9.003	S20	77.859	0.469	0.000	0.70		59.4	SURCHARGED	
S7.002	S21	77.695	0.625	0.000	1.52		93.0	SURCHARGED	
S6.002	S22	77.561	0.546	0.000	1.42		119.0	SURCHARGED	
S11.000	S23	77.950	0.100	0.000	1.25		17.2	SURCHARGED	
S6.003	S24	77.067	0.303	0.000	0.96		58.7	SURCHARGED	
S12.000	S25	78.331	0.231	0.000	0.73		4.7	SURCHARGED	
S12.001	S26	78.250	0.315	0.000	0.62		8.5	SURCHARGED	
S12.002	S27	78.189	0.402	0.000	0.67		9.2	SURCHARGED	
S12.003	S28	78.146	0.507	0.000	1.35		18.2	SURCHARGED	
S12.004	S29	77.940	0.414	0.000	2.59		28.7	SURCHARGED	
S12.005	S30	77.716	0.221	0.000	2.30		28.9	SURCHARGED	
S6.004	Soakaway 2	77.062	0.354	0.000	0.00		0.0	SURCHARGED	

AKSWard Ltd		Page 1
Seacourt Tower West Way Oxford OX2 0JJ	New Technical Site Permeable Paving	
Date 04/10/2018 File Permeable paving.srccx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Summary of Results for 1 year Return Period

Half Drain Time : 4 minutes.

Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status
15 min Summer	0.037	0.037		10.8	O K
30 min Summer	0.054	0.054		21.6	O K
60 min Summer	0.062	0.062		24.8	O K
120 min Summer	0.060	0.060		24.0	O K
180 min Summer	0.054	0.054		21.6	O K
240 min Summer	0.049	0.049		19.1	O K
360 min Summer	0.043	0.043		14.7	O K
480 min Summer	0.039	0.039		12.1	O K
600 min Summer	0.036	0.036		10.3	O K
720 min Summer	0.033	0.033		8.9	O K
960 min Summer	0.030	0.030		7.3	O K
1440 min Summer	0.026	0.026		5.3	O K
2160 min Summer	0.022	0.022		4.0	O K
2880 min Summer	0.020	0.020		3.1	O K
4320 min Summer	0.017	0.017		2.4	O K
5760 min Summer	0.015	0.015		1.9	O K
7200 min Summer	0.014	0.014		1.6	O K
8640 min Summer	0.013	0.013		1.4	O K
10080 min Summer	0.012	0.012		1.2	O K
15 min Winter	0.050	0.050		19.9	O K

Storm Rain Flooded Time-Peak

Event	(mm/hr)	Volume (m³)	(mins)
-------	---------	-------------	--------

15 min Summer	31.093	0.0	16
30 min Summer	20.252	0.0	22
60 min Summer	12.800	0.0	38
120 min Summer	7.926	0.0	66
180 min Summer	5.960	0.0	96
240 min Summer	4.862	0.0	124
360 min Summer	3.628	0.0	184
480 min Summer	2.939	0.0	246
600 min Summer	2.495	0.0	302
720 min Summer	2.183	0.0	366
960 min Summer	1.768	0.0	486
1440 min Summer	1.314	0.0	714
2160 min Summer	0.977	0.0	1100
2880 min Summer	0.791	0.0	1460
4320 min Summer	0.588	0.0	2144
5760 min Summer	0.476	0.0	2832
7200 min Summer	0.405	0.0	3656
8640 min Summer	0.354	0.0	4336
10080 min Summer	0.317	0.0	5080
15 min Winter	31.093	0.0	14

AKSWard Ltd		Page 2
Seacourt Tower West Way Oxford OX2 0JJ	New Technical Site Permeable Paving	
Date 04/10/2018 File Permeable paving.srccx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Summary of Results for 1 year Return Period

Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status
30 min Winter	0.065	0.065		26.2	O K
60 min Winter	0.066	0.066		26.6	OK
120 min Winter	0.054	0.054		21.8	O K
180 min Winter	0.047	0.047		17.6	O K
240 min Winter	0.042	0.042		14.3	O K
360 min Winter	0.037	0.037		10.8	O K
480 min Winter	0.033	0.033		8.6	O K
600 min Winter	0.030	0.030		7.3	O K
720 min Winter	0.028	0.028		6.4	O K
960 min Winter	0.025	0.025		5.1	O K
1440 min Winter	0.022	0.022		3.8	O K
2160 min Winter	0.019	0.019		2.8	O K
2880 min Winter	0.017	0.017		2.3	O K
4320 min Winter	0.014	0.014		1.6	O K
5760 min Winter	0.013	0.013		1.3	O K
7200 min Winter	0.012	0.012		1.1	O K
8640 min Winter	0.011	0.011		0.9	O K
10080 min Winter	0.010	0.010		0.8	O K

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)
-------------	--------------	---------------------	------------------

30 min Winter	20.252	0.0	22
60 min Winter	12.800	0.0	38
120 min Winter	7.926	0.0	68
180 min Winter	5.960	0.0	94
240 min Winter	4.862	0.0	124
360 min Winter	3.628	0.0	182
480 min Winter	2.939	0.0	246
600 min Winter	2.495	0.0	306
720 min Winter	2.183	0.0	370
960 min Winter	1.768	0.0	490
1440 min Winter	1.314	0.0	726
2160 min Winter	0.977	0.0	1100
2880 min Winter	0.791	0.0	1428
4320 min Winter	0.588	0.0	2124
5760 min Winter	0.476	0.0	2816
7200 min Winter	0.405	0.0	3648
8640 min Winter	0.354	0.0	4328
10080 min Winter	0.317	0.0	4952

AKSWard Ltd		Page 3
Seacourt Tower West Way Oxford OX2 0JJ	New Technical Site Permeable Paving	
Date 04/10/2018 File Permeable paving.srcx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Rainfall Details

Rainfall Model	FSR	Winter Storms	Yes
Return Period (years)	1	Cv (Summer)	0.750
Region	England and Wales	Cv (Winter)	0.840
M5-60 (mm)	20.000	Shortest Storm (mins)	15
Ratio R	0.404	Longest Storm (mins)	10080
Summer Storms	Yes	Climate Change %	+0

Time Area Diagram

Total Area (ha) 0.510

Time (mins) Area
From: To: (ha)

0 4 0.510

AKSWard Ltd		Page 4
Seacourt Tower West Way Oxford OX2 0JJ	New Technical Site Permeable Paving	
Date 04/10/2018 File Permeable paving.srcox	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Model Details

Storage is Online Cover Level (m) 0.395

Porous Car Park Structure

Infiltration Coefficient Base (m/hr)	0.35208	Width (m)	391.0
Membrane Percolation (mm/hr)	1000	Length (m)	13.0
Max Percolation (l/s)	1411.9	Slope (1:X)	21.0
Safety Factor	2.0	Depression Storage (mm)	5
Porosity	0.30	Evaporation (mm/day)	3
Invert Level (m)	0.000	Cap Volume Depth (m)	0.300

AKSWard Ltd		Page 1
Seacourt Tower West Way Oxford OX2 0JJ	New Technical Site Permeable Paving	
Date 04/10/2018 File Permeable paving.srccx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Summary of Results for 30 year Return Period

Half Drain Time : 6 minutes.

Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status
15 min Summer	0.146	0.146		58.7	26.3 Flood Risk
30 min Summer	0.160	0.160		64.3	31.7 Flood Risk
60 min Summer	0.156	0.156		62.5	29.9 Flood Risk
120 min Summer	0.133	0.133		53.5	21.8 Flood Risk
180 min Summer	0.113	0.113		45.3	15.6 Flood Risk
240 min Summer	0.097	0.097		39.0	11.6 Flood Risk
360 min Summer	0.077	0.077		30.8	7.2 O K
480 min Summer	0.064	0.064		25.6	5.0 O K
600 min Summer	0.054	0.054		21.8	3.7 O K
720 min Summer	0.049	0.049		19.1	3.0 O K
960 min Summer	0.044	0.044		15.4	2.3 O K
1440 min Summer	0.037	0.037		11.1	1.7 O K
2160 min Summer	0.032	0.032		8.1	1.2 O K
2880 min Summer	0.028	0.028		6.4	1.0 O K
4320 min Summer	0.024	0.024		4.7	0.7 O K
5760 min Summer	0.021	0.021		3.6	0.6 O K
7200 min Summer	0.020	0.020		3.1	0.5 O K
8640 min Summer	0.018	0.018		2.7	0.4 O K
10080 min Summer	0.017	0.017		2.3	0.4 O K
15 min Winter	0.159	0.159		63.9	31.2 Flood Risk

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)
15 min Summer	76.290	0.0	13
30 min Summer	49.584	0.0	21
60 min Summer	30.811	0.0	38
120 min Summer	18.584	0.0	68
180 min Summer	13.680	0.0	98
240 min Summer	10.960	0.0	128
360 min Summer	8.001	0.0	186
480 min Summer	6.397	0.0	246
600 min Summer	5.375	0.0	306
720 min Summer	4.661	0.0	366
960 min Summer	3.719	0.0	480
1440 min Summer	2.704	0.0	734
2160 min Summer	1.963	0.0	1088
2880 min Summer	1.563	0.0	1428
4320 min Summer	1.133	0.0	2192
5760 min Summer	0.901	0.0	2864
7200 min Summer	0.754	0.0	3544
8640 min Summer	0.652	0.0	4256
10080 min Summer	0.576	0.0	5096
15 min Winter	76.290	0.0	14

AKSWard Ltd		Page 2
Seacourt Tower West Way Oxford OX2 0JJ	New Technical Site Permeable Paving	
Date 04/10/2018 File Permeable paving.srccx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Summary of Results for 30 year Return Period

Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status
30 min Winter	0.168	0.168		67.6	34.9 Flood Risk
60 min Winter	0.154	0.154		61.9	29.4 Flood Risk
120 min Winter	0.120	0.120		48.1	17.7 Flood Risk
180 min Winter	0.095	0.095		38.2	11.2 Flood Risk
240 min Winter	0.079	0.079		31.6	7.6 O K
360 min Winter	0.059	0.059		23.6	4.3 O K
480 min Winter	0.049	0.049		19.1	2.9 O K
600 min Winter	0.045	0.045		16.1	2.5 O K
720 min Winter	0.042	0.042		14.0	2.1 O K
960 min Winter	0.037	0.037		11.1	1.7 O K
1440 min Winter	0.032	0.032		8.1	1.2 O K
2160 min Winter	0.027	0.027		5.7	0.9 O K
2880 min Winter	0.024	0.024		4.5	0.7 O K
4320 min Winter	0.020	0.020		3.3	0.5 O K
5760 min Winter	0.018	0.018		2.5	0.4 O K
7200 min Winter	0.016	0.016		2.1	0.3 O K
8640 min Winter	0.015	0.015		1.9	0.3 O K
10080 min Winter	0.014	0.014		1.6	0.3 O K

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)
-------------	--------------	---------------------	------------------

30 min Winter	49.584	0.0	22
60 min Winter	30.811	0.0	38
120 min Winter	18.584	0.0	70
180 min Winter	13.680	0.0	98
240 min Winter	10.960	0.0	128
360 min Winter	8.001	0.0	188
480 min Winter	6.397	0.0	240
600 min Winter	5.375	0.0	302
720 min Winter	4.661	0.0	368
960 min Winter	3.719	0.0	490
1440 min Winter	2.704	0.0	732
2160 min Winter	1.963	0.0	1084
2880 min Winter	1.563	0.0	1476
4320 min Winter	1.133	0.0	2176
5760 min Winter	0.901	0.0	2936
7200 min Winter	0.754	0.0	3616
8640 min Winter	0.652	0.0	4160
10080 min Winter	0.576	0.0	5144

AKSWard Ltd		Page 3
Seacourt Tower West Way Oxford OX2 0JJ	New Technical Site Permeable Paving	
Date 04/10/2018 File Permeable paving.srcx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Rainfall Details

Rainfall Model	FSR	Winter Storms	Yes
Return Period (years)	30	Cv (Summer)	0.750
Region	England and Wales	Cv (Winter)	0.840
M5-60 (mm)	20.000	Shortest Storm (mins)	15
Ratio R	0.404	Longest Storm (mins)	10080
Summer Storms	Yes	Climate Change %	+0

Time Area Diagram

Total Area (ha) 0.510

Time (mins) Area
From: To: (ha)

0 4 0.510

AKSWard Ltd		Page 4
Seacourt Tower West Way Oxford OX2 0JJ	New Technical Site Permeable Paving	
Date 04/10/2018 File Permeable paving.srcox	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Model Details

Storage is Online Cover Level (m) 0.395

Porous Car Park Structure

Infiltration Coefficient Base (m/hr)	0.35208	Width (m)	391.0
Membrane Percolation (mm/hr)	1000	Length (m)	13.0
Max Percolation (l/s)	1411.9	Slope (1:X)	21.0
Safety Factor	2.0	Depression Storage (mm)	5
Porosity	0.30	Evaporation (mm/day)	3
Invert Level (m)	0.000	Cap Volume Depth (m)	0.300

AKSWard Ltd		Page 1
Seacourt Tower West Way Oxford OX2 0JJ	New Technical Site Permeable Paving	
Date 04/10/2018 File Permeable paving.srccx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Summary of Results for 100 year Return Period

Half Drain Time : 7 minutes.

Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status
15 min Summer	0.181	0.181		72.8	40.5 Flood Risk
30 min Summer	0.198	0.198		79.4	48.1 Flood Risk
60 min Summer	0.193	0.193		77.4	45.7 Flood Risk
120 min Summer	0.165	0.165		66.2	33.4 Flood Risk
180 min Summer	0.141	0.141		56.5	24.4 Flood Risk
240 min Summer	0.122	0.122		49.1	18.5 Flood Risk
360 min Summer	0.097	0.097		39.0	11.6 Flood Risk
480 min Summer	0.081	0.081		32.4	8.0 O K
600 min Summer	0.069	0.069		27.8	5.9 O K
720 min Summer	0.061	0.061		24.4	4.5 O K
960 min Summer	0.050	0.050		19.9	3.0 O K
1440 min Summer	0.042	0.042		14.3	2.2 O K
2160 min Summer	0.036	0.036		10.3	1.6 O K
2880 min Summer	0.032	0.032		8.1	1.2 O K
4320 min Summer	0.027	0.027		5.7	0.9 O K
5760 min Summer	0.024	0.024		4.5	0.7 O K
7200 min Summer	0.022	0.022		3.8	0.6 O K
8640 min Summer	0.020	0.020		3.3	0.5 O K
10080 min Summer	0.019	0.019		2.8	0.4 O K
15 min Winter	0.197	0.197		79.0	47.7 Flood Risk

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)
15 min Summer	99.025	0.0	13
30 min Summer	64.904	0.0	21
60 min Summer	40.510	0.0	38
120 min Summer	24.421	0.0	68
180 min Summer	17.920	0.0	98
240 min Summer	14.300	0.0	128
360 min Summer	10.377	0.0	188
480 min Summer	8.265	0.0	248
600 min Summer	6.922	0.0	308
720 min Summer	5.986	0.0	368
960 min Summer	4.756	0.0	484
1440 min Summer	3.434	0.0	732
2160 min Summer	2.475	0.0	1100
2880 min Summer	1.960	0.0	1452
4320 min Summer	1.409	0.0	2168
5760 min Summer	1.114	0.0	2912
7200 min Summer	0.927	0.0	3584
8640 min Summer	0.798	0.0	4336
10080 min Summer	0.703	0.0	5080
15 min Winter	99.025	0.0	14

AKSWard Ltd		Page 2
Seacourt Tower West Way Oxford OX2 0JJ	New Technical Site Permeable Paving	
Date 04/10/2018 File Permeable paving.srccx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Summary of Results for 100 year Return Period

Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status
30 min Winter	0.207	0.207		83.2	52.8 Flood Risk
60 min Winter	0.192	0.192		77.0	45.3 Flood Risk
120 min Winter	0.152	0.152		60.9	28.3 Flood Risk
180 min Winter	0.122	0.122		49.1	18.4 Flood Risk
240 min Winter	0.102	0.102		40.9	12.7 Flood Risk
360 min Winter	0.076	0.076		30.6	7.1 O K
480 min Winter	0.061	0.061		24.6	4.6 O K
600 min Winter	0.051	0.051		20.6	3.3 O K
720 min Winter	0.047	0.047		17.9	2.7 O K
960 min Winter	0.042	0.042		14.3	2.2 O K
1440 min Winter	0.036	0.036		10.3	1.6 O K
2160 min Winter	0.030	0.030		7.3	1.1 O K
2880 min Winter	0.027	0.027		5.7	0.9 O K
4320 min Winter	0.023	0.023		4.2	0.6 O K
5760 min Winter	0.020	0.020		3.3	0.5 O K
7200 min Winter	0.018	0.018		2.7	0.4 O K
8640 min Winter	0.017	0.017		2.3	0.4 O K
10080 min Winter	0.016	0.016		2.0	0.3 O K

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)
-------------	--------------	---------------------	------------------

30 min Winter	64.904	0.0	23
60 min Winter	40.510	0.0	40
120 min Winter	24.421	0.0	70
180 min Winter	17.920	0.0	100
240 min Winter	14.300	0.0	130
360 min Winter	10.377	0.0	188
480 min Winter	8.265	0.0	248
600 min Winter	6.922	0.0	308
720 min Winter	5.986	0.0	366
960 min Winter	4.756	0.0	490
1440 min Winter	3.434	0.0	724
2160 min Winter	2.475	0.0	1100
2880 min Winter	1.960	0.0	1436
4320 min Winter	1.409	0.0	2088
5760 min Winter	1.114	0.0	2936
7200 min Winter	0.927	0.0	3560
8640 min Winter	0.798	0.0	4288
10080 min Winter	0.703	0.0	5016

AKSWard Ltd		Page 3
Seacourt Tower West Way Oxford OX2 0JJ	New Technical Site Permeable Paving	
Date 04/10/2018 File Permeable paving.srcx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Rainfall Details

Rainfall Model	FSR	Winter Storms	Yes
Return Period (years)	100	Cv (Summer)	0.750
Region	England and Wales	Cv (Winter)	0.840
M5-60 (mm)	20.000	Shortest Storm (mins)	15
Ratio R	0.404	Longest Storm (mins)	10080
Summer Storms	Yes	Climate Change %	+0

Time Area Diagram

Total Area (ha) 0.510

Time (mins) Area
From: To: (ha)

0 4 0.510

AKSWard Ltd		Page 4
Seacourt Tower West Way Oxford OX2 0JJ	New Technical Site Permeable Paving	
Date 04/10/2018 File Permeable paving.srcox	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Model Details

Storage is Online Cover Level (m) 0.395

Porous Car Park Structure

Infiltration Coefficient Base (m/hr)	0.35208	Width (m)	391.0
Membrane Percolation (mm/hr)	1000	Length (m)	13.0
Max Percolation (l/s)	1411.9	Slope (1:X)	21.0
Safety Factor	2.0	Depression Storage (mm)	5
Porosity	0.30	Evaporation (mm/day)	3
Invert Level (m)	0.000	Cap Volume Depth (m)	0.300

AKSWard Ltd		Page 1
Seacourt Tower West Way Oxford OX2 0JJ	New Technical Site Permeable Paving	
Date 04/10/2018 File Permeable paving.srccx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Summary of Results for 100 year Return Period (+40%)

Half Drain Time : 8 minutes.

Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status
15 min Summer	0.233	0.233		93.7	Flood Risk
30 min Summer	0.251	0.251		100.7	Flood Risk
60 min Summer	0.245	0.245		98.3	Flood Risk
120 min Summer	0.212	0.212		85.2	Flood Risk
180 min Summer	0.185	0.185		74.2	Flood Risk
240 min Summer	0.163	0.163		65.3	Flood Risk
360 min Summer	0.131	0.131		52.7	Flood Risk
480 min Summer	0.110	0.110		44.3	Flood Risk
600 min Summer	0.096	0.096		38.4	Flood Risk
720 min Summer	0.084	0.084		33.6	O K
960 min Summer	0.068	0.068		27.4	O K
1440 min Summer	0.050	0.050		19.9	O K
2160 min Summer	0.042	0.042		14.3	O K
2880 min Summer	0.038	0.038		11.4	O K
4320 min Summer	0.032	0.032		8.1	O K
5760 min Summer	0.028	0.028		6.4	O K
7200 min Summer	0.026	0.026		5.3	O K
8640 min Summer	0.024	0.024		4.5	O K
10080 min Summer	0.022	0.022		4.0	O K
15 min Winter	0.251	0.251		100.7	Flood Risk

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)
15 min Summer	138.634	0.0	13
30 min Summer	90.866	0.0	22
60 min Summer	56.713	0.0	38
120 min Summer	34.190	0.0	70
180 min Summer	25.088	0.0	100
240 min Summer	20.020	0.0	130
360 min Summer	14.528	0.0	190
480 min Summer	11.570	0.0	248
600 min Summer	9.690	0.0	308
720 min Summer	8.380	0.0	368
960 min Summer	6.658	0.0	490
1440 min Summer	4.807	0.0	724
2160 min Summer	3.465	0.0	1096
2880 min Summer	2.744	0.0	1464
4320 min Summer	1.973	0.0	2196
5760 min Summer	1.559	0.0	2840
7200 min Summer	1.298	0.0	3544
8640 min Summer	1.118	0.0	4280
10080 min Summer	0.985	0.0	5048
15 min Winter	138.634	0.0	14

AKSWard Ltd		Page 2
Seacourt Tower West Way Oxford OX2 0JJ	New Technical Site Permeable Paving	
Date 04/10/2018 File Permeable paving.srccx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Summary of Results for 100 year Return Period (+40%)

Storm Event	Max Level	Max Depth	Max Infiltration (l/s)	Max Volume (m³)	Status
30 min Winter	0.264	0.264		105.9	85.6 Flood Risk
60 min Winter	0.247	0.247		99.1	75.1 Flood Risk
120 min Winter	0.201	0.201		80.6	49.5 Flood Risk
180 min Winter	0.165	0.165		66.2	33.5 Flood Risk
240 min Winter	0.139	0.139		55.7	23.7 Flood Risk
360 min Winter	0.105	0.105		42.3	13.6 Flood Risk
480 min Winter	0.085	0.085		34.2	8.9 O K
600 min Winter	0.072	0.072		28.8	6.3 O K
720 min Winter	0.062	0.062		25.0	4.8 O K
960 min Winter	0.050	0.050		19.9	3.0 O K
1440 min Winter	0.042	0.042		14.3	2.2 O K
2160 min Winter	0.036	0.036		10.3	1.6 O K
2880 min Winter	0.032	0.032		8.1	1.3 O K
4320 min Winter	0.027	0.027		6.0	0.9 O K
5760 min Winter	0.024	0.024		4.7	0.7 O K
7200 min Winter	0.022	0.022		3.8	0.6 O K
8640 min Winter	0.020	0.020		3.3	0.5 O K
10080 min Winter	0.019	0.019		2.8	0.4 O K

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)
-------------	--------------	---------------------	------------------

30 min Winter	90.866	0.0	23
60 min Winter	56.713	0.0	40
120 min Winter	34.190	0.0	72
180 min Winter	25.088	0.0	102
240 min Winter	20.020	0.0	132
360 min Winter	14.528	0.0	190
480 min Winter	11.570	0.0	248
600 min Winter	9.690	0.0	308
720 min Winter	8.380	0.0	368
960 min Winter	6.658	0.0	474
1440 min Winter	4.807	0.0	722
2160 min Winter	3.465	0.0	1068
2880 min Winter	2.744	0.0	1424
4320 min Winter	1.973	0.0	2152
5760 min Winter	1.559	0.0	2896
7200 min Winter	1.298	0.0	3624
8640 min Winter	1.118	0.0	4288
10080 min Winter	0.985	0.0	5128

AKSWard Ltd		Page 3
Seacourt Tower West Way Oxford OX2 0JJ	New Technical Site Permeable Paving	
Date 04/10/2018 File Permeable paving.srcx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Rainfall Details

Rainfall Model	FSR	Winter Storms	Yes
Return Period (years)	100	Cv (Summer)	0.750
Region	England and Wales	Cv (Winter)	0.840
M5-60 (mm)	20.000	Shortest Storm (mins)	15
Ratio R	0.404	Longest Storm (mins)	10080
Summer Storms	Yes	Climate Change %	+40

Time Area Diagram

Total Area (ha) 0.510

Time (mins) Area
From: To: (ha)

0 4 0.510

AKSWard Ltd		Page 4
Seacourt Tower West Way Oxford OX2 0JJ	New Technical Site Permeable Paving	
Date 04/10/2018 File Permeable paving.srcox	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Model Details

Storage is Online Cover Level (m) 0.395

Porous Car Park Structure

Infiltration Coefficient Base (m/hr)	0.35208	Width (m)	391.0
Membrane Percolation (mm/hr)	1000	Length (m)	13.0
Max Percolation (l/s)	1411.9	Slope (1:X)	21.0
Safety Factor	2.0	Depression Storage (mm)	5
Porosity	0.30	Evaporation (mm/day)	3
Invert Level (m)	0.000	Cap Volume Depth (m)	0.300

AKSWard		Page 1
Seacourt Tower West Way Oxford	New Technical Site Swale 1	
Date 18-Jul-18 File SWALE1.SRCX	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Summary of Results for 1 year Return Period

Half Drain Time : 12 minutes.

Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status
15 min Summer	0.118	0.118		0.3	0.3 Flood Risk
30 min Summer	0.122	0.122		0.3	0.3 Flood Risk
60 min Summer	0.119	0.119		0.3	0.3 Flood Risk
120 min Summer	0.110	0.110		0.3	0.3 Flood Risk
180 min Summer	0.102	0.102		0.3	0.2 Flood Risk
240 min Summer	0.095	0.095		0.2	O K
360 min Summer	0.084	0.084		0.2	O K
480 min Summer	0.075	0.075		0.2	O K
600 min Summer	0.069	0.069		0.1	O K
720 min Summer	0.063	0.063		0.1	O K
960 min Summer	0.055	0.055		0.1	O K
1440 min Summer	0.047	0.047		0.1	O K
2160 min Summer	0.040	0.040		0.1	O K
2880 min Summer	0.036	0.036		0.1	O K
4320 min Summer	0.031	0.031		0.0	O K
5760 min Summer	0.028	0.028		0.0	O K
7200 min Summer	0.026	0.026		0.0	O K
8640 min Summer	0.024	0.024		0.0	O K
10080 min Summer	0.023	0.023		0.0	O K
15 min Winter	0.124	0.124		0.3	0.3 Flood Risk

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)
15 min Summer	31.093	0.0	13
30 min Summer	20.252	0.0	22
60 min Summer	12.800	0.0	38
120 min Summer	7.926	0.0	70
180 min Summer	5.960	0.0	102
240 min Summer	4.862	0.0	132
360 min Summer	3.628	0.0	192
480 min Summer	2.939	0.0	252
600 min Summer	2.495	0.0	312
720 min Summer	2.183	0.0	372
960 min Summer	1.768	0.0	492
1440 min Summer	1.314	0.0	726
2160 min Summer	0.977	0.0	1100
2880 min Summer	0.791	0.0	1440
4320 min Summer	0.588	0.0	2160
5760 min Summer	0.476	0.0	2888
7200 min Summer	0.405	0.0	3624
8640 min Summer	0.354	0.0	4256
10080 min Summer	0.317	0.0	5032
15 min Winter	31.093	0.0	14

AKSWard		Page 2
Seacourt Tower West Way Oxford	New Technical Site Swale 1	
Date 18-Jul-18 File SWALE1.SRCX	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Summary of Results for 1 year Return Period

Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status
30 min Winter	0.127	0.127		0.3	0.4 Flood Risk
60 min Winter	0.122	0.122		0.3	0.3 Flood Risk
120 min Winter	0.108	0.108		0.3	0.3 Flood Risk
180 min Winter	0.096	0.096		0.2	0.2 O K
240 min Winter	0.087	0.087		0.2	0.2 O K
360 min Winter	0.074	0.074		0.2	0.1 O K
480 min Winter	0.064	0.064		0.1	0.1 O K
600 min Winter	0.057	0.057		0.1	0.1 O K
720 min Winter	0.052	0.052		0.1	0.0 O K
960 min Winter	0.046	0.046		0.1	0.0 O K
1440 min Winter	0.040	0.040		0.1	0.0 O K
2160 min Winter	0.034	0.034		0.0	0.0 O K
2880 min Winter	0.031	0.031		0.0	0.0 O K
4320 min Winter	0.027	0.027		0.0	0.0 O K
5760 min Winter	0.024	0.024		0.0	0.0 O K
7200 min Winter	0.022	0.022		0.0	0.0 O K
8640 min Winter	0.021	0.021		0.0	0.0 O K
10080 min Winter	0.020	0.020		0.0	0.0 O K

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)
30 min Winter	20.252	0.0	23
60 min Winter	12.800	0.0	42
120 min Winter	7.926	0.0	74
180 min Winter	5.960	0.0	106
240 min Winter	4.862	0.0	136
360 min Winter	3.628	0.0	196
480 min Winter	2.939	0.0	256
600 min Winter	2.495	0.0	314
720 min Winter	2.183	0.0	372
960 min Winter	1.768	0.0	488
1440 min Winter	1.314	0.0	714
2160 min Winter	0.977	0.0	1084
2880 min Winter	0.791	0.0	1416
4320 min Winter	0.588	0.0	2244
5760 min Winter	0.476	0.0	2808
7200 min Winter	0.405	0.0	3560
8640 min Winter	0.354	0.0	4224
10080 min Winter	0.317	0.0	5024

AKSWard		Page 3
Seacourt Tower West Way Oxford	New Technical Site Swale 1	
Date 18-Jul-18 File SWALE1.SRCX	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Rainfall Details

Rainfall Model	FSR	Winter Storms	Yes
Return Period (years)	1	Cv (Summer)	0.750
Region	England and Wales	Cv (Winter)	0.840
M5-60 (mm)	20.000	Shortest Storm (mins)	15
Ratio R	0.404	Longest Storm (mins)	10080
Summer Storms	Yes	Climate Change %	+0

Time Area Diagram

Total Area (ha) 0.008

Time (mins) Area
From: To: (ha)

0 4 0.008

AKSWard		Page 4
Seacourt Tower West Way Oxford	New Technical Site Swale 1	
Date 18-Jul-18 File SWALE1.SRCX	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Model Details

Storage is Online Cover Level (m) 0.400

Swale Structure

Infiltration Coefficient Base (m/hr)	0.35208	Length (m)	23.0
Infiltration Coefficient Side (m/hr)	0.35208	Side Slope (1:X)	3.0
Safety Factor	2.0	Slope (1:X)	60.0
Porosity	1.00	Cap Volume Depth (m)	0.000
Invert Level (m)	0.000	Cap Infiltration Depth (m)	0.000
Base Width (m)	0.5		

AKSWard		Page 1
Seacourt Tower West Way Oxford	New Technical Site Swale 1	
Date 18-Jul-18 File SWALE1.SRCX	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Summary of Results for 30 year Return Period

Half Drain Time : 19 minutes.

Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status
15 min Summer	0.179	0.179		0.6	0.8 Flood Risk
30 min Summer	0.187	0.187		0.6	0.9 Flood Risk
60 min Summer	0.186	0.186		0.6	0.9 Flood Risk
120 min Summer	0.175	0.175		0.5	0.8 Flood Risk
180 min Summer	0.163	0.163		0.5	0.7 Flood Risk
240 min Summer	0.153	0.153		0.4	0.6 Flood Risk
360 min Summer	0.137	0.137		0.4	0.4 Flood Risk
480 min Summer	0.125	0.125		0.3	0.4 Flood Risk
600 min Summer	0.115	0.115		0.3	0.3 Flood Risk
720 min Summer	0.107	0.107		0.3	0.2 Flood Risk
960 min Summer	0.094	0.094		0.2	O K
1440 min Summer	0.077	0.077		0.2	O K
2160 min Summer	0.061	0.061		0.1	O K
2880 min Summer	0.052	0.052		0.1	O K
4320 min Summer	0.044	0.044		0.1	O K
5760 min Summer	0.039	0.039		0.1	O K
7200 min Summer	0.036	0.036		0.1	O K
8640 min Summer	0.033	0.033		0.0	O K
10080 min Summer	0.031	0.031		0.0	O K
15 min Winter	0.189	0.189		0.6	0.9 Flood Risk

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)
15 min Summer	76.290	0.0	15
30 min Summer	49.584	0.0	23
60 min Summer	30.811	0.0	40
120 min Summer	18.584	0.0	72
180 min Summer	13.680	0.0	104
240 min Summer	10.960	0.0	136
360 min Summer	8.001	0.0	196
480 min Summer	6.397	0.0	256
600 min Summer	5.375	0.0	316
720 min Summer	4.661	0.0	376
960 min Summer	3.719	0.0	494
1440 min Summer	2.704	0.0	736
2160 min Summer	1.963	0.0	1100
2880 min Summer	1.563	0.0	1452
4320 min Summer	1.133	0.0	2200
5760 min Summer	0.901	0.0	2872
7200 min Summer	0.754	0.0	3576
8640 min Summer	0.652	0.0	4400
10080 min Summer	0.576	0.0	5056
15 min Winter	76.290	0.0	15

AKSWard		Page 2
Seacourt Tower West Way Oxford	New Technical Site Swale 1	
Date 18-Jul-18 File SWALE1.SRCX	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Summary of Results for 30 year Return Period

Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status
30 min Winter	0.196	0.196		0.7	1.0 Flood Risk
60 min Winter	0.192	0.192		0.6	1.0 Flood Risk
120 min Winter	0.175	0.175		0.6	0.8 Flood Risk
180 min Winter	0.159	0.159		0.5	0.6 Flood Risk
240 min Winter	0.146	0.146		0.4	0.5 Flood Risk
360 min Winter	0.126	0.126		0.3	0.4 Flood Risk
480 min Winter	0.111	0.111		0.3	0.3 Flood Risk
600 min Winter	0.100	0.100		0.2	O K
720 min Winter	0.091	0.091		0.2	O K
960 min Winter	0.078	0.078		0.2	O K
1440 min Winter	0.061	0.061		0.1	O K
2160 min Winter	0.049	0.049		0.1	O K
2880 min Winter	0.043	0.043		0.1	O K
4320 min Winter	0.037	0.037		0.1	O K
5760 min Winter	0.033	0.033		0.0	O K
7200 min Winter	0.030	0.030		0.0	O K
8640 min Winter	0.028	0.028		0.0	O K
10080 min Winter	0.026	0.026		0.0	O K

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)
30 min Winter	49.584	0.0	24
60 min Winter	30.811	0.0	42
120 min Winter	18.584	0.0	76
180 min Winter	13.680	0.0	110
240 min Winter	10.960	0.0	140
360 min Winter	8.001	0.0	202
480 min Winter	6.397	0.0	262
600 min Winter	5.375	0.0	320
720 min Winter	4.661	0.0	380
960 min Winter	3.719	0.0	498
1440 min Winter	2.704	0.0	736
2160 min Winter	1.963	0.0	1084
2880 min Winter	1.563	0.0	1468
4320 min Winter	1.133	0.0	2196
5760 min Winter	0.901	0.0	2928
7200 min Winter	0.754	0.0	3688
8640 min Winter	0.652	0.0	4352
10080 min Winter	0.576	0.0	5120

AKSWard		Page 3
Seacourt Tower West Way Oxford	New Technical Site Swale 1	
Date 18-Jul-18 File SWALE1.SRCX	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Rainfall Details

Rainfall Model	FSR	Winter Storms	Yes
Return Period (years)	30	Cv (Summer)	0.750
Region	England and Wales	Cv (Winter)	0.840
M5-60 (mm)	20.000	Shortest Storm (mins)	15
Ratio R	0.404	Longest Storm (mins)	10080
Summer Storms	Yes	Climate Change %	+0

Time Area Diagram

Total Area (ha) 0.008

Time (mins) Area
From: To: (ha)

0 4 0.008

AKSWard		Page 4
Seacourt Tower West Way Oxford	New Technical Site Swale 1	
Date 18-Jul-18 File SWALE1.SRCX	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Model Details

Storage is Online Cover Level (m) 0.400

Swale Structure

Infiltration Coefficient Base (m/hr)	0.35208	Length (m)	23.0
Infiltration Coefficient Side (m/hr)	0.35208	Side Slope (1:X)	3.0
Safety Factor	2.0	Slope (1:X)	60.0
Porosity	1.00	Cap Volume Depth (m)	0.000
Invert Level (m)	0.000	Cap Infiltration Depth (m)	0.000
Base Width (m)	0.5		

AKSWard		Page 1
Seacourt Tower West Way Oxford	New Technical Site Swale 1	
Date 18-Jul-18 File Swale1.srcx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Summary of Results for 100 year Return Period

Half Drain Time : 21 minutes.

Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status
15 min Summer	0.202	0.202		0.7	1.1 Flood Risk
30 min Summer	0.212	0.212		0.7	1.2 Flood Risk
60 min Summer	0.212	0.212		0.7	1.2 Flood Risk
120 min Summer	0.201	0.201		0.7	1.1 Flood Risk
180 min Summer	0.189	0.189		0.6	0.9 Flood Risk
240 min Summer	0.178	0.178		0.6	0.8 Flood Risk
360 min Summer	0.160	0.160		0.5	0.6 Flood Risk
480 min Summer	0.146	0.146		0.4	0.5 Flood Risk
600 min Summer	0.135	0.135		0.4	0.4 Flood Risk
720 min Summer	0.126	0.126		0.3	0.4 Flood Risk
960 min Summer	0.111	0.111		0.3	0.3 Flood Risk
1440 min Summer	0.091	0.091		0.2	O K
2160 min Summer	0.073	0.073		0.2	O K
2880 min Summer	0.062	0.062		0.1	O K
4320 min Summer	0.049	0.049		0.1	O K
5760 min Summer	0.043	0.043		0.1	O K
7200 min Summer	0.039	0.039		0.1	O K
8640 min Summer	0.037	0.037		0.1	O K
10080 min Summer	0.034	0.034		0.0	O K
15 min Winter	0.212	0.212		0.7	1.3 Flood Risk

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)
15 min Summer	99.025	0.0	15
30 min Summer	64.904	0.0	23
60 min Summer	40.510	0.0	40
120 min Summer	24.421	0.0	74
180 min Summer	17.920	0.0	106
240 min Summer	14.300	0.0	136
360 min Summer	10.377	0.0	198
480 min Summer	8.265	0.0	258
600 min Summer	6.922	0.0	318
720 min Summer	5.986	0.0	378
960 min Summer	4.756	0.0	500
1440 min Summer	3.434	0.0	736
2160 min Summer	2.475	0.0	1100
2880 min Summer	1.960	0.0	1468
4320 min Summer	1.409	0.0	2156
5760 min Summer	1.114	0.0	2936
7200 min Summer	0.927	0.0	3592
8640 min Summer	0.798	0.0	4272
10080 min Summer	0.703	0.0	5096
15 min Winter	99.025	0.0	15

AKSWard		Page 2
Seacourt Tower West Way Oxford	New Technical Site Swale 1	
Date 18-Jul-18 File Swale1.srcx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Summary of Results for 100 year Return Period

Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status
30 min Winter	0.222	0.222		0.8	1.4 Flood Risk
60 min Winter	0.220	0.220		0.8	1.4 Flood Risk
120 min Winter	0.202	0.202		0.7	1.1 Flood Risk
180 min Winter	0.186	0.186		0.6	0.9 Flood Risk
240 min Winter	0.171	0.171		0.5	0.7 Flood Risk
360 min Winter	0.148	0.148		0.4	0.5 Flood Risk
480 min Winter	0.131	0.131		0.4	0.4 Flood Risk
600 min Winter	0.118	0.118		0.3	0.3 Flood Risk
720 min Winter	0.108	0.108		0.3	0.3 Flood Risk
960 min Winter	0.093	0.093		0.2	O K
1440 min Winter	0.074	0.074		0.2	O K
2160 min Winter	0.057	0.057		0.1	O K
2880 min Winter	0.049	0.049		0.1	O K
4320 min Winter	0.041	0.041		0.1	O K
5760 min Winter	0.037	0.037		0.1	O K
7200 min Winter	0.034	0.034		0.0	O K
8640 min Winter	0.031	0.031		0.0	O K
10080 min Winter	0.029	0.029		0.0	O K

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)
-------------	--------------	---------------------	------------------

30 min Winter	64.904	0.0	25
60 min Winter	40.510	0.0	44
120 min Winter	24.421	0.0	78
180 min Winter	17.920	0.0	110
240 min Winter	14.300	0.0	142
360 min Winter	10.377	0.0	204
480 min Winter	8.265	0.0	264
600 min Winter	6.922	0.0	324
720 min Winter	5.986	0.0	382
960 min Winter	4.756	0.0	502
1440 min Winter	3.434	0.0	736
2160 min Winter	2.475	0.0	1104
2880 min Winter	1.960	0.0	1468
4320 min Winter	1.409	0.0	2184
5760 min Winter	1.114	0.0	2848
7200 min Winter	0.927	0.0	3648
8640 min Winter	0.798	0.0	4296
10080 min Winter	0.703	0.0	5136

AKSWard		Page 3
Seacourt Tower West Way Oxford	New Technical Site Swale 1	
Date 18-Jul-18 File Swale1.srcx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Rainfall Details

Rainfall Model	FSR	Winter Storms	Yes
Return Period (years)	100	Cv (Summer)	0.750
Region	England and Wales	Cv (Winter)	0.840
M5-60 (mm)	20.000	Shortest Storm (mins)	15
Ratio R	0.404	Longest Storm (mins)	10080
Summer Storms	Yes	Climate Change %	+0

Time Area Diagram

Total Area (ha) 0.008

Time (mins) Area
From: To: (ha)

0 4 0.008

AKSWard		Page 4
Seacourt Tower West Way Oxford	New Technical Site Swale 1	
Date 18-Jul-18 File Swale1.srcx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Model Details

Storage is Online Cover Level (m) 0.400

Swale Structure

Infiltration Coefficient Base (m/hr)	0.35208	Length (m)	23.0
Infiltration Coefficient Side (m/hr)	0.35208	Side Slope (1:X)	3.0
Safety Factor	2.0	Slope (1:X)	60.0
Porosity	1.00	Cap Volume Depth (m)	0.000
Invert Level (m)	0.000	Cap Infiltration Depth (m)	0.000
Base Width (m)	0.5		

AKSWard		Page 1
Seacourt Tower West Way Oxford	New Technical Site Swale 1	
Date 18-Jul-18 File Swale1.srcx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Summary of Results for 100 year Return Period (+40%)

Half Drain Time : 24 minutes.

Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status
15 min Summer	0.234	0.234		0.9	1.6 Flood Risk
30 min Summer	0.246	0.246		0.9	1.8 Flood Risk
60 min Summer	0.248	0.248		0.9	1.8 Flood Risk
120 min Summer	0.237	0.237		0.9	1.6 Flood Risk
180 min Summer	0.225	0.225		0.8	1.4 Flood Risk
240 min Summer	0.213	0.213		0.7	1.3 Flood Risk
360 min Summer	0.193	0.193		0.6	1.0 Flood Risk
480 min Summer	0.178	0.178		0.6	0.8 Flood Risk
600 min Summer	0.165	0.165		0.5	0.7 Flood Risk
720 min Summer	0.155	0.155		0.5	0.6 Flood Risk
960 min Summer	0.138	0.138		0.4	0.4 Flood Risk
1440 min Summer	0.115	0.115		0.3	0.3 Flood Risk
2160 min Summer	0.093	0.093		0.2	O K
2880 min Summer	0.080	0.080		0.2	O K
4320 min Summer	0.062	0.062		0.1	O K
5760 min Summer	0.052	0.052		0.1	O K
7200 min Summer	0.047	0.047		0.1	O K
8640 min Summer	0.043	0.043		0.1	O K
10080 min Summer	0.041	0.041		0.1	O K
15 min Winter	0.246	0.246		0.9	1.8 Flood Risk

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)
15 min Summer	138.634	0.0	15
30 min Summer	90.866	0.0	24
60 min Summer	56.713	0.0	40
120 min Summer	34.190	0.0	74
180 min Summer	25.088	0.0	106
240 min Summer	20.020	0.0	138
360 min Summer	14.528	0.0	200
480 min Summer	11.570	0.0	260
600 min Summer	9.690	0.0	320
720 min Summer	8.380	0.0	380
960 min Summer	6.658	0.0	500
1440 min Summer	4.807	0.0	738
2160 min Summer	3.465	0.0	1100
2880 min Summer	2.744	0.0	1468
4320 min Summer	1.973	0.0	2188
5760 min Summer	1.559	0.0	2936
7200 min Summer	1.298	0.0	3632
8640 min Summer	1.118	0.0	4336
10080 min Summer	0.985	0.0	5128
15 min Winter	138.634	0.0	15

AKSWard		Page 2
Seacourt Tower West Way Oxford	New Technical Site Swale 1	
Date 18-Jul-18 File Swale1.srcx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Summary of Results for 100 year Return Period (+40%)

Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status
30 min Winter	0.258	0.258		1.0	2.0 Flood Risk
60 min Winter	0.258	0.258		1.0	2.0 Flood Risk
120 min Winter	0.241	0.241		0.9	1.7 Flood Risk
180 min Winter	0.223	0.223		0.8	1.4 Flood Risk
240 min Winter	0.207	0.207		0.7	1.2 Flood Risk
360 min Winter	0.182	0.182		0.6	0.9 Flood Risk
480 min Winter	0.163	0.163		0.5	0.7 Flood Risk
600 min Winter	0.148	0.148		0.4	0.5 Flood Risk
720 min Winter	0.136	0.136		0.4	0.4 Flood Risk
960 min Winter	0.118	0.118		0.3	0.3 Flood Risk
1440 min Winter	0.094	0.094		0.2	O K
2160 min Winter	0.074	0.074		0.2	O K
2880 min Winter	0.062	0.062		0.1	O K
4320 min Winter	0.049	0.049		0.1	O K
5760 min Winter	0.043	0.043		0.1	O K
7200 min Winter	0.040	0.040		0.1	O K
8640 min Winter	0.037	0.037		0.1	O K
10080 min Winter	0.035	0.035		0.0	O K

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)
-------------	--------------	---------------------	------------------

30 min Winter	90.866	0.0	25
60 min Winter	56.713	0.0	44
120 min Winter	34.190	0.0	80
180 min Winter	25.088	0.0	112
240 min Winter	20.020	0.0	144
360 min Winter	14.528	0.0	206
480 min Winter	11.570	0.0	266
600 min Winter	9.690	0.0	326
720 min Winter	8.380	0.0	384
960 min Winter	6.658	0.0	502
1440 min Winter	4.807	0.0	738
2160 min Winter	3.465	0.0	1104
2880 min Winter	2.744	0.0	1468
4320 min Winter	1.973	0.0	2144
5760 min Winter	1.559	0.0	2936
7200 min Winter	1.298	0.0	3672
8640 min Winter	1.118	0.0	4352
10080 min Winter	0.985	0.0	5128

AKSWard		Page 3
Seacourt Tower West Way Oxford	New Technical Site Swale 1	
Date 18-Jul-18 File Swale1.srcx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Rainfall Details

Rainfall Model	FSR	Winter Storms	Yes
Return Period (years)	100	Cv (Summer)	0.750
Region	England and Wales	Cv (Winter)	0.840
M5-60 (mm)	20.000	Shortest Storm (mins)	15
Ratio R	0.404	Longest Storm (mins)	10080
Summer Storms	Yes	Climate Change %	+40

Time Area Diagram

Total Area (ha) 0.008

Time (mins) Area
From: To: (ha)

0 4 0.008

AKSWard		Page 4
Seacourt Tower West Way Oxford	New Technical Site Swale 1	
Date 18-Jul-18 File Swale1.srcx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Model Details

Storage is Online Cover Level (m) 0.400

Swale Structure

Infiltration Coefficient Base (m/hr)	0.35208	Length (m)	23.0
Infiltration Coefficient Side (m/hr)	0.35208	Side Slope (1:X)	3.0
Safety Factor	2.0	Slope (1:X)	60.0
Porosity	1.00	Cap Volume Depth (m)	0.000
Invert Level (m)	0.000	Cap Infiltration Depth (m)	0.000
Base Width (m)	0.5		

AKSWard		Page 1
Seacourt Tower West Way Oxford	New Technical Site Swale 2	
Date 18-Jul-18 File Swale2.srcx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Summary of Results for 1 year Return Period

Half Drain Time : 11 minutes.

Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status
15 min Summer	0.057	0.057		0.6	O K
30 min Summer	0.060	0.060		0.7	O K
60 min Summer	0.058	0.058		0.6	O K
120 min Summer	0.049	0.049		0.6	O K
180 min Summer	0.043	0.043		0.5	O K
240 min Summer	0.038	0.038		0.5	O K
360 min Summer	0.031	0.031		0.4	O K
480 min Summer	0.027	0.027		0.3	O K
600 min Summer	0.023	0.023		0.3	O K
720 min Summer	0.021	0.021		0.2	O K
960 min Summer	0.017	0.017		0.2	O K
1440 min Summer	0.013	0.013		0.2	O K
2160 min Summer	0.010	0.010		0.1	O K
2880 min Summer	0.008	0.008		0.1	O K
4320 min Summer	0.006	0.006		0.1	O K
5760 min Summer	0.005	0.005		0.1	O K
7200 min Summer	0.004	0.004		0.1	O K
8640 min Summer	0.004	0.004		0.0	O K
10080 min Summer	0.003	0.003		0.0	O K
15 min Winter	0.062	0.062		0.7	O K

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)
-------------	--------------	---------------------	------------------

15 min Summer	31.093	0.0	13
30 min Summer	20.252	0.0	22
60 min Summer	12.800	0.0	38
120 min Summer	7.926	0.0	70
180 min Summer	5.960	0.0	100
240 min Summer	4.862	0.0	130
360 min Summer	3.628	0.0	190
480 min Summer	2.939	0.0	250
600 min Summer	2.495	0.0	310
720 min Summer	2.183	0.0	370
960 min Summer	1.768	0.0	492
1440 min Summer	1.314	0.0	734
2160 min Summer	0.977	0.0	1096
2880 min Summer	0.791	0.0	1464
4320 min Summer	0.588	0.0	2192
5760 min Summer	0.476	0.0	2936
7200 min Summer	0.405	0.0	3552
8640 min Summer	0.354	0.0	4400
10080 min Summer	0.317	0.0	5104
15 min Winter	31.093	0.0	14

AKSWard		Page 2
Seacourt Tower West Way Oxford	New Technical Site Swale 2	
Date 18-Jul-18 File Swale2.srcx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Summary of Results for 1 year Return Period

Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status
30 min Winter	0.065	0.065		0.7	0.7 O K
60 min Winter	0.059	0.059		0.6	0.6 O K
120 min Winter	0.046	0.046		0.6	0.4 O K
180 min Winter	0.038	0.038		0.5	0.4 O K
240 min Winter	0.033	0.033		0.4	0.3 O K
360 min Winter	0.026	0.026		0.3	0.2 O K
480 min Winter	0.021	0.021		0.3	0.2 O K
600 min Winter	0.018	0.018		0.2	0.1 O K
720 min Winter	0.016	0.016		0.2	0.1 O K
960 min Winter	0.013	0.013		0.2	0.1 O K
1440 min Winter	0.010	0.010		0.1	0.1 O K
2160 min Winter	0.007	0.007		0.1	0.1 O K
2880 min Winter	0.006	0.006		0.1	0.0 O K
4320 min Winter	0.005	0.005		0.1	0.0 O K
5760 min Winter	0.004	0.004		0.0	0.0 O K
7200 min Winter	0.003	0.003		0.0	0.0 O K
8640 min Winter	0.003	0.003		0.0	0.0 O K
10080 min Winter	0.003	0.003		0.0	0.0 O K

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)
-------------	--------------	---------------------	------------------

30 min Winter	20.252	0.0	23
60 min Winter	12.800	0.0	40
120 min Winter	7.926	0.0	72
180 min Winter	5.960	0.0	102
240 min Winter	4.862	0.0	132
360 min Winter	3.628	0.0	192
480 min Winter	2.939	0.0	254
600 min Winter	2.495	0.0	314
720 min Winter	2.183	0.0	376
960 min Winter	1.768	0.0	500
1440 min Winter	1.314	0.0	726
2160 min Winter	0.977	0.0	1092
2880 min Winter	0.791	0.0	1476
4320 min Winter	0.588	0.0	2200
5760 min Winter	0.476	0.0	2976
7200 min Winter	0.405	0.0	3856
8640 min Winter	0.354	0.0	4400
10080 min Winter	0.317	0.0	5096

AKSWard		Page 3
Seacourt Tower West Way Oxford	New Technical Site Swale 2	
Date 18-Jul-18 File Swale2.srcx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Rainfall Details

Rainfall Model	FSR	Winter Storms	Yes
Return Period (years)	1	Cv (Summer)	0.750
Region	England and Wales	Cv (Winter)	0.840
M5-60 (mm)	20.000	Shortest Storm (mins)	15
Ratio R	0.404	Longest Storm (mins)	10080
Summer Storms	Yes	Climate Change %	+0

Time Area Diagram

Total Area (ha) 0.015

Time (mins) Area
From: To: (ha)

0 4 0.015

AKSWard		Page 4
Seacourt Tower West Way Oxford	New Technical Site Swale 2	
Date 18-Jul-18 File Swale2.srcx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Model Details

Storage is Online Cover Level (m) 0.500

Swale Structure

Infiltration Coefficient Base (m/hr)	0.35208	Length (m)	15.0
Infiltration Coefficient Side (m/hr)	0.35208	Side Slope (1:X)	3.0
Safety Factor	2.0	Slope (1:X)	0.0
Porosity	1.00	Cap Volume Depth (m)	0.000
Invert Level (m)	0.000	Cap Infiltration Depth (m)	0.000
Base Width (m)	0.5		

AKSWard		Page 1
Seacourt Tower West Way Oxford	New Technical Site Swale 2	
Date 18-Jul-18 File Swale2.srcx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Summary of Results for 30 year Return Period

Half Drain Time : 22 minutes.

Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status
15 min Summer	0.122	0.122		0.9	O K
30 min Summer	0.132	0.132		1.0	O K
60 min Summer	0.131	0.131		1.0	O K
120 min Summer	0.118	0.118		0.9	O K
180 min Summer	0.104	0.104		0.9	O K
240 min Summer	0.092	0.092		0.8	O K
360 min Summer	0.072	0.072		0.7	O K
480 min Summer	0.058	0.058		0.6	O K
600 min Summer	0.049	0.049		0.6	O K
720 min Summer	0.044	0.044		0.5	O K
960 min Summer	0.036	0.036		0.4	O K
1440 min Summer	0.027	0.027		0.3	O K
2160 min Summer	0.020	0.020		0.2	O K
2880 min Summer	0.016	0.016		0.2	O K
4320 min Summer	0.012	0.012		0.1	O K
5760 min Summer	0.009	0.009		0.1	O K
7200 min Summer	0.008	0.008		0.1	O K
8640 min Summer	0.007	0.007		0.1	O K
10080 min Summer	0.006	0.006		0.1	O K
15 min Winter	0.134	0.134		1.0	O K

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)
15 min Summer	76.290	0.0	15
30 min Summer	49.584	0.0	24
60 min Summer	30.811	0.0	40
120 min Summer	18.584	0.0	74
180 min Summer	13.680	0.0	106
240 min Summer	10.960	0.0	136
360 min Summer	8.001	0.0	198
480 min Summer	6.397	0.0	256
600 min Summer	5.375	0.0	312
720 min Summer	4.661	0.0	372
960 min Summer	3.719	0.0	492
1440 min Summer	2.704	0.0	734
2160 min Summer	1.963	0.0	1100
2880 min Summer	1.563	0.0	1464
4320 min Summer	1.133	0.0	2200
5760 min Summer	0.901	0.0	2856
7200 min Summer	0.754	0.0	3632
8640 min Summer	0.652	0.0	4336
10080 min Summer	0.576	0.0	5144
15 min Winter	76.290	0.0	15

AKSWard		Page 2
Seacourt Tower West Way Oxford	New Technical Site Swale 2	
Date 18-Jul-18 File Swale2.srcx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Summary of Results for 30 year Return Period

Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status
30 min Winter	0.144	0.144		1.0	2.0
60 min Winter	0.140	0.140		1.0	1.9
120 min Winter	0.120	0.120		0.9	1.5
180 min Winter	0.100	0.100		0.8	1.2
240 min Winter	0.083	0.083		0.8	0.9
360 min Winter	0.058	0.058		0.6	0.6
480 min Winter	0.045	0.045		0.5	0.4
600 min Winter	0.039	0.039		0.5	0.4
720 min Winter	0.034	0.034		0.4	0.3
960 min Winter	0.027	0.027		0.3	0.2
1440 min Winter	0.020	0.020		0.2	0.2
2160 min Winter	0.015	0.015		0.2	0.1
2880 min Winter	0.012	0.012		0.1	0.1
4320 min Winter	0.009	0.009		0.1	0.1
5760 min Winter	0.007	0.007		0.1	0.1
7200 min Winter	0.006	0.006		0.1	0.0
8640 min Winter	0.005	0.005		0.1	0.0
10080 min Winter	0.004	0.004		0.1	0.0

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)
-------------	--------------	---------------------	------------------

30 min Winter	49.584	0.0	25
60 min Winter	30.811	0.0	44
120 min Winter	18.584	0.0	78
180 min Winter	13.680	0.0	112
240 min Winter	10.960	0.0	142
360 min Winter	8.001	0.0	200
480 min Winter	6.397	0.0	256
600 min Winter	5.375	0.0	314
720 min Winter	4.661	0.0	374
960 min Winter	3.719	0.0	490
1440 min Winter	2.704	0.0	736
2160 min Winter	1.963	0.0	1088
2880 min Winter	1.563	0.0	1468
4320 min Winter	1.133	0.0	2208
5760 min Winter	0.901	0.0	2856
7200 min Winter	0.754	0.0	3648
8640 min Winter	0.652	0.0	4368
10080 min Winter	0.576	0.0	5224

AKSWard		Page 3
Seacourt Tower West Way Oxford	New Technical Site Swale 2	
Date 18-Jul-18 File Swale2.srcx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Rainfall Details

Rainfall Model	FSR	Winter Storms	Yes
Return Period (years)	30	Cv (Summer)	0.750
Region	England and Wales	Cv (Winter)	0.840
M5-60 (mm)	20.000	Shortest Storm (mins)	15
Ratio R	0.404	Longest Storm (mins)	10080
Summer Storms	Yes	Climate Change %	+0

Time Area Diagram

Total Area (ha) 0.015

Time (mins) Area
From: To: (ha)

0 4 0.015

AKSWard		Page 4
Seacourt Tower West Way Oxford	New Technical Site Swale 2	
Date 18-Jul-18 File Swale2.srcx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Model Details

Storage is Online Cover Level (m) 0.500

Swale Structure

Infiltration Coefficient Base (m/hr)	0.35208	Length (m)	15.0
Infiltration Coefficient Side (m/hr)	0.35208	Side Slope (1:X)	3.0
Safety Factor	2.0	Slope (1:X)	0.0
Porosity	1.00	Cap Volume Depth (m)	0.000
Invert Level (m)	0.000	Cap Infiltration Depth (m)	0.000
Base Width (m)	0.5		

AKSWard		Page 1
Seacourt Tower West Way Oxford	New Technical Site Swale 2	
Date 18-Jul-18 File Swale2.srcx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Summary of Results for 100 year Return Period

Half Drain Time : 22 minutes.

Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status
15 min Summer	0.150	0.150		1.1	O K
30 min Summer	0.163	0.163		1.1	O K
60 min Summer	0.165	0.165		1.1	O K
120 min Summer	0.152	0.152		1.1	O K
180 min Summer	0.137	0.137		1.0	O K
240 min Summer	0.123	0.123		0.9	O K
360 min Summer	0.100	0.100		0.8	O K
480 min Summer	0.082	0.082		0.8	O K
600 min Summer	0.068	0.068		0.7	O K
720 min Summer	0.058	0.058		0.6	O K
960 min Summer	0.046	0.046		0.6	O K
1440 min Summer	0.034	0.034		0.4	O K
2160 min Summer	0.025	0.025		0.3	O K
2880 min Summer	0.020	0.020		0.2	O K
4320 min Summer	0.015	0.015		0.2	O K
5760 min Summer	0.012	0.012		0.1	O K
7200 min Summer	0.010	0.010		0.1	O K
8640 min Summer	0.008	0.008		0.1	O K
10080 min Summer	0.007	0.007		0.1	O K
15 min Winter	0.163	0.163		1.1	O K

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)
15 min Summer	99.025	0.0	15
30 min Summer	64.904	0.0	24
60 min Summer	40.510	0.0	42
120 min Summer	24.421	0.0	76
180 min Summer	17.920	0.0	108
240 min Summer	14.300	0.0	140
360 min Summer	10.377	0.0	200
480 min Summer	8.265	0.0	260
600 min Summer	6.922	0.0	320
720 min Summer	5.986	0.0	376
960 min Summer	4.756	0.0	492
1440 min Summer	3.434	0.0	736
2160 min Summer	2.475	0.0	1096
2880 min Summer	1.960	0.0	1464
4320 min Summer	1.409	0.0	2196
5760 min Summer	1.114	0.0	2896
7200 min Summer	0.927	0.0	3624
8640 min Summer	0.798	0.0	4280
10080 min Summer	0.703	0.0	4968
15 min Winter	99.025	0.0	16

AKSWard		Page 2
Seacourt Tower West Way Oxford	New Technical Site Swale 2	
Date 18-Jul-18 File Swale2.srcx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Summary of Results for 100 year Return Period

Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status
30 min Winter	0.177	0.177		1.2	2.7 O K
60 min Winter	0.177	0.177		1.2	2.7 O K
120 min Winter	0.157	0.157		1.1	2.3 O K
180 min Winter	0.135	0.135		1.0	1.8 O K
240 min Winter	0.116	0.116		0.9	1.5 O K
360 min Winter	0.085	0.085		0.8	1.0 O K
480 min Winter	0.064	0.064		0.7	0.7 O K
600 min Winter	0.050	0.050		0.6	0.5 O K
720 min Winter	0.043	0.043		0.5	0.4 O K
960 min Winter	0.035	0.035		0.4	0.3 O K
1440 min Winter	0.025	0.025		0.3	0.2 O K
2160 min Winter	0.018	0.018		0.2	0.2 O K
2880 min Winter	0.015	0.015		0.2	0.1 O K
4320 min Winter	0.011	0.011		0.1	0.1 O K
5760 min Winter	0.008	0.008		0.1	0.1 O K
7200 min Winter	0.007	0.007		0.1	0.1 O K
8640 min Winter	0.006	0.006		0.1	0.0 O K
10080 min Winter	0.005	0.005		0.1	0.0 O K

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)
30 min Winter	64.904	0.0	26
60 min Winter	40.510	0.0	44
120 min Winter	24.421	0.0	80
180 min Winter	17.920	0.0	114
240 min Winter	14.300	0.0	146
360 min Winter	10.377	0.0	208
480 min Winter	8.265	0.0	264
600 min Winter	6.922	0.0	314
720 min Winter	5.986	0.0	376
960 min Winter	4.756	0.0	492
1440 min Winter	3.434	0.0	734
2160 min Winter	2.475	0.0	1100
2880 min Winter	1.960	0.0	1464
4320 min Winter	1.409	0.0	2160
5760 min Winter	1.114	0.0	2848
7200 min Winter	0.927	0.0	3584
8640 min Winter	0.798	0.0	4496
10080 min Winter	0.703	0.0	4984

AKSWard		Page 3
Seacourt Tower West Way Oxford	New Technical Site Swale 2	
Date 18-Jul-18 File Swale2.srcx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Rainfall Details

Rainfall Model	FSR	Winter Storms	Yes
Return Period (years)	100	Cv (Summer)	0.750
Region	England and Wales	Cv (Winter)	0.840
M5-60 (mm)	20.000	Shortest Storm (mins)	15
Ratio R	0.404	Longest Storm (mins)	10080
Summer Storms	Yes	Climate Change %	+0

Time Area Diagram

Total Area (ha) 0.015

Time (mins) Area
From: To: (ha)

0 4 0.015

AKSWard		Page 4
Seacourt Tower West Way Oxford	New Technical Site Swale 2	
Date 18-Jul-18 File Swale2.srcx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Model Details

Storage is Online Cover Level (m) 0.500

Swale Structure

Infiltration Coefficient Base (m/hr)	0.35208	Length (m)	15.0
Infiltration Coefficient Side (m/hr)	0.35208	Side Slope (1:X)	3.0
Safety Factor	2.0	Slope (1:X)	0.0
Porosity	1.00	Cap Volume Depth (m)	0.000
Invert Level (m)	0.000	Cap Infiltration Depth (m)	0.000
Base Width (m)	0.5		

AKSWard		Page 1
Seacourt Tower West Way Oxford	New Technical Site Swale 2	
Date 18-Jul-18 File Swale2.srcx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Summary of Results for 100 year Return Period (+40%)

Half Drain Time : 34 minutes.

Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status
15 min Summer	0.192	0.192		1.3	O K
30 min Summer	0.210	0.210		1.4	3.6 Flood Risk
60 min Summer	0.215	0.215		1.4	3.7 Flood Risk
120 min Summer	0.203	0.203		1.3	3.4 Flood Risk
180 min Summer	0.187	0.187		1.3	O K
240 min Summer	0.172	0.172		1.2	O K
360 min Summer	0.146	0.146		1.1	O K
480 min Summer	0.125	0.125		1.0	O K
600 min Summer	0.108	0.108		0.9	O K
720 min Summer	0.094	0.094		0.8	O K
960 min Summer	0.072	0.072		0.7	O K
1440 min Summer	0.048	0.048		0.6	O K
2160 min Summer	0.035	0.035		0.4	O K
2880 min Summer	0.028	0.028		0.3	O K
4320 min Summer	0.020	0.020		0.2	O K
5760 min Summer	0.016	0.016		0.2	O K
7200 min Summer	0.013	0.013		0.2	O K
8640 min Summer	0.012	0.012		0.1	O K
10080 min Summer	0.010	0.010		0.1	O K
15 min Winter	0.209	0.209		1.4	3.5 Flood Risk

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)
15 min Summer	138.634	0.0	16
30 min Summer	90.866	0.0	26
60 min Summer	56.713	0.0	42
120 min Summer	34.190	0.0	76
180 min Summer	25.088	0.0	110
240 min Summer	20.020	0.0	142
360 min Summer	14.528	0.0	204
480 min Summer	11.570	0.0	266
600 min Summer	9.690	0.0	326
720 min Summer	8.380	0.0	384
960 min Summer	6.658	0.0	502
1440 min Summer	4.807	0.0	736
2160 min Summer	3.465	0.0	1100
2880 min Summer	2.744	0.0	1468
4320 min Summer	1.973	0.0	2200
5760 min Summer	1.559	0.0	2928
7200 min Summer	1.298	0.0	3584
8640 min Summer	1.118	0.0	4320
10080 min Summer	0.985	0.0	5136
15 min Winter	138.634	0.0	16

AKSWard		Page 2
Seacourt Tower West Way Oxford	New Technical Site Swale 2	
Date 18-Jul-18 File Swale2.srcx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Summary of Results for 100 year Return Period (+40%)

Storm Event	Max Level	Max Depth	Max Infiltration (l/s)	Max Volume (m³)	Status
30 min Winter	0.228	0.228		1.5	4.1 Flood Risk
60 min Winter	0.232	0.232		1.5	4.2 Flood Risk
120 min Winter	0.213	0.213		1.4	3.6 Flood Risk
180 min Winter	0.190	0.190		1.3	O K
240 min Winter	0.169	0.169		1.2	O K
360 min Winter	0.134	0.134		1.0	O K
480 min Winter	0.107	0.107		0.9	O K
600 min Winter	0.086	0.086		0.8	O K
720 min Winter	0.069	0.069		0.7	O K
960 min Winter	0.048	0.048		0.6	O K
1440 min Winter	0.035	0.035		0.4	O K
2160 min Winter	0.026	0.026		0.3	O K
2880 min Winter	0.020	0.020		0.2	O K
4320 min Winter	0.015	0.015		0.2	O K
5760 min Winter	0.012	0.012		0.1	O K
7200 min Winter	0.010	0.010		0.1	O K
8640 min Winter	0.008	0.008		0.1	O K
10080 min Winter	0.007	0.007		0.1	O K

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)
-------------	--------------	---------------------	------------------

30 min Winter	90.866	0.0	27
60 min Winter	56.713	0.0	46
120 min Winter	34.190	0.0	82
180 min Winter	25.088	0.0	118
240 min Winter	20.020	0.0	150
360 min Winter	14.528	0.0	214
480 min Winter	11.570	0.0	274
600 min Winter	9.690	0.0	332
720 min Winter	8.380	0.0	390
960 min Winter	6.658	0.0	498
1440 min Winter	4.807	0.0	736
2160 min Winter	3.465	0.0	1092
2880 min Winter	2.744	0.0	1432
4320 min Winter	1.973	0.0	2164
5760 min Winter	1.559	0.0	2856
7200 min Winter	1.298	0.0	3568
8640 min Winter	1.118	0.0	4384
10080 min Winter	0.985	0.0	4968

AKSWard		Page 3
Seacourt Tower West Way Oxford	New Technical Site Swale 2	
Date 18-Jul-18 File Swale2.srcx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Rainfall Details

Rainfall Model	FSR	Winter Storms	Yes
Return Period (years)	100	Cv (Summer)	0.750
Region	England and Wales	Cv (Winter)	0.840
M5-60 (mm)	20.000	Shortest Storm (mins)	15
Ratio R	0.404	Longest Storm (mins)	10080
Summer Storms	Yes	Climate Change %	+40

Time Area Diagram

Total Area (ha) 0.015

Time (mins) Area
From: To: (ha)

0 4 0.015

AKSWard		Page 4
Seacourt Tower West Way Oxford	New Technical Site Swale 2	
Date 18-Jul-18 File Swale2.srcx	Designed by NJ Checked by GT	
Micro Drainage	Source Control 2018.1.1	

Model Details

Storage is Online Cover Level (m) 0.500

Swale Structure

Infiltration Coefficient Base (m/hr)	0.35208	Length (m)	15.0
Infiltration Coefficient Side (m/hr)	0.35208	Side Slope (1:X)	3.0
Safety Factor	2.0	Slope (1:X)	0.0
Porosity	1.00	Cap Volume Depth (m)	0.000
Invert Level (m)	0.000	Cap Infiltration Depth (m)	0.000
Base Width (m)	0.5		

Appendix E

Surface Water Drainage Pro-Forma

Surface Water Drainage Pro-forma for new developments

This pro-forma accompanies our “Surface Water Drainage; Local Guidance for Planning Applications” note. It is expected that applicants/developers should complete and submit the pro-forma to present a summary of the surface water drainage strategy for the site and demonstrate compliance with the National Planning Policy Guidance and Non-Statutory Technical Standards. The pro-forma will then be used to support the LPA in making a decision on the suitability of the proposal and, if the LPA is minded to find the completed pro-forma acceptable, then it may be used as an evidence base for a relevant surface water condition to be appended to the decision notice, stating that the developments drainage proposal will be constructed in accordance with the details set out in the relevant pro-forma.

It must however be noted that this pro-forma submitted alone, will not be considered a suitable surface water drainage strategy. It should be clearly referenced within the pro-forma where in the other submission documents the details provided are taken from.

The pro-forma is supported by the [Defra/EA guidance on Rainfall Runoff Management](#), and uses the storage calculator on [www.UKsuds.com](#). The pro-forma should be considered alongside other supporting SuDS Guidance, but focuses on ensuring flood risk is not made worse elsewhere. This proforma is based upon current industry standard practice.

1. Site Details

Site	New Technical Site, Bicester Heritage
Address & post code or LPA reference	A4421, Bicester OX26 5HA
Grid reference	SP 59258 24680
Is the existing site developed or Greenfield?	Greenfield
Total Site Area	1.61 Hectares
Total Site Area served by drainage system (excluding open space) (Ha)*	1.08 Hectares
Pre-application sought? (Ref)	

* The Greenfield runoff off rate from the development which is to be used for assessing the requirements for limiting discharge flow rates and attenuation storage from a site should be calculated for the area that forms the drainage network for the site whatever size of site and type of drainage technique. Please refer to the Rainfall Runoff Management document or CIRIA manual for detail on this.

2. Impermeable Area

	Existing	Proposed	Difference (Proposed-Existing)	Notes for developers
Impermeable area (ha)	0 Hectares	1.08 Hectares	1.08 Hectares	If proposed > existing, then runoff rates and volumes will be increasing. Section 6 must be filled in. If proposed ≤ existing, then section 6 can be skipped & section 7 filled in.
Drainage Method (infiltration/sewer/watercourse)	Infiltration	Infiltration	N/A	If different from the existing, please fill in section 3. If existing drainage is by infiltration and the proposed is not, discharge volumes may increase. Fill in section 6.

3. Proposing to Discharge Surface Water via

	Yes	No	Justification and Evidence that this is possible	Notes for developers
Infiltration	X		Soakage tests have been carried out within the site. Infiltration rate 9.78×10^{-5} m/s	Soakage tests will need to be provided and results included in drainage strategy. Section 7 (infiltration) must be filled in if infiltration is proposed.
To watercourse		X		If infiltration is not possible - is there a watercourse nearby? Have the EA or IDB provided input where necessary?
To surface water sewer		X	.	This should be a last resort. If required, has sewer provider confirmed that sufficient capacity exists for this connection? Has an appropriate connection detail been agreed?
Combination of above		X		e.g. part infiltration, part discharge to sewer or watercourse. Provide evidence as above.

4. Peak Discharge Rates – This is the maximum flow rate at which storm water runoff leaves the site during a particular storm event.

	Existing Rates (l/s)	Proposed Rates (l/s)	Difference (l/s) (Proposed-Existing)	Notes for developers
Greenfield QBAR	0.5 l/s	N/A	N/A	QBAR is approx. 1 in 2 storm event. Provide this if Section 7 (QBAR) is proposed.
1 in 1	0.5 l/s	0 l/s	-0.5 l/s	Proposed discharge rates (with mitigation) should be no greater than existing rates for all corresponding storm events. E.g. discharging all flow from site at the existing 1 in 100 event increases flood risk during smaller events.
1 in 30	1.2 l/s	0 l/s	-1.2 l/s	
1 in 100	1.6 l/s	0 l/s	-1.6 l/s	
1 in 100 plus climate change	N/A	0 l/s	-1.6 l/s	To mitigate for climate change the proposed 1 in 100 +CC must be no greater than the existing 1 in 100 runoff rate. If not, flood risk increases under climate change. <ul style="list-style-type: none"> - Where lifetime of development is 100 years (residential) 30% should be added to the peak rainfall intensity. - Where lifetime of development is 60 years (residential) 20% should be added to the peak rainfall intensity.

5. Calculate additional volumes for storage – The total volume of water leaving the development site. New hard surfaces potentially restrict the amount of storm water that can go to the ground, so this needs to be controlled so not to make flood risk worse to properties downstream.

	Existing Volume (m ³)	Proposed Volume (m ³)	Difference (m ³) (Proposed-Existing)	Notes for developers
1 in 1	16.946 m ³	0 m ³	-16.946 m ³	Proposed discharge volumes (without mitigation) should be no greater than existing volumes for all corresponding storm events. Any increase in volume increases flood risk elsewhere. Where volumes are increased section 6 must be filled in.
1 in 30	54.053 m ³	0 m ³	-54.053 m ³	
1 in 100	62.554 m ³	0 m ³	-62.554 m ³	
1 in 100 plus climate change	N/A	0 m ³	-62.554 m ³	To mitigate for climate change the volume discharge from site must be no greater than the existing 1 in 100 storm event. If not, flood risk will increase under climate change.

6. Calculate attenuation storage – Attenuation storage is provided to enable the rate of runoff from the site into the receiving watercourse to be limited to an acceptable rate to protect against erosion and flooding downstream. The attenuation storage volume is a function of the degree of development relative to the greenfield discharge rate.

		Notes for developers
What Storage Attenuation volume (Flow rate control) is required to retain rates as existing (m³) Where is the storage to be accommodated on site?	<p>2No. new cellular soakaways will be installed under parking area and soft area to attenuate and infiltrate runoff volume from roof area and adjacent hard paving.</p> <p>In addition, permeable paving for all car parks will drain and infiltrate runoff water from this area.</p> <p>New access road to the south of the site will drain into 2 No. swales and infiltrate into the ground</p>	Volume of water to attenuate on site if discharging at existing rates. Can't be used where discharge volumes are increasing

7. How is Storm Water stored on site?

Storage is required for the additional volume from site but also for holding back water to slow down the rate from the site. This is known as attenuation storage and long term storage. The idea is that the additional volume does not get into the watercourses, or if it does it is at an exceptionally low rate. You can either infiltrate the stored water back to ground, or if this isn't possible hold it back with on site storage. Firstly, can infiltration work on site?

			Notes for developers
Infiltration	State the Site's Geology and known Source Protection Zones (SPZ)	Outside SPZ	<ul style="list-style-type: none"> - Infiltration rates are highly variable, soakage tests should be comprehensive. - Avoid infiltrating in made ground. - Refer to Environment Agency website to identify and source protection zones (SPZ)
	Infiltration Rate (m/s)?	9.78x10 ⁻⁵ m/s	Infiltration rates should be no lower than 1x10 ⁻⁶ m/s.
	State the distance between a proposed infiltration device base and the ground water	No recorded	Need 1m (min) between the base of the infiltration device & the water table to protect Groundwater quality & ensure

	(GW) level		GW doesn't enter infiltration devices. Avoid infiltration where this isn't possible.
	Were infiltration rates obtained by desk study or infiltration test?	Infiltration test.	Infiltration rates can be estimated from desk studies at most stages of the planning system if a back up attenuation scheme is provided.
	Is the site contaminated? If yes, consider advice from others on whether infiltration can happen.	No.	Water should not be infiltrated through land that is contaminated. The Environment Agency may provide bespoke advice in planning consultations for contaminated sites that should be considered.
In light of the above, is infiltration feasible?	Yes/No? If the answer is No, please identify how the storm water will be stored prior to release	Yes.	If infiltration is not feasible how will the additional volume be stored? The applicant should consider the following options in the next section.

Storage requirements

The developer must confirm one of the two methods for dealing with the amount of water that needs to be stored on site.

Option 1 Simple – Store both the additional volume and attenuation volume in order to make a final discharge from site at **QBAR** (Mean annual flow rate). This is preferred if no infiltration can be made on site. This very simply satisfies the runoff rates and volume criteria.

Option 2 Complex – If some of the additional volume of water can be infiltrated back into the ground, the remainder can be discharged at a very low rate of 2 l/sec/hectare. A combined storage calculation using the partial permissible rate of 2 l/sec/hectare and the attenuation rate used to slow the runoff from site.

Please confirm what option has been chosen and how much storage is required on site.	Notes for developers
<p>2 new cellular soakaways with volumes of 54.72 m³ and 133.00 m³ will be installed under soft landscape area to attenuate and infiltrate runoff volume from roof and adjacent.</p> <p>In addition, permeable sub-base in car parks will drain and infiltrate runoff water</p>	<p>The developer at this stage should have an idea of the site characteristics and be able to explain what the storage requirements are on site and how it will be achieved.</p>

	<p>from this area.</p> <p>The new access road to the south will drain into 2No. swales located to both sides of the road.</p>	
--	---	--

8. Please confirm

		Notes for developers
1. Which Drainage Systems measures have been used? Provide an overview of the SuDS design scheme used? - Is the runoff managed at, or close to, the surface wherever possible. - Where the system serves more than one property, is public space used and integrated with the drainage system in an appropriate and beneficial way?	<ul style="list-style-type: none"> - Permeable paving - Cellular tanks - Swales 	SUDS can be adapted for most situations even where infiltration isn't feasible e.g. impermeable liners beneath some SUDS devices allows treatment but not infiltration. See CIRIA SUDS Manual C697.
2. Functionality Are the design features sufficiently durable to ensure structural integrity over the system design life (residential 100 years and commercial 60 years), with reasonable maintenance requirements?	Yes	
Are all parts of the SuDS system outside any areas of flood risk?	Yes	If not, provide justification and evidence that performance will not be adversely affected.
Has runoff and flooding from all sources (both on and off site) been considered and taken into account in the design?	Yes	
Has residual risk been addressed?	Yes refer Drainage strategy	<ul style="list-style-type: none"> • Does the drainage system contain the 1 in 30 storm event without any flooding (include description of how any exceedance of surface water systems will be routed exceptional rain fall away from property)? • Are 1 in 100 year flows contained or stored on-site within safe exceedance storage areas and flow paths? • Is any flooding between 1 in 30 and 100 +CC storm events safely contained on site, without causing property flooding or a hazard to site users? • Has it been ensured that there is no flooding from the system to downstream property or access routes for the 100 year + climate change event?

How are rates being restricted (hydro brakes etc.)?	No rates to be restricted	<ul style="list-style-type: none"> - Hydrobrakes to be used where rates are between 2l/s to 5l/s. - Orifices not to be used below 5l/s as the pipes may block. - Pipes with flows < 2l/s are prone to blockage.
3. Please confirm the owners/adopters of the entire drainage systems throughout the development. Please list all the owners.	Bicester Heritage Hotel	If these are multiple owners then a drawing illustrating exactly what features will be within each owner's remit must be submitted with this Proforma.
How is the entire drainage system to be maintained? An acceptable maintenance plan, clearly defining the operating and maintenance requirements of the drainage system will need to be submitted and approved.	The drainage drawings and schedules will form part of the O&M manual along with a post completion CCTV survey to ensure the system is fully operational at handover.	<p>If the features are to be maintained directly by the owners as stated in answer to the above question please answer yes to this question and submit the relevant maintenance schedule for each feature. If it is to be maintained by others than those above, please give details of each feature and the maintenance schedule.</p> <p>Clear details of the maintenance proposals of all elements of the proposed drainage system must be provided.</p> <p>Poorly maintained drainage can lead to increased flooding problems in the future.</p>

9. Evidence Please identify where the details quoted in the sections above were taken from. i.e. Plans, reports etc. Please also provide relevant drawings that need to accompany your pro-forma, in particular exceedance routes, ownership and location of SuDS (maintenance access strips etc.)

Pro-forma Section	Document reference where details quoted above are taken from	Page Number
Section 2	Drainage Strategy	1, Appendix A &C
Section 3	Drainage Strategy	Appendix C
Section 4	Drainage Strategy	Appendix B &D
Section 5	Drainage Strategy	Appendix B&D
Section 6	Drainage Strategy	Appendix C

Section 7	Drainage Strategy	Appendix A & C

The above form is completed using factual information and evidence from the Surface Water Drainage Strategy, Flood Risk Assessment and site plans and can be used as a summary of the surface water drainage strategy on this site, clearly showing that the proposed surface water rate and volume will not be increasing as a result of the development. Where an increase in rate or volume is shown the appropriate sections of the pro-forma have been completed setting out how the additional rate/volume is being dealt with, to ensure no increased flood risk on or off site.

Where the pro-forma is found to be acceptable to the Local Planning Authority then the surface water drainage system design must be built in accordance with the details provided here.

Form completed by: Graham Taylor

Qualification of person responsible for signing of this pro-forma: IEng MICE

Company: AKS Ward

On behalf of (Client's details): Bicester Heritage

Date 04.10.18

Appendix F
SuDS Maintenance Schedule

Cellular Tanks Operation & Maintenance Requirements

Regular inspection and maintenance is required to ensure the effective long-term operation of below ground modular storage systems.

Specific maintenance needs of the system should be monitored, and maintenance schedules adjusted to suit requirements.

Modular systems – operation and maintenance requirements

Maintenance schedule	Required action	Recommended Frequency
Regular maintenance	Inspect and identify any areas that are not operating correctly. If required, take remedial action.	Monthly for 3 months, then six monthly
	Debris removal from catchment surface (where may cause risks to performance)	Monthly
	Where rainfall infiltrates into blocks from above, check surface of filter for blockage by silt, algae or other matter. Remove and replace surface infiltration medium as necessary.	Monthly (and after large storms)
	Remove sediment from pre-treatment structures	Annually, or as required
Remedial actions	Repair/rehabilitation of inlets, outlet , overflows and vents	As required
Monitoring	Inspect/check all inlets, outlets, vents and overflows to ensure that they are in good condition and operating as designed	Annually and after large storms

Maintenance activities should be detailed in the health and safety plan and a risk assessment should be undertaken.

Permeable Paving Operation & Maintenance Requirements

Regular inspection and maintenance is important for the effective operation of pervious pavements. The facility should be inspected regularly, preferably during and after heavy rainfall to check effective operation and to identify any areas of ponding.

Pervious surfaces need to be regularly cleaned of silt and other sediments to preserve their infiltration capability. Manufacturers' recommendations should always be followed.

A brush cleaner, which can be a lorry-mounted device or a smaller precinct sweeper, should be used and the sweeping regime should be as follows:

1. End of winter (April) – to collect winter debris.
2. Mid-summer (July/August) – to collect dust, flower and grass-type deposits.
3. After autumn leaf fall (November).

Care should be taken in using vacuuming equipment to avoid removal of jointing material. Any lost material should be replaced.

If reconstruction is necessary, the following procedure should be followed:

1. Lift surface layer and laying course.
2. Remove any geo-textile filter layer.
3. Inspect sub-base and remove, and replace if required.
4. Renew any geo-textile layers.
5. Renew laying course, jointing material and concrete block paving.

The reconstruction of failed areas of concrete block pavement should be less costly and disruptive than the rehabilitation of continuous concrete or asphalt porous surfaces due to the reduced area that is likely to be affected. Materials removed from the voids or the layers below the surface may contain heavy metals and hydrocarbons and may need to be disposed of as controlled waste. Sediment testing should be carried out before disposal to confirm its classification and appropriate disposal methods.

Pervious pavement operation and maintenance requirements

Maintenance schedule	Required action	Frequency
Regular maintenance	Brushing	Once a year, after autumn leaf fall, or reduced frequency as required, based on site-specific observations of clogging or manufacturer's recommendations – pay particular attention to areas where water runs onto pervious surface from adjacent impermeable areas as this area is most likely to collect the most sediment
Occasional maintenance	Stabilize and mow contributing and adjacent areas	As required
	Removal of weeds or management using glyphosphate applied directly into the weeds by an applicator rather than spraying	As required – once per year on less frequently used pavements

Maintenance schedule	Required action	Frequency
Remedial actions	Remediate any landscaping which, through vegetation maintenance or soil slip, has been raised to within 50mm of the level of the paving	As required
	Remedial work to any depressions, rutting, and cracked or broken blocks considered detrimental to the structural performance or a hazard to users, and replace lost jointing material	As required
	Rehabilitation of surface and upper substructure by remedial sweeping	Every ten to fifteen years or as required (if infiltration performance is reduced due to significant clogging)
Monitoring	Initial inspection	Monthly for three months after installation
	Inspect for evidence of poor operation and/or weed growth – if required, take remedial action	Three-monthly, 48hrs after large storms in first six months
	Inspect silt accumulation rates and establish appropriate brushing frequencies	Annually
	Monitor inspection chambers	Annually

Maintenance activities should be detailed in the Health and Safety Plan and a risk assessment should be undertaken.

Swales Operation & Maintenance Requirements

Regular inspection and maintenance is important for the effective operation of swales as designed.

Adequate access must be provided to all swale areas for inspection and maintenance, including for appropriate equipment and vehicles. Operation and maintenance requirements for swales are described below.

Swales operation and maintenance requirements

Maintenance schedule	Required action	Frequency
Regular maintenance	Remove litter and debris	Monthly, or as required
	Cut grass – to retain grass height within specified design range	Monthly (during growing season), or as required
	Manage other vegetation and remove nuisance plants	Monthly at start, then as required
	Inspect inlets, outlets, and overflows for blockages and clear if required	Monthly
	Inspect infiltration surfaces for ponding, compaction, silt accumulation, record areas where water is ponding for >48hrs	Monthly, or when required
	Inspect vegetation coverage	Monthly for six months, quarterly for two years, then bi-annually
	Inspect inlets and facility surface for silt accumulation, establish appropriate silt removal frequencies	
Occasional maintenance	Reseed areas of poor vegetation growth, alter plant types to better suit conditions, if required	As required or if bare soil is exposed over 10% or more of the swale treatment area
Remedial actions	Repair erosion or other damage by re-turfing or reseeding	As required
	Re-level uneven surfaces and reinstate design levels	As required
	Scarf and spike topsoil layer to improve infiltration performance, break up silt deposits, and prevent compaction of the soil surface	As required
	Remove buildup of sediment on upstream gravel trench, flow spreader of the soil surface	As required
	Remove and dispose of oils or petrol residues using safe standard practices	As required
Monitoring	Inspect inlets, outlets and overflows for blockages, and clear if required	Monthly

Maintenance schedule	Required action	Frequency
	Inspect infiltration surfaces for ponding, compaction, silt accumulation. Record areas where water is ponding for >48 hours	Monthly, or when required
	Inspect inlets and facility surface for silt accumulation. Establish appropriate silt removal frequencies	Half yearly

Sediments excavated from swales that receive runoff from residential or standard road and roof areas are generally not toxic or hazardous material and can be safely disposed of by either land application or land filling. However, consultation should take place with the environmental regulator to confirm appropriate protocols. Sediment testing may be required before sediment excavation to determine its classification and appropriate disposal methods. For industrial site runoff, sediment testing will be essential. In the majority of cases, it will be acceptable to distribute the sediment on site if there is an appropriate safe and acceptable location to do so.

Many of the specific maintenance activities for swales can be undertaken as part of a general landscaping contract and so if landscape management is already required at site, should have marginal cost implications.

Maintenance activities should be detailed in the health and safety plan and a risk assessment should be undertaken.